LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET
Lincoln, NE 68510-1514
(402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 96390052001

Issued 09/26/96
Expires 03/26/97
Revenue Code 18754

Establishment
CLIFFORD WOLFE
T11N R7E SEC 27
8300 N 70 STREET

FEES: $50.00

TOTAL $50.00

Permittee
CLIFFORD WOLFE
8300 N 70 ST
LINCOLN NE 68517

Issued By M. Jane Ford
Health Director

2627

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-25-96

The undersigned hereby applies for a permit to ALTER [X], EXTEND [ ], or REPAIR [ ] an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11 N ; Range 7E ; Section 27 ;
Block _____ ; Lot _____ ; Addition _____ 40 Acres
Street Address RR 2 3300 N 70

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. Bedrooms 2
Describe _____
Other Use [ ]
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank [X]; Other [X] Lagoon must be sealed

4. Description of proposed alteration, extension or repair: Change septic system to lagoon

5. Work to be done by: Owner [X] ; or Contractor [ ] , _____
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	500

Clifford A Wolfe
Signature of Applicant (owner or lessee)

3300 N 70 Lincoln
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: RECEIVED SEP 25 1996
Filing Fee: $ 50.00 # 4119

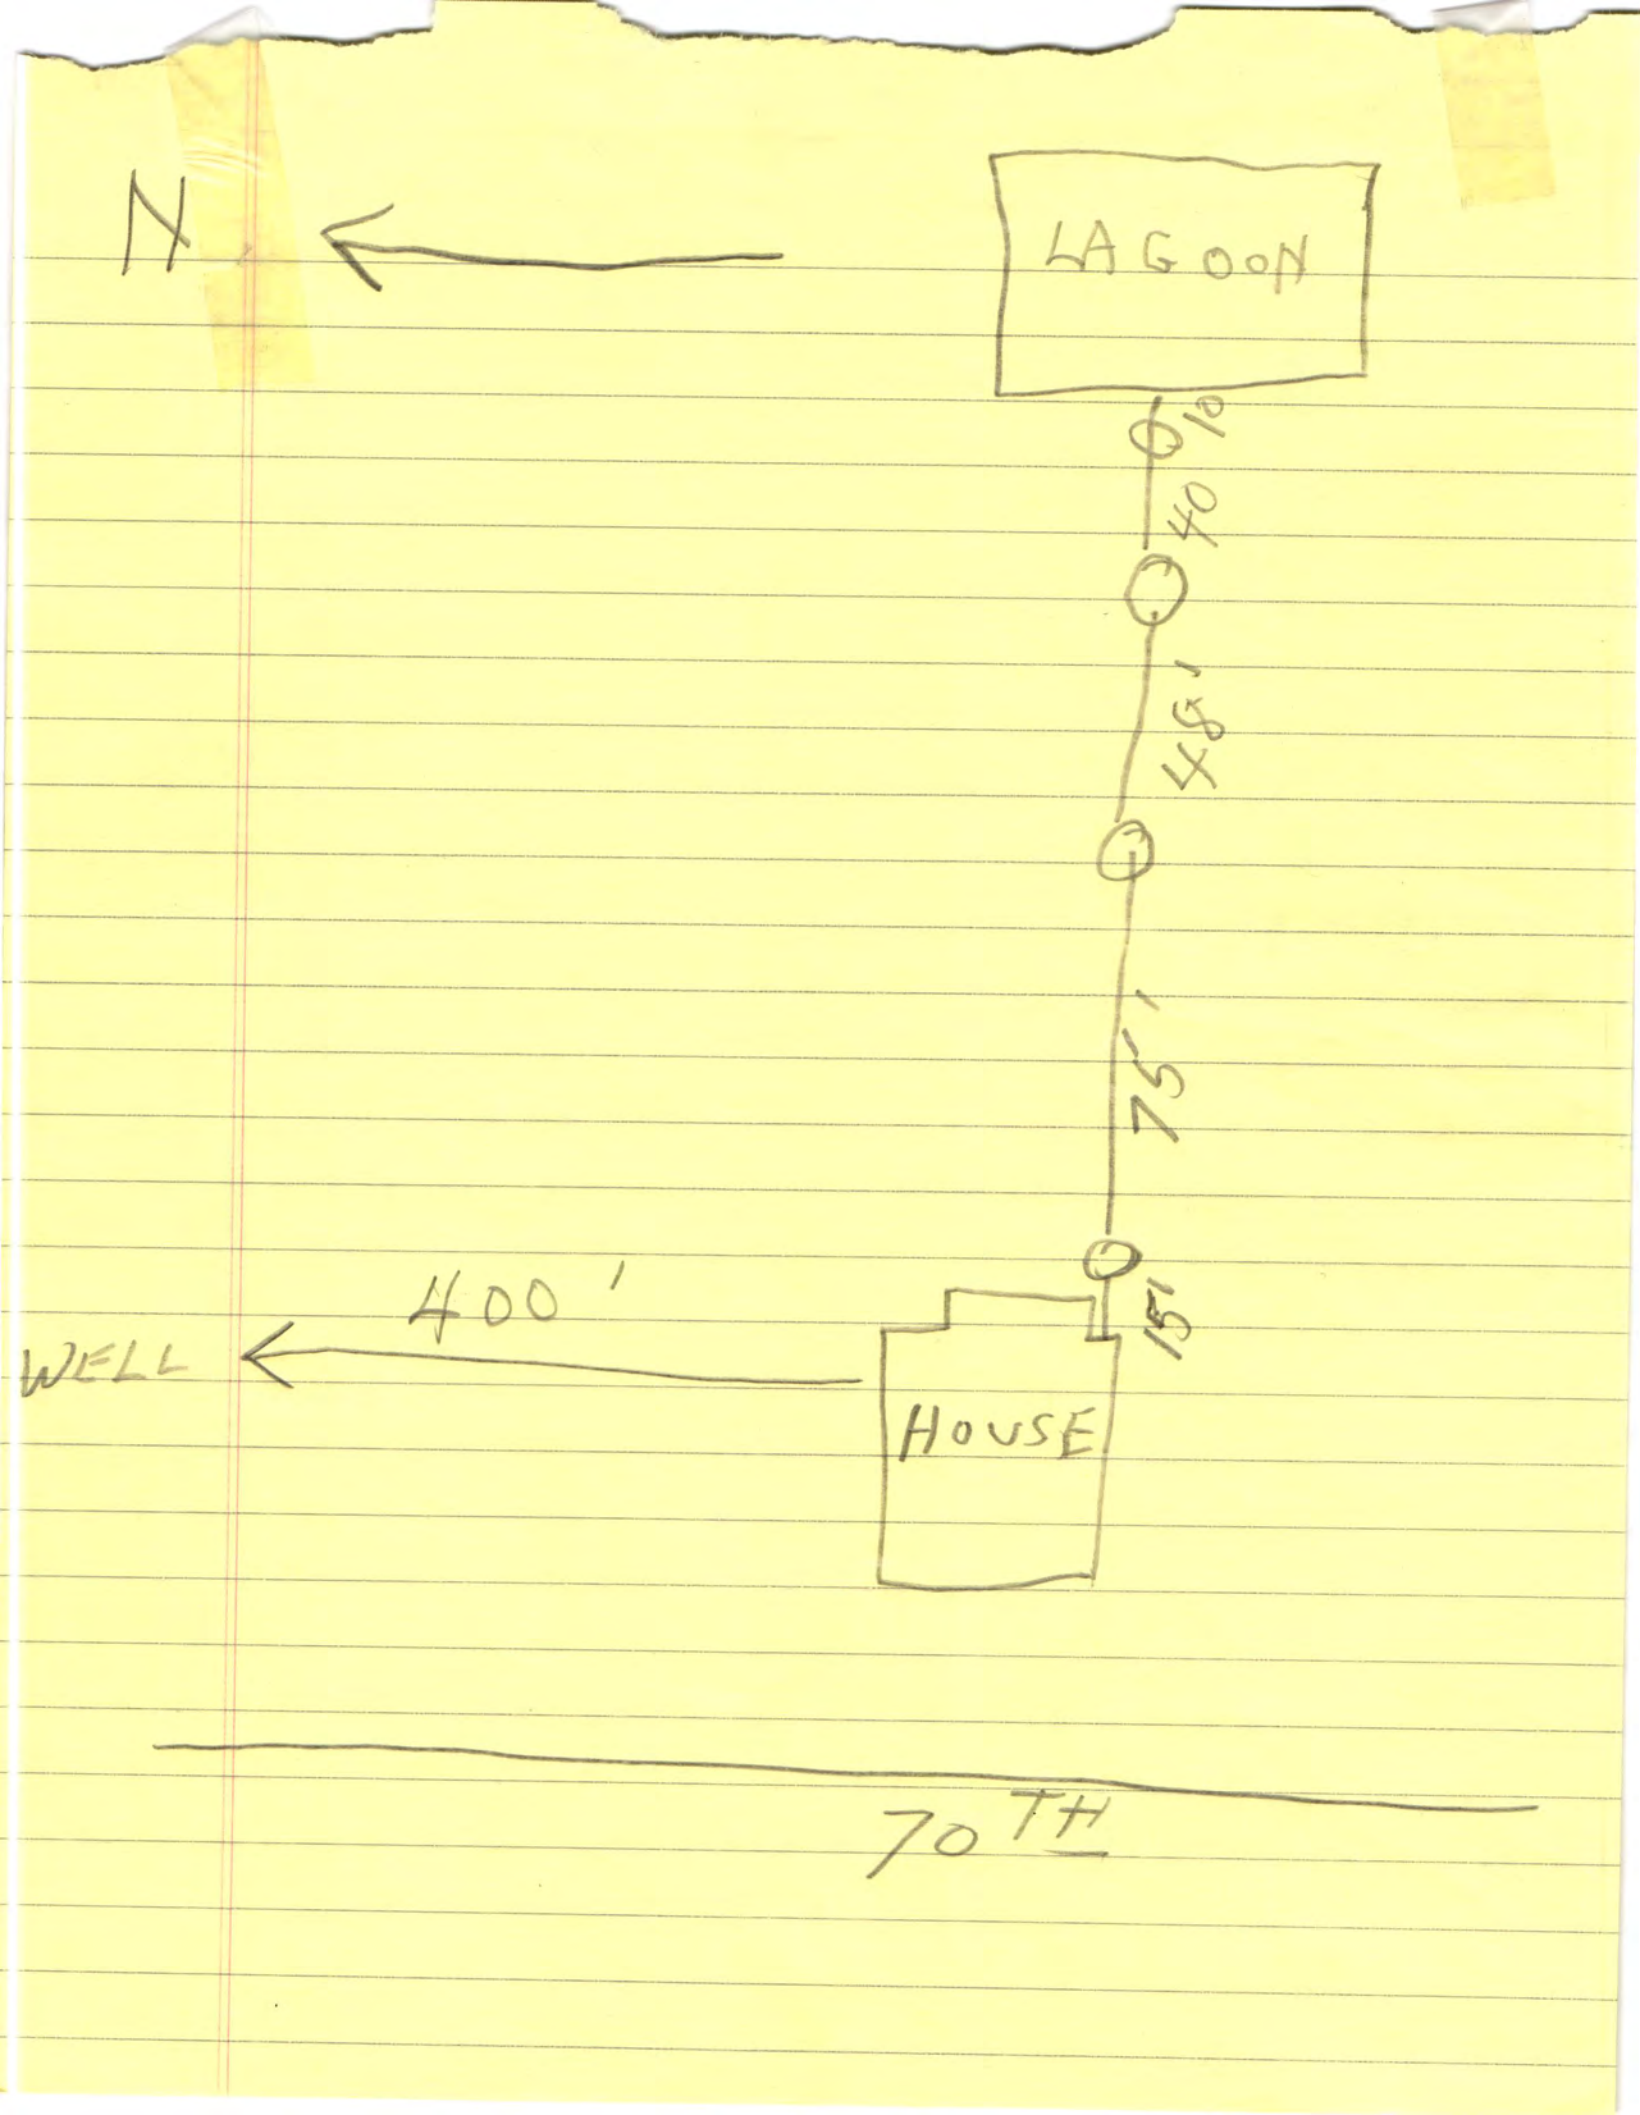
2. Site Visits:
Date: 4-2-98 by: sm *
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved [X]; Disapproved [ ]
by: Jerrold E. Hood

4. INSTALLATION ~~FINAL~~ PROVISIONAL WRITTEN APPROVAL
Date: 4-3-98 by: Ron Mayhew

* Lagoon rather large for a 2-bdrm. 48' x 55'; North, south & east outside slopes of dikes is too steep. Installed & covered without inspection by LLCHD.
- tank was abandoned from old system

2248 OR 240


N
LAGOON
10'
40'
48'
15'
15'
400'
WELL
HOUSE
70TH


N.70th
LANCASTER COUNTY, N
(Joins sheet 15)
(Joins sheet 19)
(Joins sheet 25)
N
Scale 1:20000
5000 Feet
0
1000
2000
3000
4000
5000
1 455 000 FEET
2 790 000 FEET
SALT CREEK
SEWAGE LAGOON
SANITARY LANDFILL
20
21
22
27
28
29
32
33
34