FILE NO. 282

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

January 3, 1973 — THIS LICENSE OR PERMIT EXPIRES

Gary D. Walker — LICENSEE OR PERMITTEE

1310 B Street — ADDRESS

T11N; R7E; Sec. 19-NW 1/4 — NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
6210.155	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 282

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 11N; Range TE; Section 19 NW¼
Block ____; Lot ____; Addition ____;
Street Address RFD DAVEY.

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bedrooms 3. Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: ____ ft.

Gary D Walker
Signature of Applicant (owner or lessee)

1310 B St Apt 5
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 7/3/72. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 7/3/72. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 7/3/72. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 7/3/72. Signature: Chas. E. Neal

3. City Engineer: Date Rec'd. ____. ACTION: Approved ___ [✓] Disapproved [ ]
Date Frwd. 7-3-72. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 282

DATE: July 1, 1972

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 11N; Range 7E; Section NW¼
Block _____; Lot _____; Addition _____;
Street Address RFD DAVEY.

2. Property Use: Residential [X]; Commercial [ ]
No. of Bed Rooms 3 Describe: _____

Other Use [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Gary D. Walker
Signature of Applicant (owner or lessee)

1310 S St APT #5
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 4/6/73 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 7/3/72
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/6/73 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 282

PROPERTY WHERE SOIL TESTED:
Location: Township NORTH BLUFF
Section & ¼ Sect. NW¼ SEC 19-11-7
Property Dimensions: 270 ft. x 170 ft.
Area: 1.1 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☑; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: GARY WALKER
Address 1310 B ST APT #5

Dates of Tests: 6-24- to 7-25. Weather: Precip. 0 Temp. 85 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	54"	6-24	8 00	6-25	8 00	6-25	8 30	6"	9 00	5	30 MIN	1	30 - 1
2	54"	6-24	"	6-25	"	"	"	6"	"	4½	30 MIN	1½	" 1½
3	54"	6-24	"	"	"	"	"	6"	"	4¾	"	1¼	" 1¼
4	54"	"	"	"	"	"	"	6"	"	4½	"	1½	" 1½
5	54"	"	"	"	"	"	"	"	"	4¾	"	1¼	" 1¼
6	54"	"	"	"	"	"	"	4	"	4⅞	"	1⅛	" 1⅛

Sum of Percolation Rates 6 1/8
Average of Rates: 1¼
Mean of Rates: 30 MIN - 1¼

Gary A. Walker
Signature of Person Conducting Test

Address 1310 B ST
Phone: 477-8842

(Do not write below this line)

REVIEWING ACTION

REMARKS:

Approved Percolation Rate(s)
A. 24 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: June 30, 1972

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 282

SPECIFICATIONS

DATE: 7-1-72


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 36 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material FIBERGLASS; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 50 in.
3. Factory Built: Yes ☒ (Company CORRIGATED FIBERGLASS) No ☐
4. Manholes: Over Inlet; diam. 12 in.
Over Outlet; diam. ___ in.
Below Grade ___ in.
5. Inlet: Baffle ☒; or Tee ☒
6. Outlet: Baffle ☒; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 50 in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☒, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF Round
2. Lateral Lines: Depth below grade 50 in.
Number 4; Length of each line 44 ft
Total length of Laterals 169 ft.;
Slope 6 in/100 ft. Diameter of pipe 16 in.; Shape ___
Material: concrete ☐; (fiberGLASS) asbestos ☐; clay ☐; other ___
Distance between lateral lines 8 ft.
3. Trench Dimensions: Depth 36 in.; Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 16 in.
5. Distances To:
Well or Suction Line 120 ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line ___ ft.
6. Percolation Rate: ~~30~~ 24 minutes/inch

TYPICAL SKETCHES

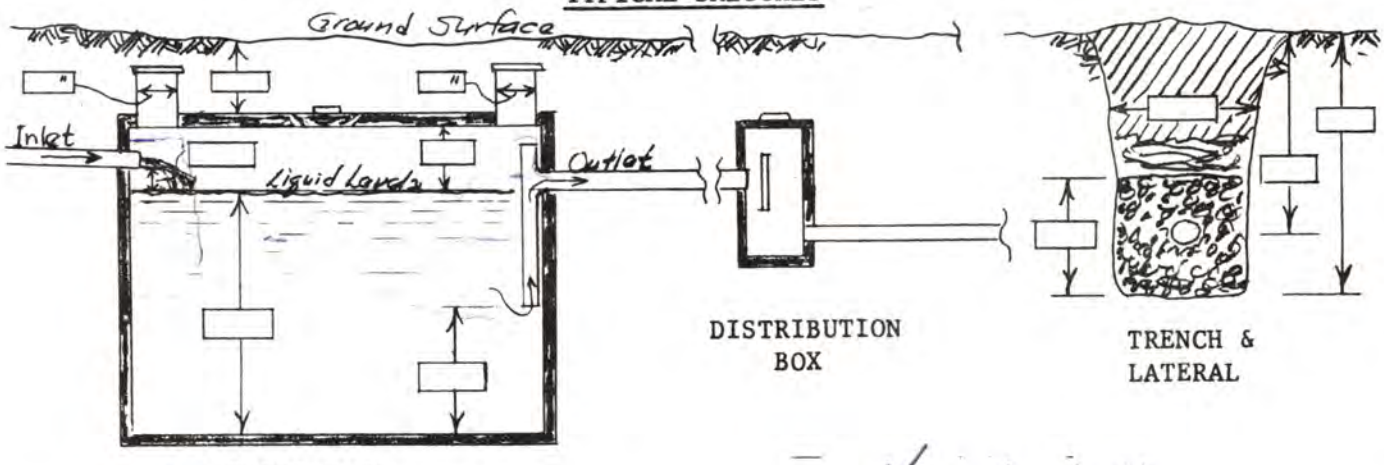


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

8/1170

Gary D. Walker
Signature of Applicant

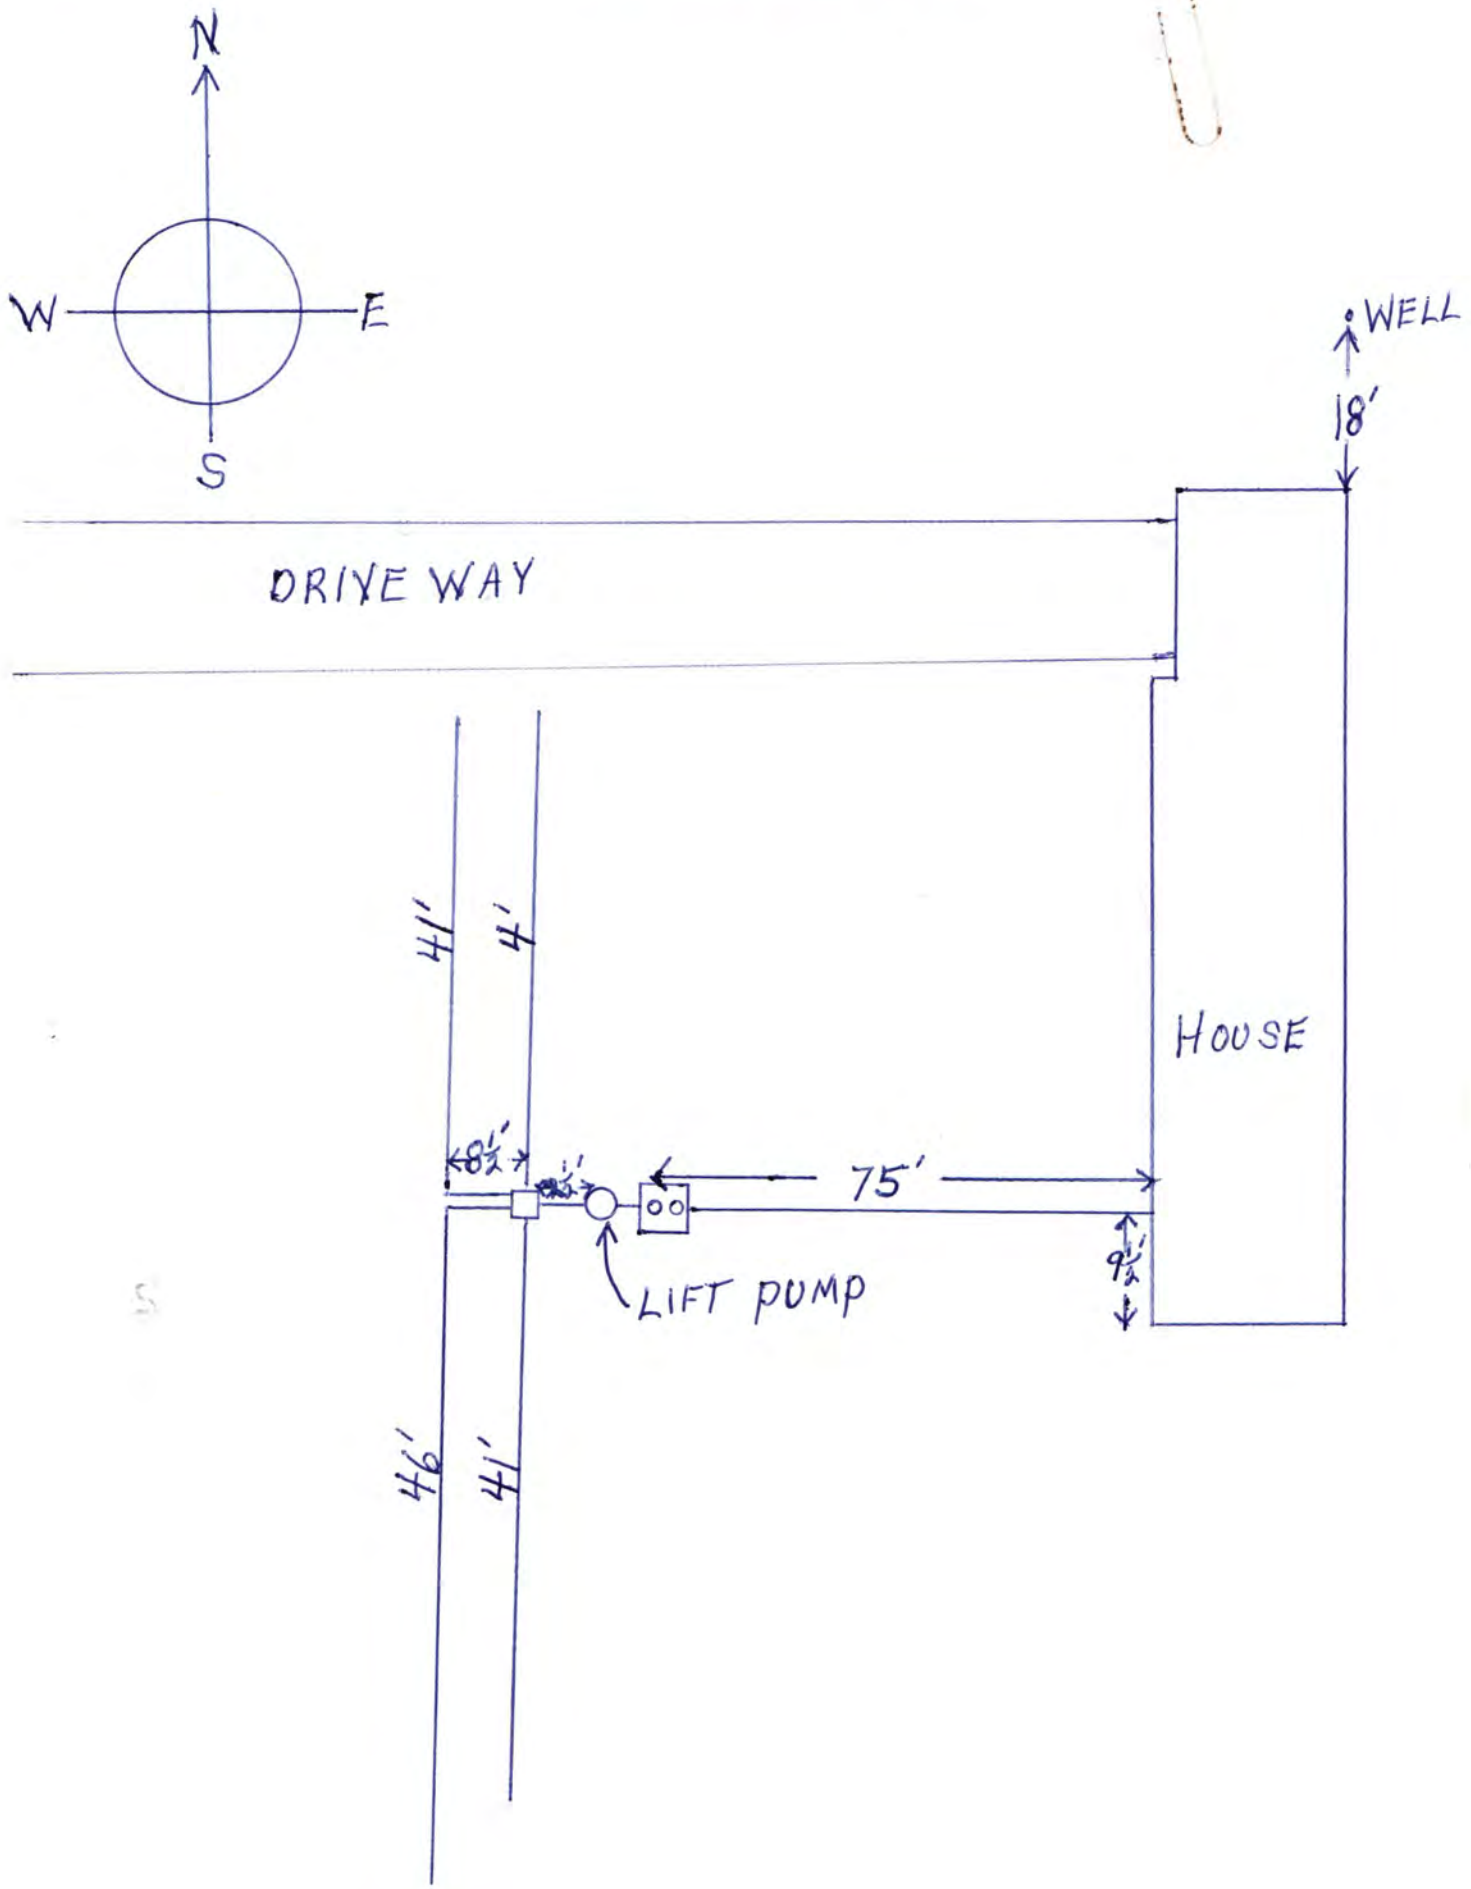
N
W
E
S
WELL
18'
DRIVE WAY
HOUSE
41'
4'
8½'
1'
75'
9½'
LIFT PUMP
94'
41'

INTER-DEPARTMENT COMMUNICATION

TO Charles Seale

DEPARTMENT Building Inspections

ATTENTION

CARBONS TO

DATE **July 3, 1972**

FROM Jerrold C. Hood

DEPARTMENT Health

SUBJECT Individual Sewage System Construction - File No. **282**
(**Gary D. Walker**
1310 B Street)

The application and plans have been reviewed and approved for the construction of an individual sewage disposal system on property legally described as:

T11N; R7E; Section 19-NW 1/4

Jerrold C. Hood, R. S., Chief
Section of General Sanitation
Division of Environmental Health

JCH: **ch**