LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

3140 "N" STREET ENVIRONMENTAL HEALTH DIVISION Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit

SEWAGE SYSTEM REPAIR

No. 95390048001

Issued 10/05/95
Expires 04/05/96
Revenue Code 18754

Establishment

DEWAYNE FRIESEN
T11N R7E SEC 11
FINIGANS BLK 2 LOT 6
12201 FINNIGAN ROAD

FEES: $50.00

TOTAL $50.00

Permittee

DEWAYNE FRIESEN
RRT 001
LINCOLN NE 68502

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☐

Lincoln-Lancaster County
HEALTH DEPARTMENT
3140 "N" STREET LINCOLN, NE 68510-1514

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: Oct 4, 1995

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11N ; Range 7E ; Section 11 ;
Block 2 ; Lot 6 ; Addition FINIGANS
Street Address 13201 Finnigan Rd

2. Property Use: Residential X ☐; Commercial _____ ☐
No. Bedrooms 3
Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: Short East End of Laterals x 24' add 60' of lateral Half moon

5. Work to be done by: Owner ☐ ; or Contractor ☒, FRIESEN EXCAVATING
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$ 1400.00

DeWayne Friesen
Signature of Applicant (owner or lessee)

RT. #1, LINCOLN, NEBRASKA 68502
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 50.00

2. Site Visits:
Date: 10/4/95 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 10/11/95 by: Jerrold Hood

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 1835-C

INDIVIDIAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF PERMIT

APRIL 5, 1982
THIS PERMIT EXPIRES

David L. Hall 1207 Stillwater Lincoln, NE 68502
ISSUED TO ADDRESS

T11N, R7E, Section 11, Block 2, Lot 6, Addition Finnigan Subdivision
LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY DATE AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

FILING FEE: $60.00

FILE NO. 1835-C

DATE: Oct 5,1981

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 11 N ; Range 7 E ; Section 11 ;
   Block 2 : Lot 6 : Addition Finnigan subdivision
   Street Address 12201 Finnigan Rd.

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: aprox. 4 miles ft.

David L Hall
Signature of Applicant (Owner or Lessee)

1207 Stillwater, Lincoln, NE 68502
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 10/5/81 . Date Frwd. 10/5/81 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. . Date Frwd. 10/5/81 . ACTION: Approved ☒ Disapproved ☐ Signature: Gary M Shawcat

3. City or County Engineer: Date Rec'd. . Date Frwd. . ACTION: Approved ☒ Disapproved ☐ Signature: Don Thomas

REMARKS OR REASONS FOR DISAPPROVAL

Site Visits:
Date: 10/29/81 by: L.C.H.
Date: by:
Date: by:

PROVISONAL

INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 4-8-82 By: Ron Mangum

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

HEAT PUMP DISCHARGE WELL WITHIN 100' OF LATERAL

FORM 20105-0477

SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township _____; Range _____; Section & ¼ Section _____.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 9-22-81 to 9-23-81. Weather: Precip. 0 Temp. 60°.

OWNER: _____

Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	32	9-22	5:30 PM	9-23	6:00 PM	9-23	6:00 PM	12	9:30 PM	3	30M	½	
2										4		½	
3										3½		¾	
4										2		¾	
5										3		½	
6										2½		¾	

Sum of Percolation Rates: 3¾
Average of Rates: .1625
Mean of Rates: _____

Donna R. LaPosa
Signature of Person Conducting Test

Address PRECAST STEP CO Phone 464-0638

(Do not write below this line)

REVIEWING ACTION

Approved Percolation Rate (a)
A. 48 min./inch
B. _____ min./inch
C. _____ min./inch

Remarks: _____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date: October 5, 1981
Confirmed. 10/29/81

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541


C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

REALLE FINIGAN SUB DIVISION

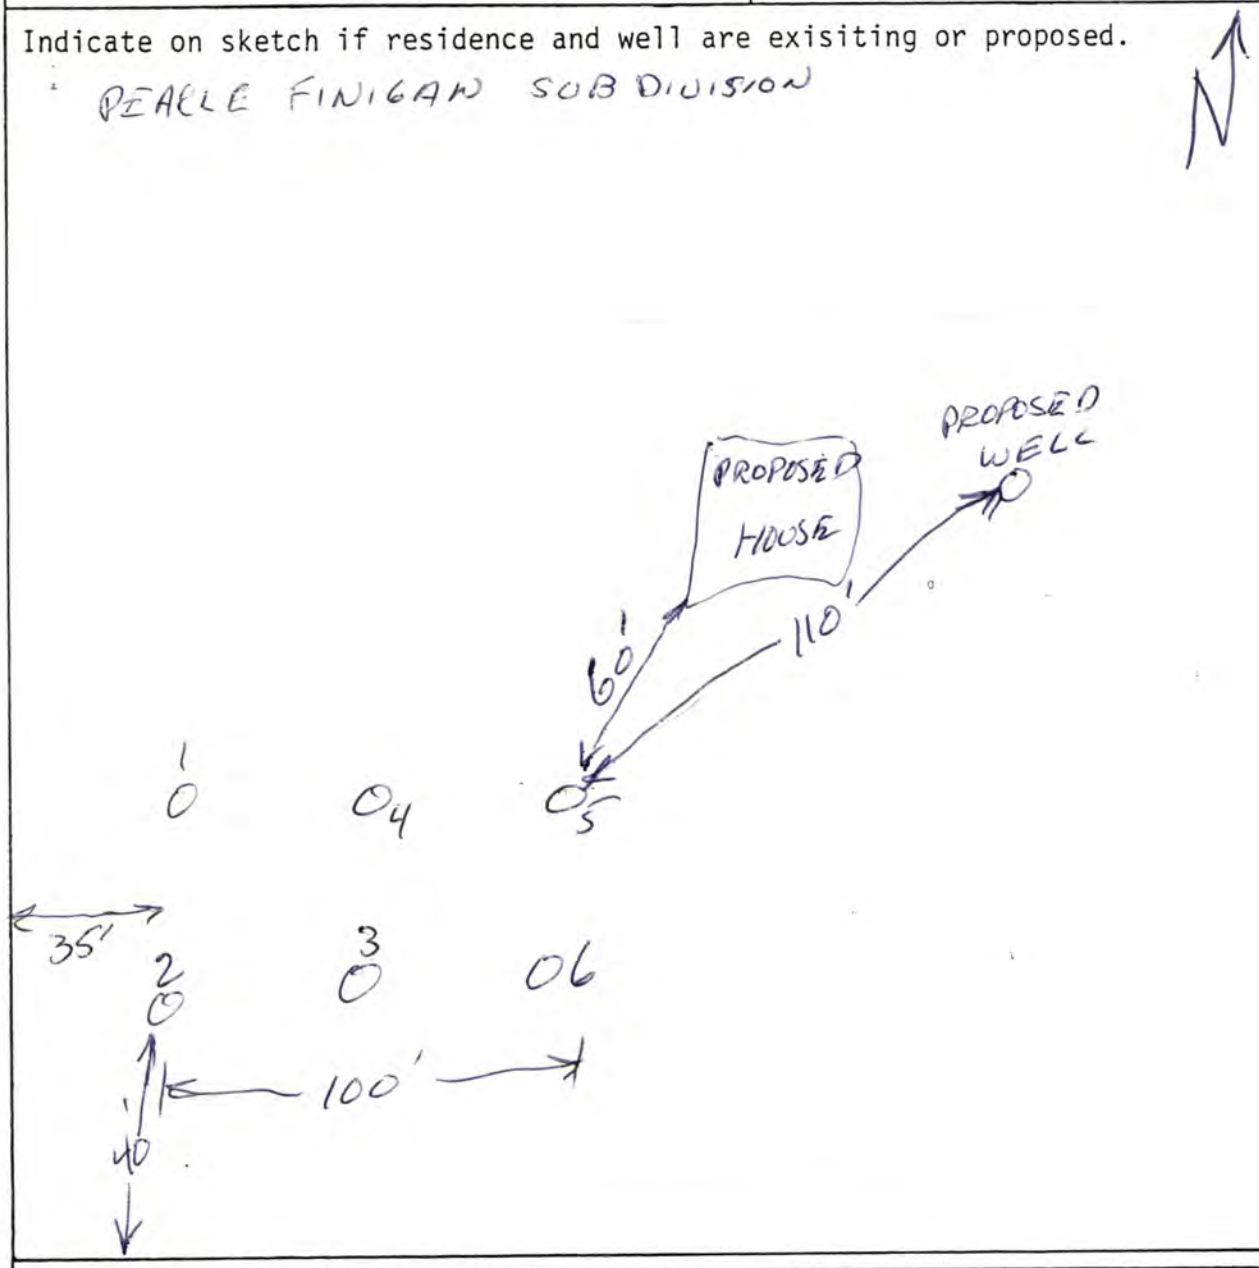

¼ MILE N. OF WAVERLY RD

REVIEWING ACTION

Remarks: _____


Date: October 5, 1981

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Lateral 305 ft.
3. With a Trench Width of 36" in.
4. Total Area of Lateral needed 916 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

DAVE HALL ROUND HOUSE- 86TH & WAVERLY ROAD

REC'D NOV 12 1981

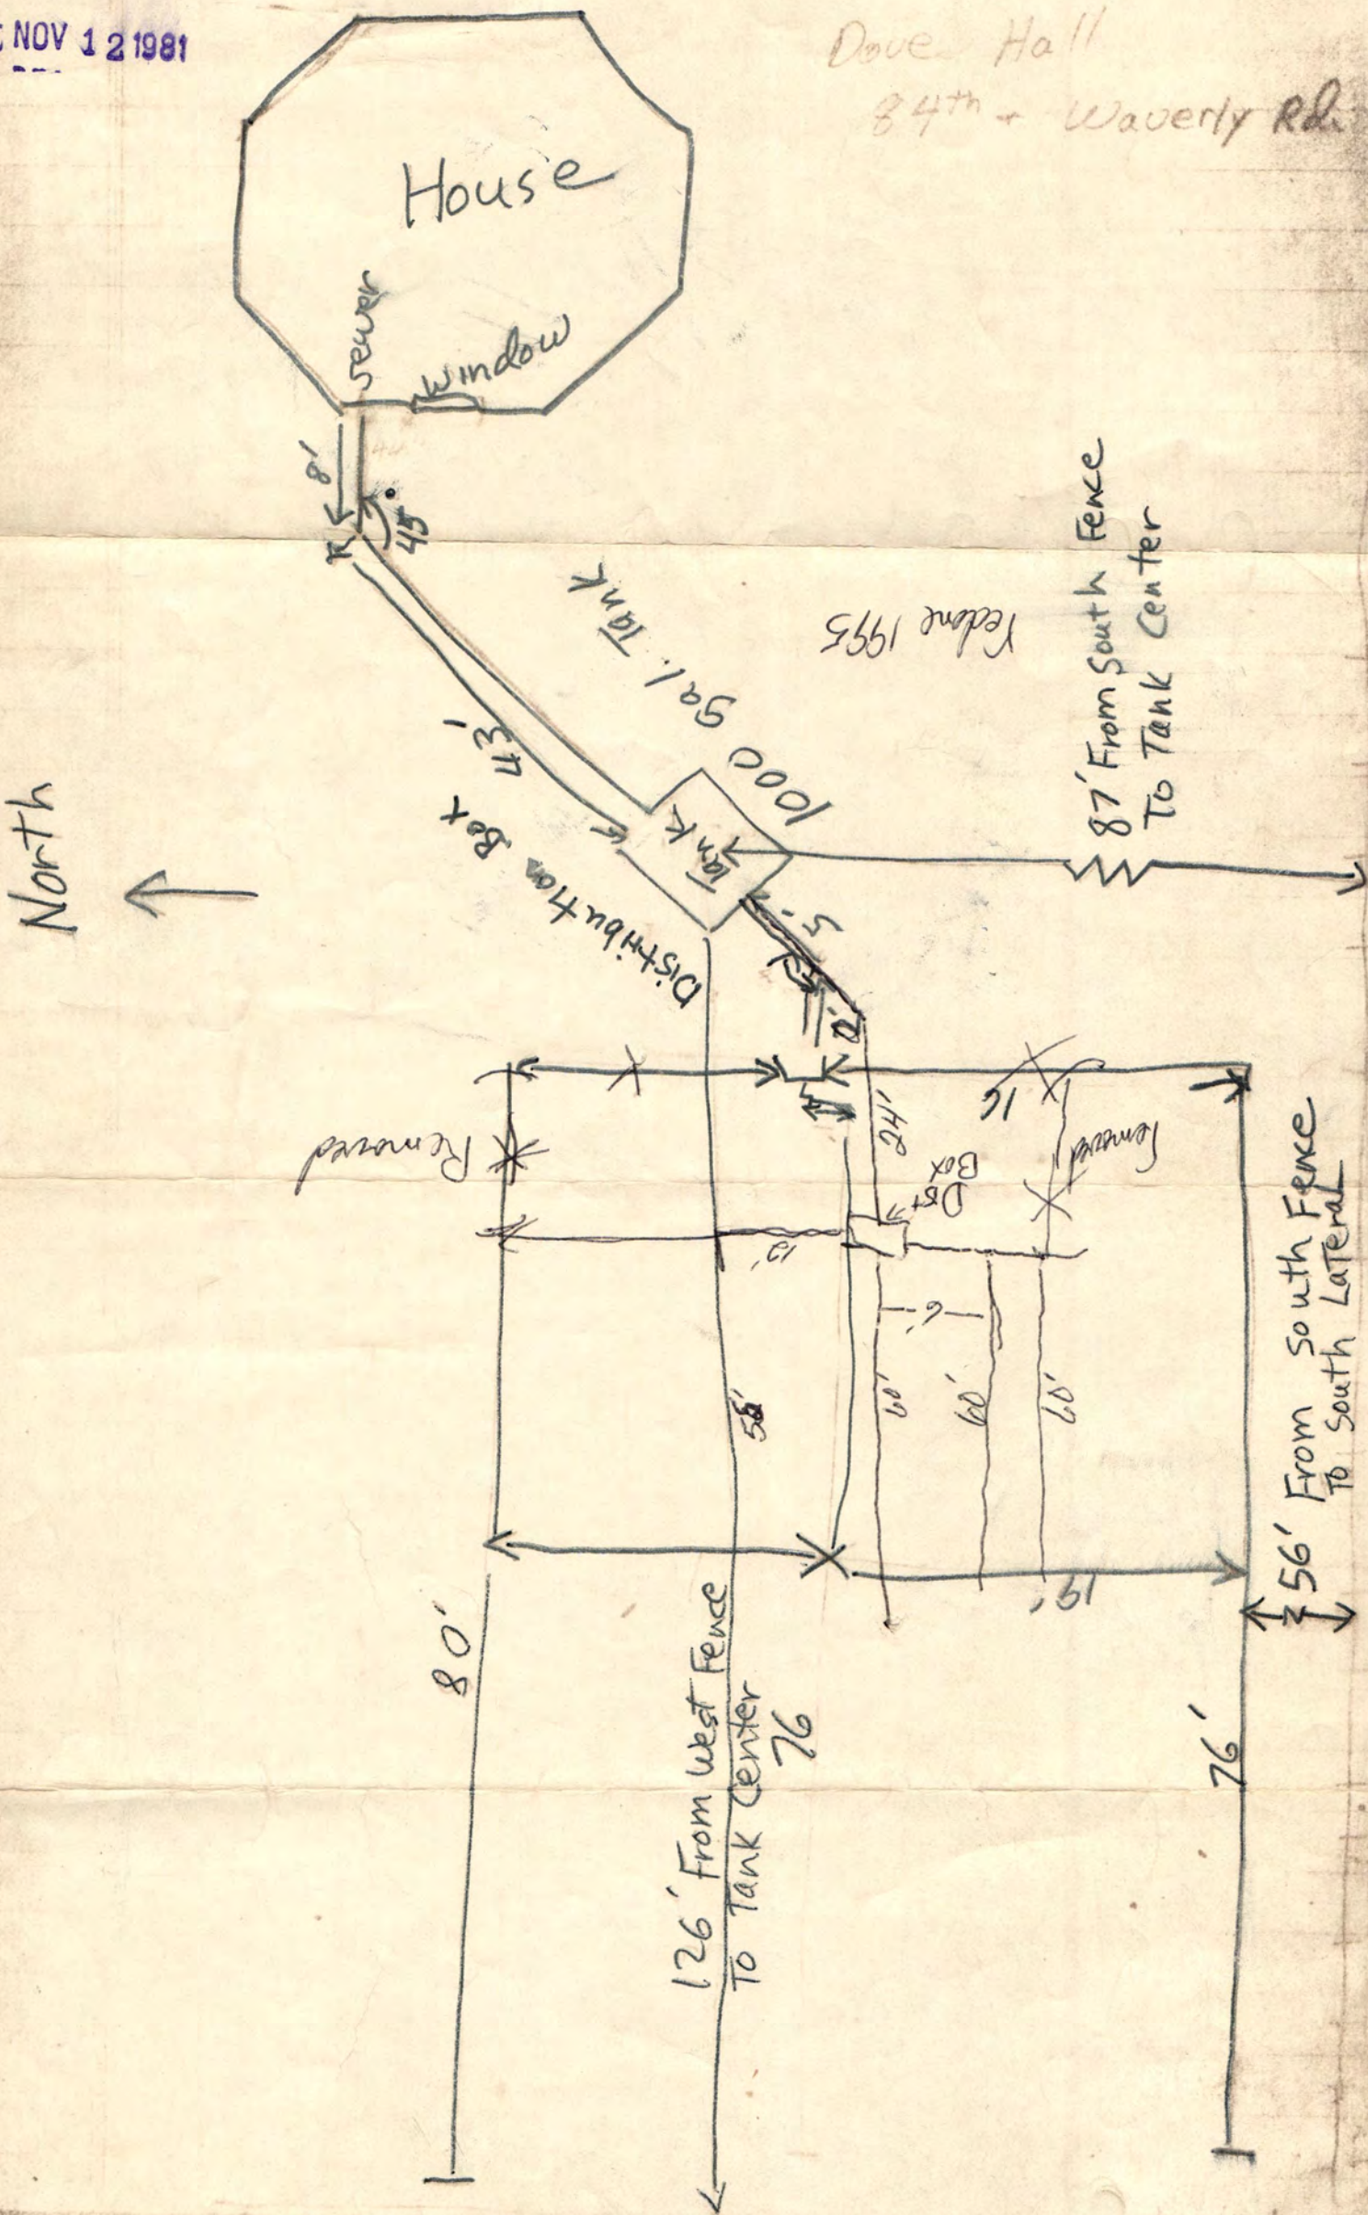

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 12201 Finigan Rd.

Twp 11 Range 7 Section 11 1/4 ___ 1/4 ___ Block 2 Lot 6 Addition ___

Directions to Property Finigan's Sub Block 2 Lot 6 Directions – Highway 77 north to Waverly Road, east to ¼ mile past 84th Street, north on Finigan ¼ mile

Location of Well Main well – east of house, 2nd well (heat pump) southwest house Tap Location: Inside ☐ Outside ☒

Location of Sewage System South-west corner of lot Year Installed 1982 new lateral – 1996?

	NAME	ADDRESS	PHONE
Present Owner:	Terrence Buethe	12201 Finigan Lincoln, NE 68517	466-9479
Tenant/Buyer:	Brian & Mary Gansemer	521 Wedgewood Drive Lincoln NE 68510	489-7974
Return to:	Brian & Mary Gansemer	521 Wedgewood Drive Lincoln, NE 68510	

Signature of Applicant Bill Gansemer Address 521 Wedgewood Dr Lincoln, NE 68510 Date 5/20/99

HEALTH DEPARTMENT USE ONLY

RECEIVED

Date 05/20/99
Initials ss
Amount 150.00
Check No. 2948

DATA ENTRY

Date ___/___/___
Case No. ___
Initials ___

Boc P8525-18

NO3 P7726-68

PRELIMINARY STATUS--By Ron Maryanek **DATE:** 5/21/99

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ 1.2 ppm	☐ ___ ppm

SEWAGE SYSTEM	
Approved	☒
Provisional	☐
Disapproved	☐

Additional Site Visits

Date___/___/___by___
Date___/___/___by___
Date___/___/___by___

Comments: Recommend checking to see if septic tank needs pumping

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved ☒ **SEWAGE DISPOSAL SYSTEM:** Approved ☒ Provisional Approval ☐

Approved by Ron Maryanek Date 5/26/99

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95

©11

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 12201 Finigan Rd

Twp 11N Range 7E Section 11 1/4 SW 1/4 Block 2 Lot 6 Addition Finigan 5th Sub

Directions to Property 1st Rd North (Just east of 84 & Waverly Rd)

Location of Well East of Front Door Tap Location: Inside ☒ Outside ☒

Location of Sewage System SW of house Year Installed Unknown

	NAME	ADDRESS	PHONE
Present Owner:	Mattie Jones	12201 Finigan Rd ~~Property~~ Lincoln No 68514	none
Tenant/Buyer:	Terrence Buethe	5843 Randolph Lincoln No 68510	486-3286
Return to:	Harry Matthews C/o Home Real Estate	4444 O ST Lincoln No 68510	475-4444

Signature of Applicant Harry Matthews Address 4444 O ST Lincoln No 68510 Date 9/18/95

HEALTH DEPARTMENT USE ONLY

Date Received 9/18/95 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS–By Ron Marquart **DATE:** 9/20/95

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☒ Corrected
Bacteria	☒ 0 /ml	☐ /ml
Nitrate	☒ 0.1 ppm	☐ ppm

SEWAGE SYSTEM
Approved ☐
Provisional ☐
Disapproved ☐

Additional Site Visits
Date 10/5/95 by J.C.H. Still high water
Date 10/5/95 by J.C.H.
Date 10/17/95 by Ron

Comments:

See Attached Letter ☐


FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒ Provisional Approval: ☐

Approved by Ron Marquart, R.S. Date 10/23/95

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

Central Office
4444 "O" Street
Lincoln, Nebraska 68510-2182
402-475-4444
402-435-4417 fax

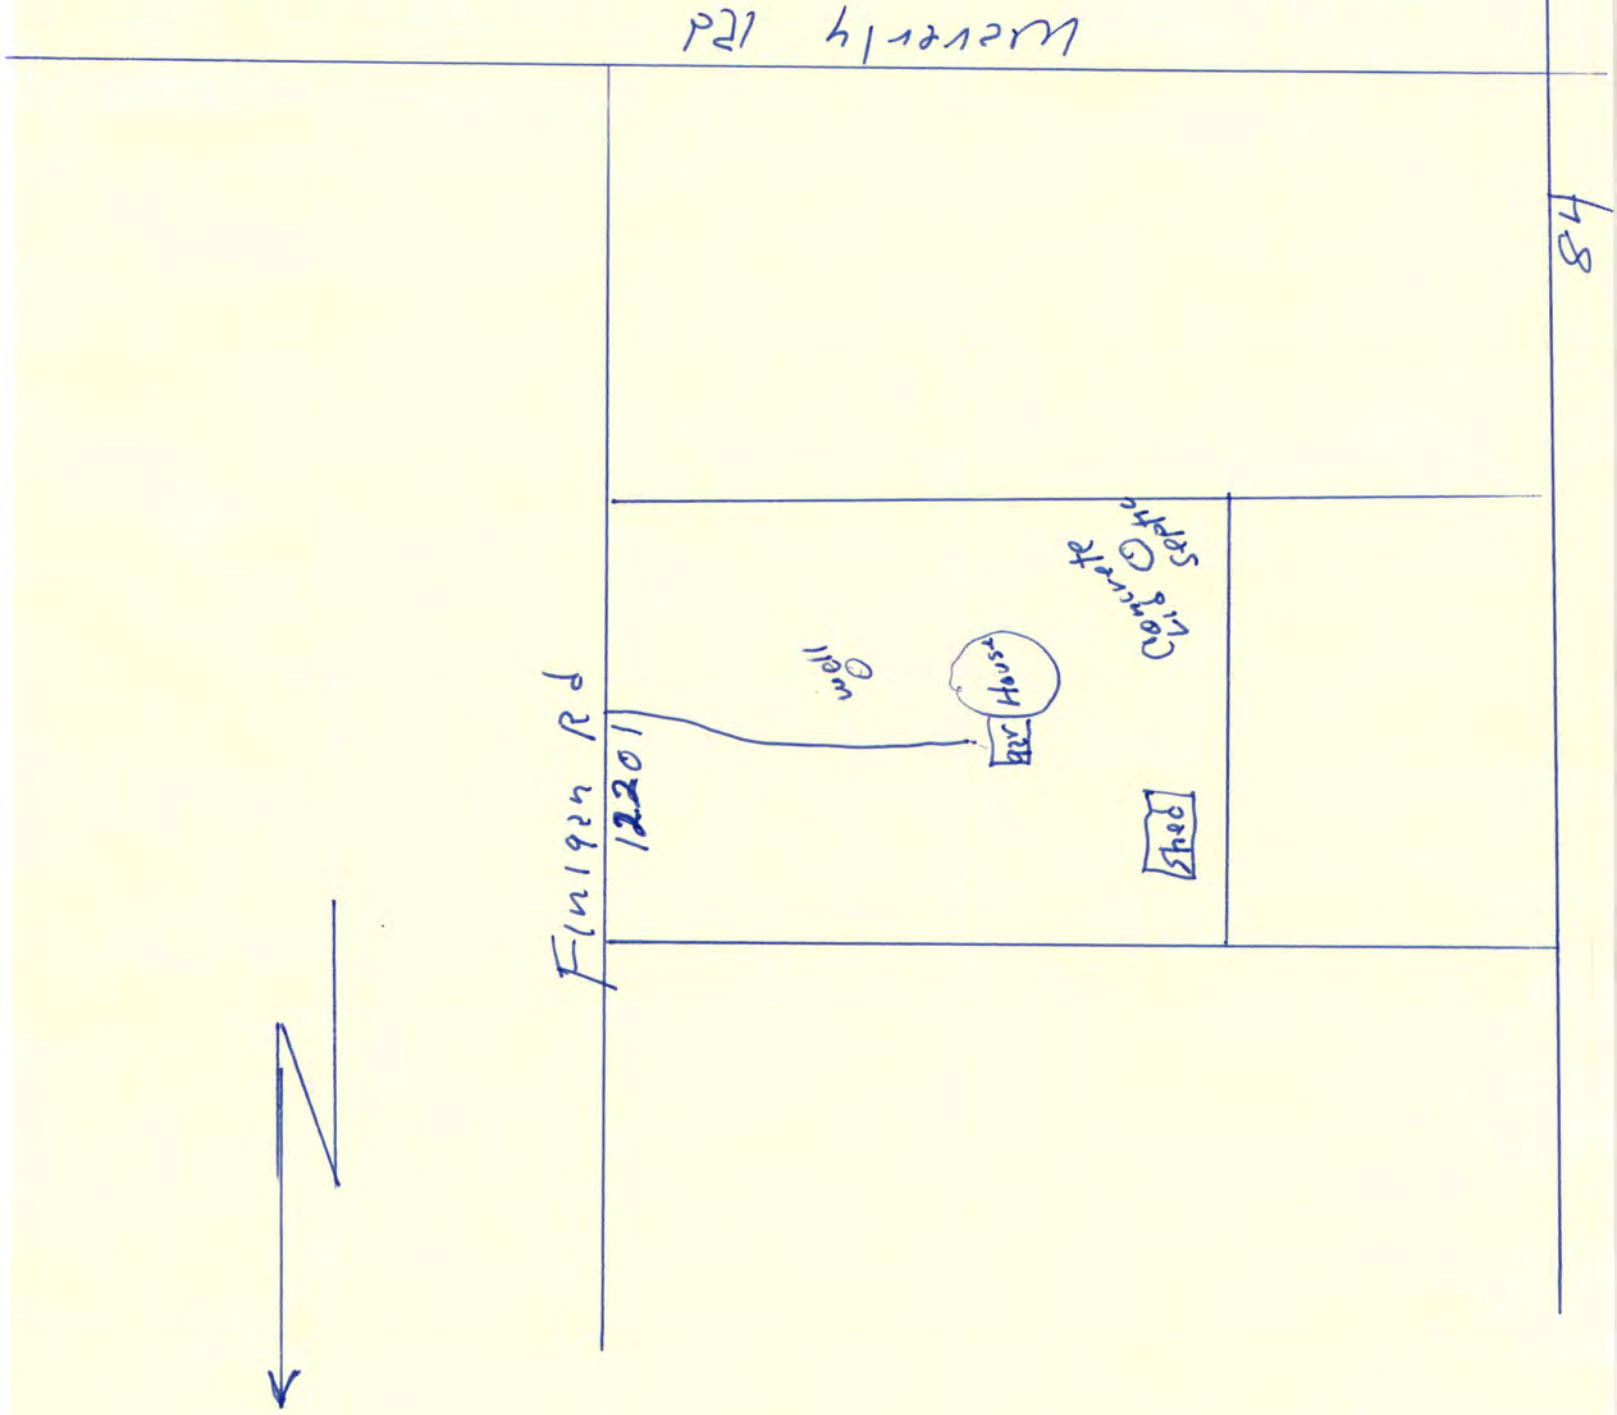

HOME Real Estate's Mission

To provide each individual outstanding service and exceptional opportunities in real estate through our commitment to professional and ethical performance by our entire organization.