CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 239

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — July 19, 1972

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Robert Gilliam — Route #8, Lincoln, Nebraska

LICENSEE OR PERMITTEE — ADDRESS

T10N; R6E; Sec. 31; Bl. 4, Lot 1; High Ridge Acres Add.

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 110.15 1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 239

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 4; Lot 21; Addition _____;
Street Address Highridge Terrace.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bedrooms 3. Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: _____ ft.

Robert Dillion
Signature of Applicant (owner or lessee)
Rt 8 Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 1/19/72. ACTION: Approved [ ] Disapproved [X]
Date Frwd. 1/19/72. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 1-19-72. ACTION: Approved [ ] Disapproved [X]
Date Frwd. _____. Signature: Charles Seals By R.S.

3. City Engineer: Date Rec'd. _____. ACTION: Approved [ ] Disapproved [ ]
Date Frwd. 1-19-72. Signature: _____

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: _____ Signature _____

339

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 239

DATE: Jan 18, 1972

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 4; Lot 1; Addition ____;
Street Address Highridge Acres

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bed Rooms 2 Describe: ____

Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Robert Gilliam
Signature of Applicant (owner or lessee)
by Roger Bailey

Rt 8 Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $ 30.00

2. Date Site Clearance ____

3. Site Visits:
Date: 4/25/72 by: O.S.S.
Date: ____ by: ____
Date: ____ by: ____

4. Date: Approved [X]; Disapproved [ ]: 1/19/72
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/27/72 by: Jerrold C. Hood

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 239

SPECIFICATIONS

DATE: Jan 18, 1972


A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments _____.
2. Capacity 1000 gals.; Liquid depth 50 in.
3. Factory Built: Yes [X] (Company _____)
No [ ]
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. ___in.
Below Grade 24 in.
5. Inlet: Baffle [ ]; or Tee [X]
6. Outlet: Baffle [ ]; or Tee [ ]
Depth of outlet below inlet 2 in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material _____; No. available outlets _____.
2. Factory Built: Yes [ ], (Company _____ No [ ]
3. Dimension: Length ____in.; Width ___in. Depth ____in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes [ ], No [ ] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Tile round
2. Lateral Lines: Depth below grade __in.
Number ____; Length of each line ___ft
Total length of Laterals ____ft.;
Slope 6 in/100 ft. Diameter of pipe ____ in.; Shape _____
Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other _____
Distance between lateral lines ____ft.
3. Trench Dimensions: Depth 36 in.; Width 48 in.
4. Filter Material: _____.
Depth of material from trench bottom 16 in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

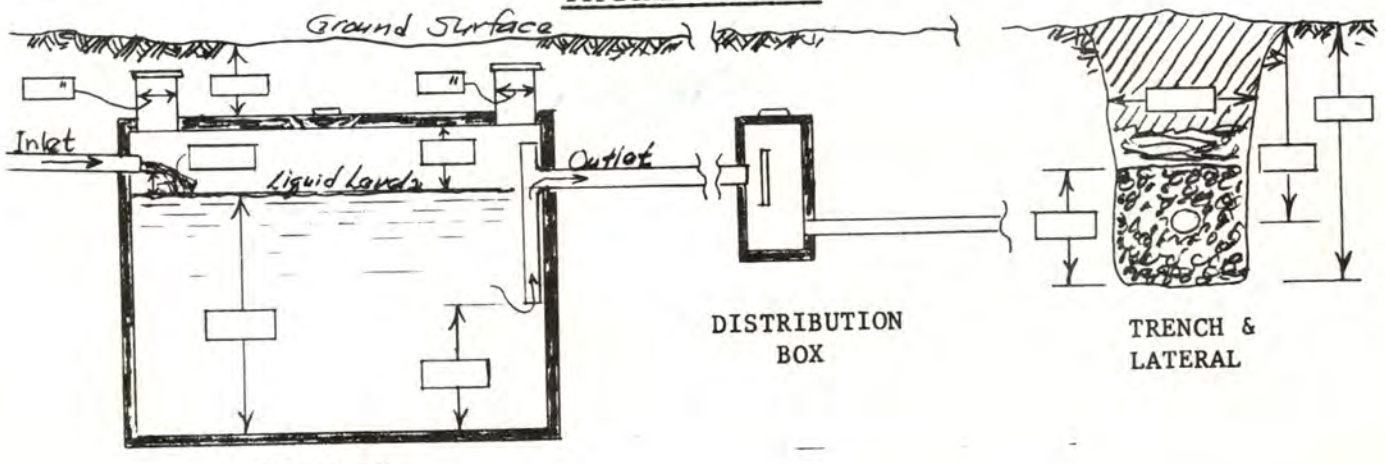

Signature of Applicant

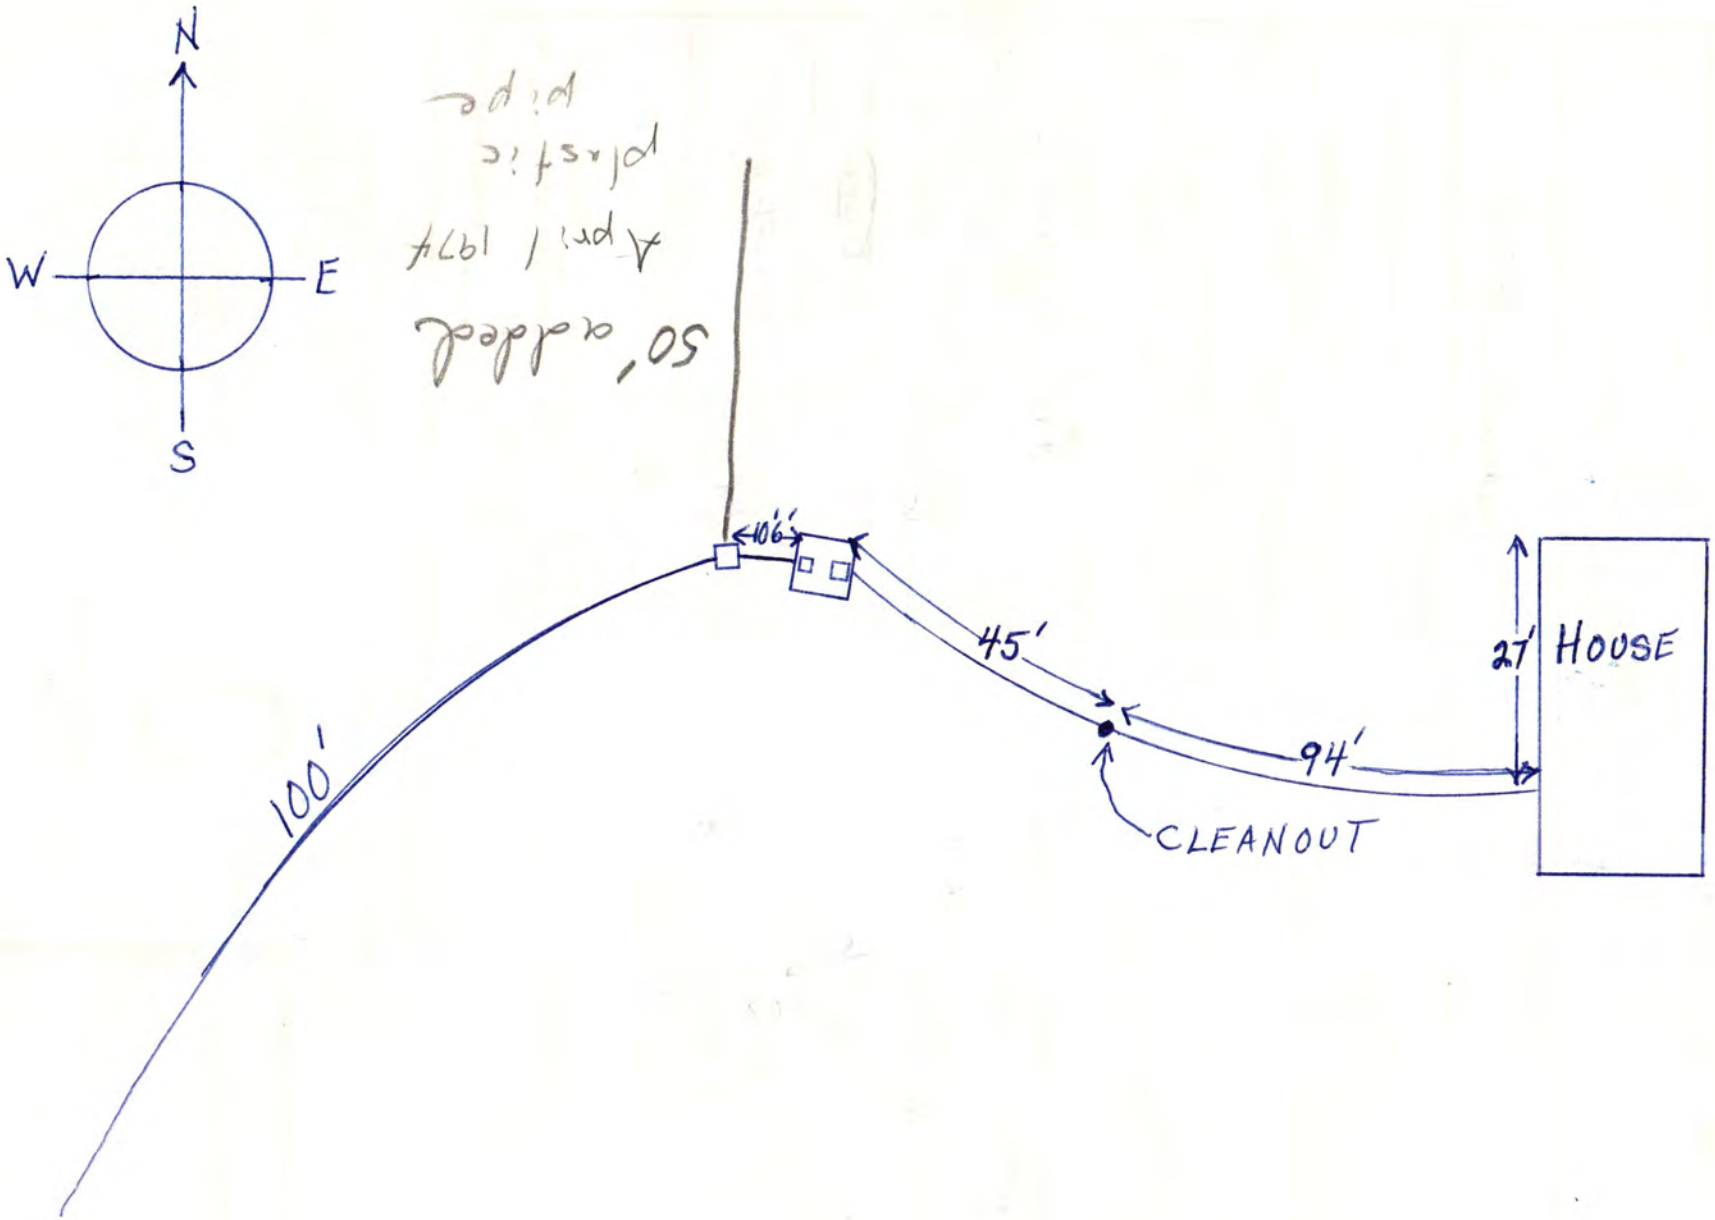
N
W
E
S
106'
45'
94'
100'
27'
HOUSE
CLEANOUT
ROAD

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☑ Evaluation of the Individual Water System Date: July 7, 1991

☑ Evaluation of the Sewage Disposal System ☑ Enclosed is $150.00

Legal Description of Property: TWP. 10N; RANGE 6E; SECTION 31; BLOCK 4

LOT 1; ADDITION High Ridge Acres; Street Address 1705 S.W. 47th

Directions to Property West on West 'A' St. to S.W. 47th. Turn L. left on S.W. 47th. Third House on West side of Street. Name on Mail Box.

Location of Well ~~145' West of House~~ 20' East of House Tap Location: Inside ☐ Outside ☑

Location of Sewage System (145' West of House) Year Installed 1971

	NAME	ADDRESS	PHONE
Present Owner:	Norman Chastek	1705 S.W. 47th	4381705
Tenant/Buyer:			
Return to:			

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Norman Chastek Address 1705 S.W. 47th Lincoln, Nebr. 68523

==========

HEALTH DEPARTMENT USE ONLY

Date Received JULY 10, 1991 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE JULY 11, 1991

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:	
Construction	☐	☒	Approved:	☐	Date 7/11/91	by J.C.H
Bacteria	☒	☐	Provisional:	☐	Date 7/19/91	by J.C.H
Nitrate	☒	☐	Disapproved:	☒	Date	by

Comments: EVIDENCE OF SEEPAGE AT ENDS OF LATERALS. SLIGHT DEPRESSION AROUND WELL, TOP OF WELL IS TOO CLOSE TO GROUND LEVEL. OUTSIDE FAUCETS ARE TOO LOW TO GROUND TO GET SAMPLE BOTTLE UNDER. NO ONE HOME. See Attached Letter ☐

all corrected 7/19/91 J.C.H.

FINAL STATUS

	WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
	Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Lerold C. Hood R.S. DATE JULY 24, 1991

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832