FILE NO. 209

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

January 22, 1972 — THIS LICENSE OR PERMIT EXPIRES

Bob Gilliam — LICENSEE OR PERMITTEE

7120 Logan — ADDRESS

T10N; Range 6E; Section 31; Block 5; High Ridge Acres — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 110.15 1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 5; Lot 7; Addition _____;
Street Address High Ridge acres

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. of Bedrooms 2. Describe: _____
Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: 2 mi ft.

Robert Dillman
Signature of Applicant (owner or lessee)

7120 Logan
Address Knob Boggenstoff

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 7/21/71. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. _____. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 7/22/71. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. 7/22/71. Signature: Chas. Fink by BS.

3. City Engineer: Date Rec'd. 7-22-71. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. 7-22-71. Signature: J. L. Blessing

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. _____

DATE: July 21, 1971

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 5; Lot 7; Addition _____;
Street Address High Ridge Acres.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 2 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Bob Gillespie
Signature of Applicant (owner or lessee)

7120 Logan
Address Ruth Biggenroth

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 9/24/71 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 7/21/71
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 9/24/71 by: Jerrold C. Hood

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 209

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material ~~CI~~ PLASTIC; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 4 in.
3. Distance between dwelling and septic tank 15 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Con; No. of compartments ___.
2. Capacity 1000 gals.; Liquid depth ___ in.
3. Factory Built: Yes ☒ (Company PRE-CAST) No ☐
4. Manholes: Over Inlet; diam. ___ in.
Over Outlet; diam. ___ in.
Below Grade ___ in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

C. DISTRIBUTION BOX
1. Material Con; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 11 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF MOON
2. Lateral Lines: Depth below grade ___ in.
Number 1; Length of each line 100 ft
Total length of Laterals 100 ft.;
Slope 4 in/100 ft. Diameter of pipe 16 in.; Shape ∩
Material: concrete ☒; fiber asbestos ☐; clay ☐; other FIBERGLASS
Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth ___ in.; Width 48 in.
4. Filter Material: GRAVEL.
Depth of material from trench bottom ___ in.
5. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line ___ ft.
6. Percolation Rate: _____ minutes/inch

TYPICAL SKETCHES

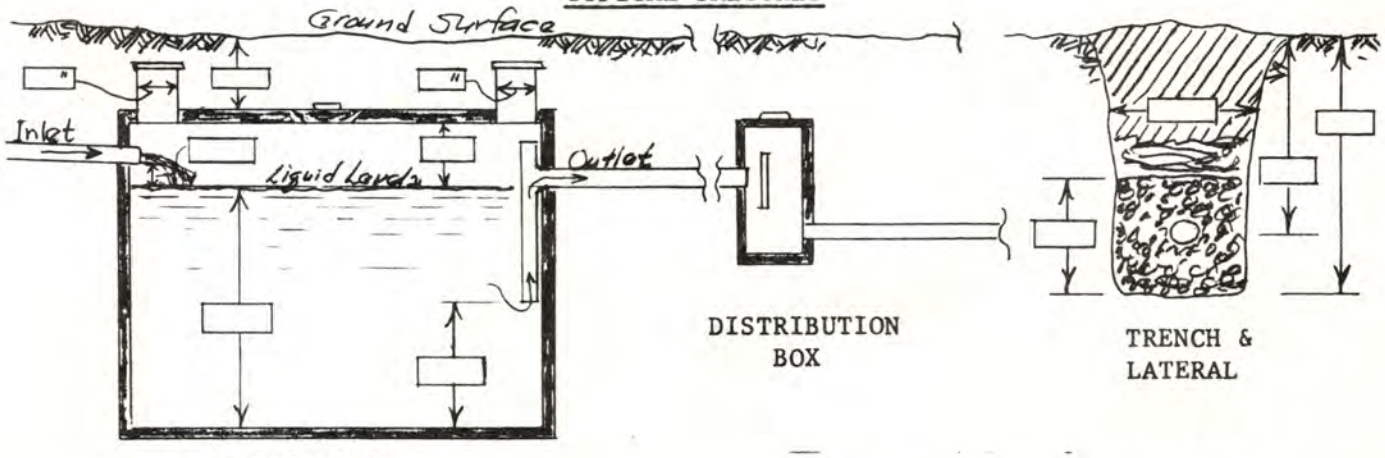

SEPTIC TANK

Kurt Eigenbrodt
Signature of Applicant

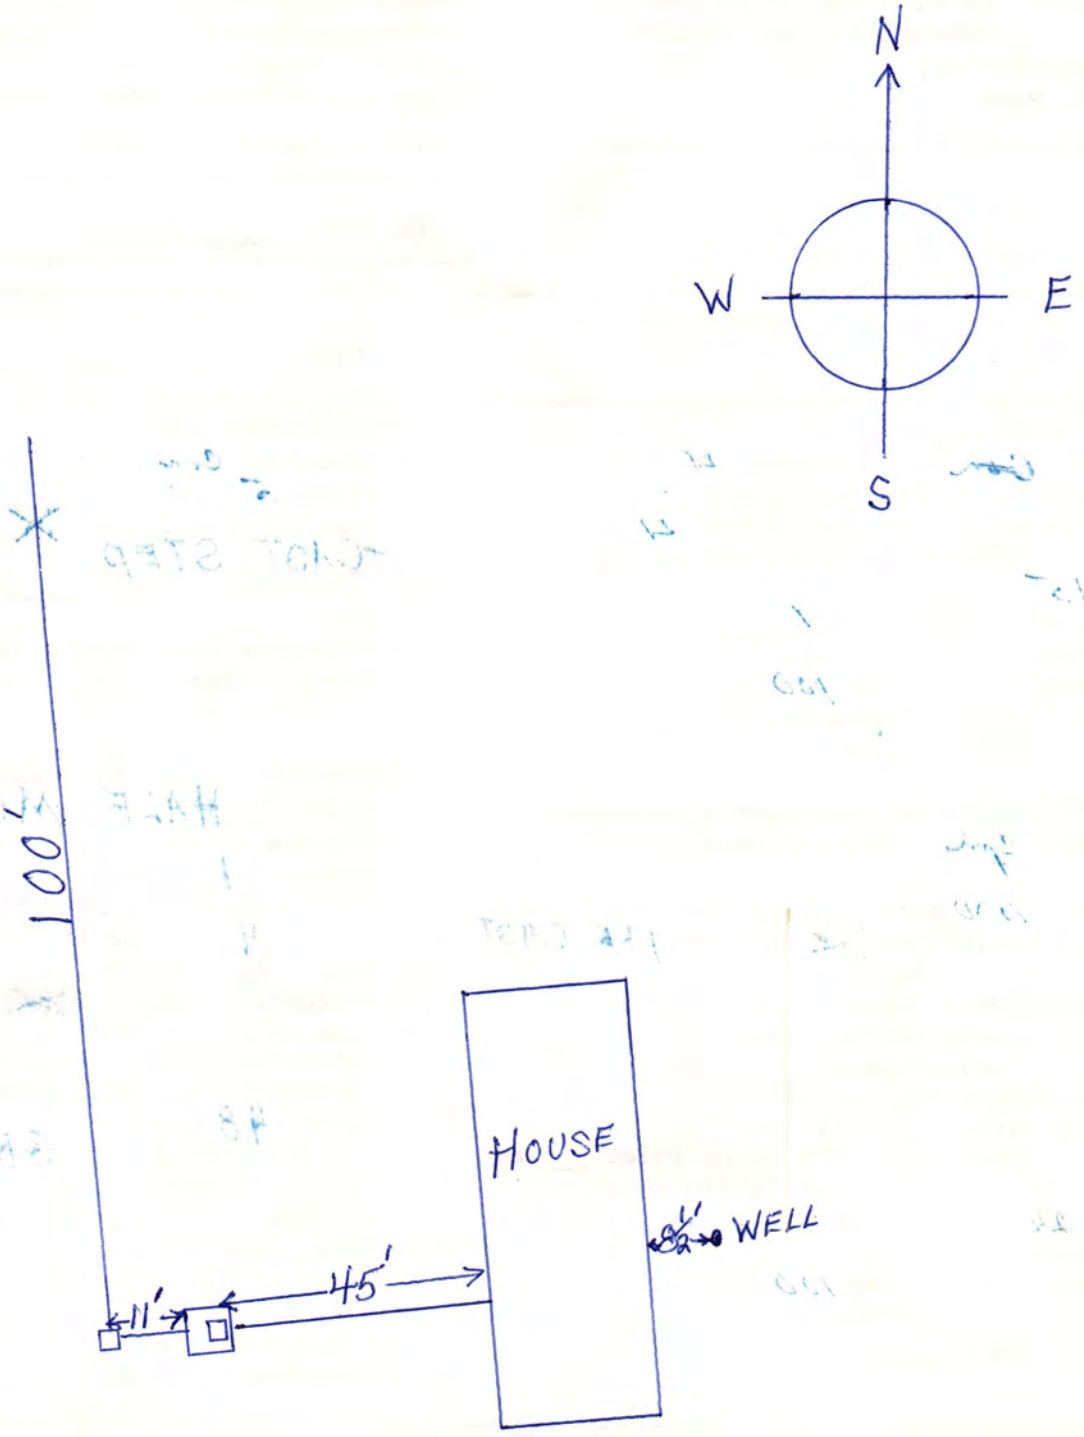
N
W
E
S
100'
HOUSE
WELL
45'
11'

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7[illegible]

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

REAL ESTATE TRANSFER / [illegible]

This form must be completed and returned to reque[illegible]

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 6/8/90

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 10N; RANGE 6E; SECTION 33; BLOCK 2

LOT ___; ADDITION Highlands Addition; Street Address 1941 W. Peach Circle

Directions to Property West & S.W. on [illegible], South to W. Peach Street, West to W. Peach Circle, South to House

Location of Well East of House Tap Location: Inside ☐ Outside ☒ Septic Tank

Location of Sewage System West of House (Red Tag) Year Installed 1970 (1981 / 1989)

	NAME	ADDRESS	PHONE
Present Owner:	Gale Corr	1941 W. Peach	474-4002
Tenant/Buyer:	Jeff Plager	1110 "F" St #3	474-5467
Return to:	Dick Roberts	3910 South ST 68506	488-4663

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Richard Roberts Address 3910 South ST Lincoln 68506

==========

HEALTH DEPARTMENT USE ONLY

Date Received JUNE 12, 1990 Received $75.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 6-12-90

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☒	Date 6-12-90 by DM
Bacteria	☒	☐	Provisional:	☐	Date _____ by ___
Nitrate	☒	☐	Disapproved:	☐	Date _____ by ___

Comments: Recommend checking to see if septic tank needs pumping

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Ron Marquardt DATE 6-18-90

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832