CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 227

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

April 27, 1972
THIS LICENSE OR PERMIT EXPIRES

Robert Gilliam
LICENSEE OR PERMITTEE

RFD #6, Lincoln, Nebraska
ADDRESS

T10N; Range 6E; Section 31; Block 5; Lot 9; Hi Ridge Acres Add.
NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION
ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 110.15 1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 227

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N ; Range 6E ; Section 31 ;
Block 5 ; Lot 9 ; Addition Hi Ridge; Acres
Street Address _____.

2. Property Use: Residential _____ [x]; Commercial _____ [ ]
No. of Bedrooms 2 . Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [x]; Other [ ]

4. Distance to public sewer: _____ ft.

Robert
~~Roger~~ Gilliam
Signature of Applicant (owner or lessee)

RFD 6 Lincoln, Nebraska
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/27/71. ACTION: Approved [ ] Disapproved [X]
Date Frwd. 10/27/71. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 10/27/71. ACTION: Approved [ ] Disapproved [X]
Date Frwd. 10/27/71. Signature: Charles E. By Bob Stevens

3. ~~Dp~~ City Engineer: Date Rec'd. 10-27-71. ACTION: Approved [ ] Disapproved [X]
Date Frwd. " . Signature: H. L. Blessing

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 227

DATE: 10026-71

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N ; Range 6E ; Section 31 ;
Block 5 ; Lot 9 ; Addition Hi Ridge Acres
Street Address _____.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 2 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X], Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Robert Gilliam
Signature of Applicant (owner or lessee)

RFD 6 Lincoln, Nebraska
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 3/29/72 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 10/27/71
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 3/29/72 by: Jerrold C. Hood

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 227

SPECIFICATIONS

DATE: Oct 26, 1971


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor 14 in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 32 ft.
4. Number of clean-outs ___.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material fiber; No. of compartments 1
2. Capacity 1000 gals.; Liquid depth 50 in.
3. Factory Built: Yes [X] (Company CORRUGATED FIBERGLASS)
No [ ]
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. 6 in.
Below Grade 24 in.
5. Inlet: Baffle [ ]; or Tee [X]
6. Outlet: Baffle [ ]; or Tee [X]
Depth of outlet below inlet 24 in.
7. Depth of top of tank below finished grade ___in.
8. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.


C. DISTRICTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes [X], (Company PRE CAST STEP) No [ ]
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 6 ft.
5. Serial Distribution: Yes [ ], No [X]
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: half round
2. Lateral Lines: Depth below grade 24 in.
Number 1; Length of each line 100 ft
Total length of Laterals 100 ft.;
Slope 6 in/100 ft. Diameter of pipe 16 in.; Shape half round
Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other ___
Distance between lateral lines ___ft.
3. Trench Dimensions: Depth 40 in.;
Width 48 in.
4. Filter Material: gravel.
Depth of material from trench bottom 18 in.
5. Distances To:
Well or Suction Line 100 ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: ___minutes/inch

TYPICAL SKETCHES

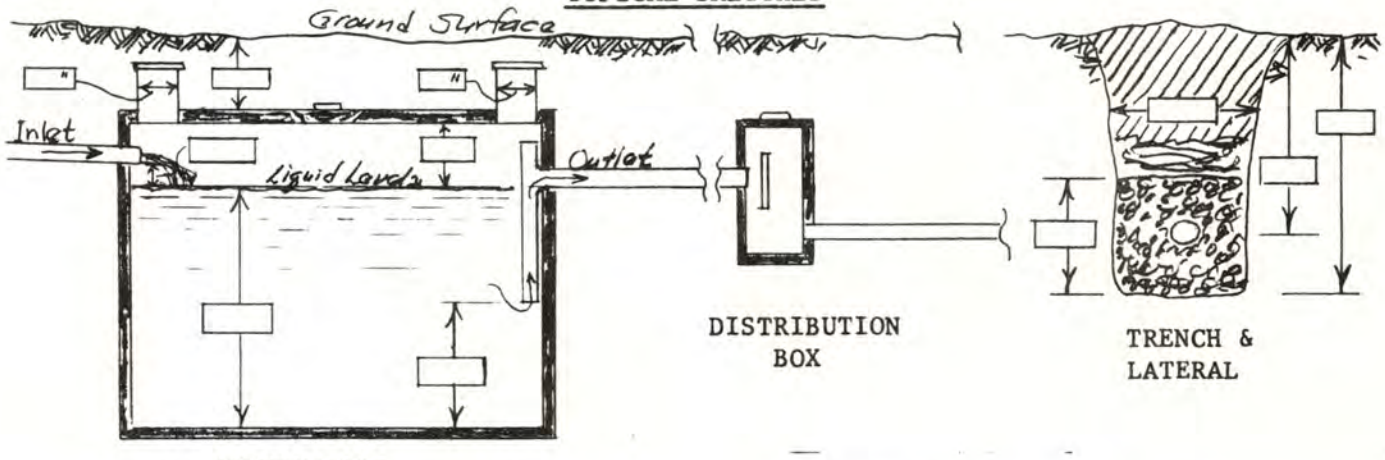

Robert Gilliam
Signature of Applicant

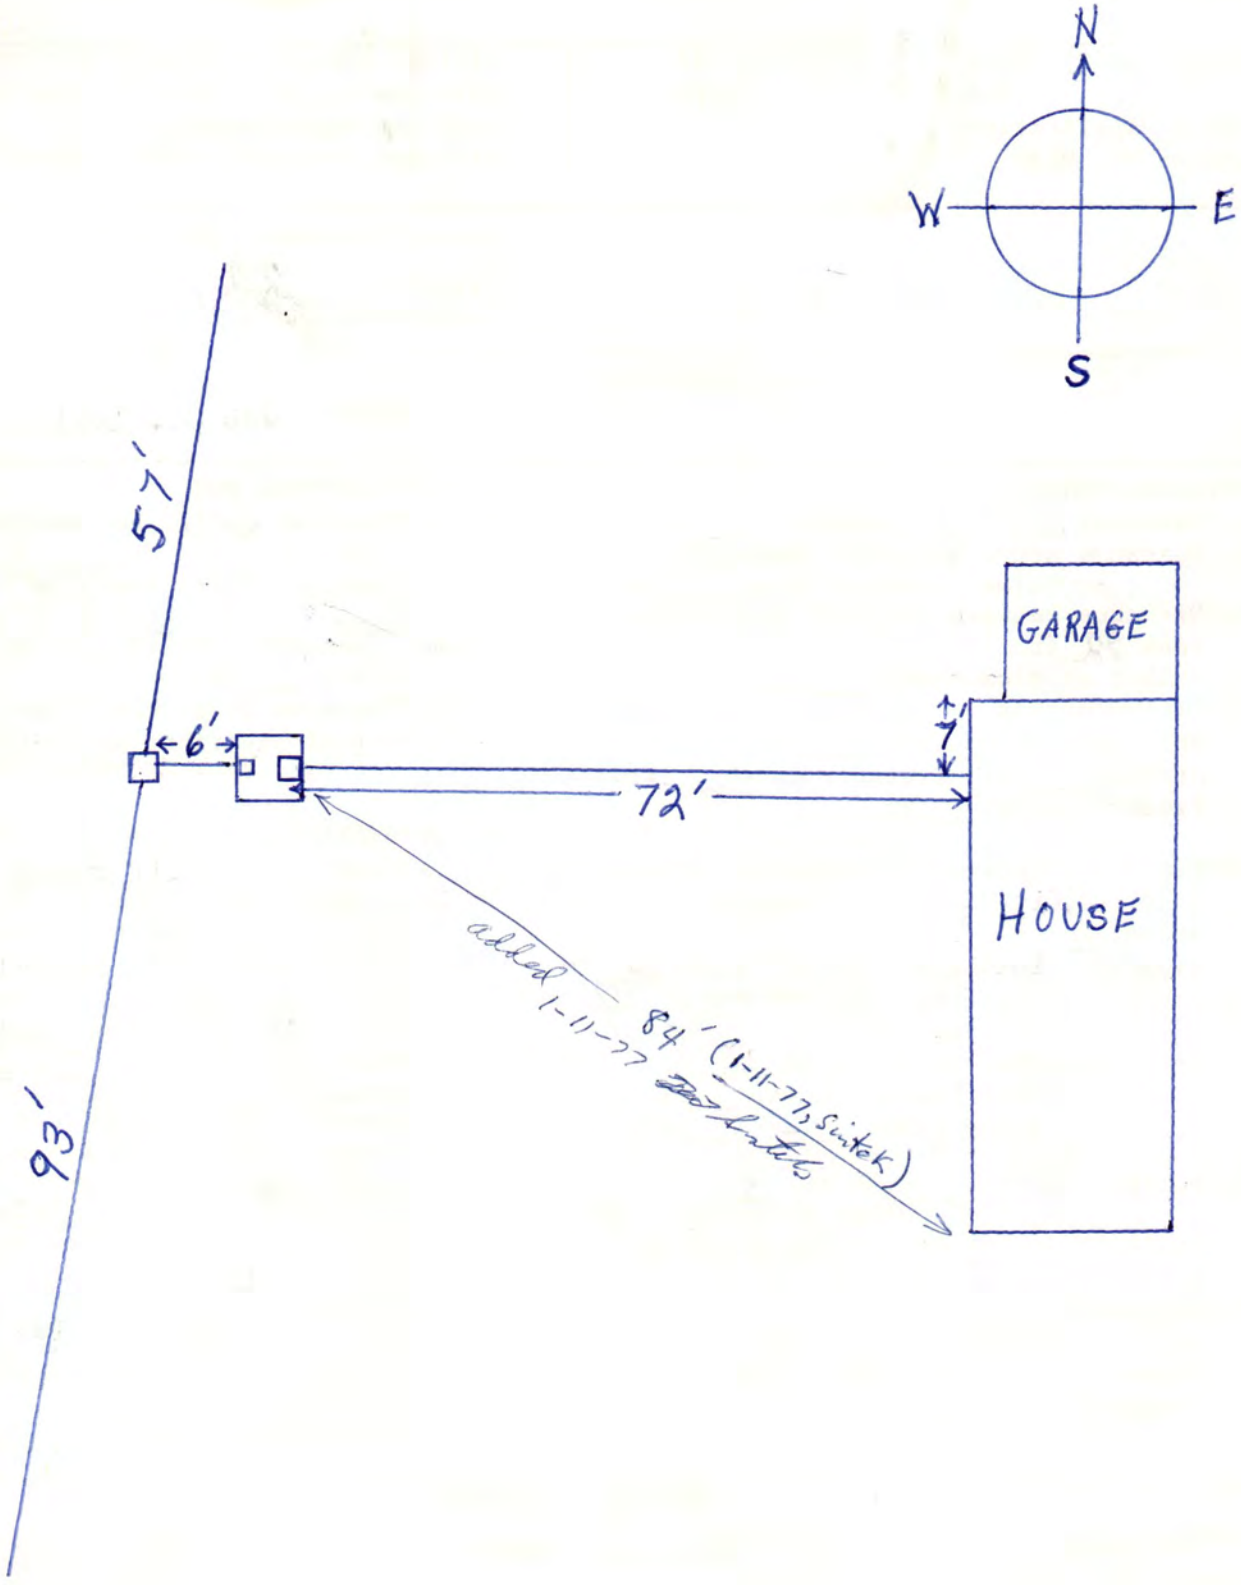
N
W
E
S
57'
6'
GARAGE
7'
72'
HOUSE
added 1-11-77
84' (1-11-77, Sintek)
93'

003

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

[X] Evaluation of the Individual Water System Date: January 20, 1993

[X] Evaluation of the Sewage Disposal System [X] Enclosed is $150.00

Legal Description of Property: TWP. 10N; RANGE 6E; SECTION 31; BLOCK 5

LOT 9; ADDITION High Ridge Acres; Street Address 4501 West Peach Lincoln, NE 68501

Directions to Property _____

_____

Location of Well _____ Tap Location: Inside [ ] Outside [ ]

Location of Sewage System _____ Year Installed _____

	NAME	ADDRESS	PHONE
Present Owner:	Steven and Cindy Champoux	4501 W. Peach,	476-6599
Tenant/Buyer:			437-8088 Cellular
Return to:	First Security National Bank	100 W. Fletcher Ave. Lincoln 68521	435-7233 FAX 435-3850

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Roger A. Thury Address 100 W. Fletcher Ave. Lincoln NE 68521

==========

HEALTH DEPARTMENT USE ONLY

Date Received 01/22/93 Received $150.00 Check [X] #10005 Cash [ ]

PRELIMINARY STATUS--DATE JANUARY 25 1993 3/15/93 J.C.H. 3/16/93 J.C.H. PD 3-9-93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:	SITE VISIT:
Construction	[ ]	[X]	Approved: [X]	Date 1/25/93 by J.C.H.
Bacteria	[ ]	[X]	Provisional: [ ]	Date 2/26/93 by J.C.H.
Nitrate <0.1PPM	[X]	[ ]	Disapproved: [ ]	Date 3/8/93 by J.C.H.

Comments: CASING EXTENSION WELD HAS BROKEN OFF.
NOTE: HEAVY SNOW ON GROUND AT TIME OF INSPECTION.
Well repairs made 2/26/93 J.C.H. Septic lid in new hole See Attached Letter [ ]
3/2/93 California bacteria Count at 5 as per phone call to
FINAL STATUS 3/15/93 State lab. Shock Chlorination of well needed Long Form
Septic lid replaced. J.C.H.

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: [X]	Approved: [X]	Provisional Approval: [ ]

APPROVED BY Gerrold C. Hood R.E.H.S. DATE March 16, 1993

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

204