FILE #2595

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

MAY 4, 1988 — THIS LICENSE OR PERMIT EXPIRES

KENNETH E. PATTERSON — LICENSEE OR PERMITTEE

2001 S.W. 47 STREET, LINCOLN, NE 68506 — ADDRESS

T10N; R6E; Sec 31; Bk 6; Lot 1; High Ridge Acres; 2001 S.W. 47 Street

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON TRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 30.00	018754	$ 30.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. 2595

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: _____

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☐, or REPAIR ☒ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 10N ; Range 6E ; Section 31 ;
Block 6 ; Lot 1 ; Addition HIGH RIDGE ACRES
Street Address 2001 SW 47

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 2 Describe _____

Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: REPLACE SEPTIC INCREASE CAPACITY OF LATERALS INSTALL SEWAGE LIFT STATION

5. Work to be done by: Owner ☐ ; or Contractor ☒ , PAUL VON GILLERN
Contractor's Name

6. Estimated cost of project:

a. Materials	$ 1600	00
b. Labor	$ 1100	00
c. Other	$	
TOTAL	$ 2700	00

Kenneth E. Patterson
Signature of Applicant (owner or lessee)

2001 SW 47 Lincoln, Ne
Address

(Do not write below this line)


REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Site Visits:
Date: 11/2/87 by: J.C.H
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ by: _____

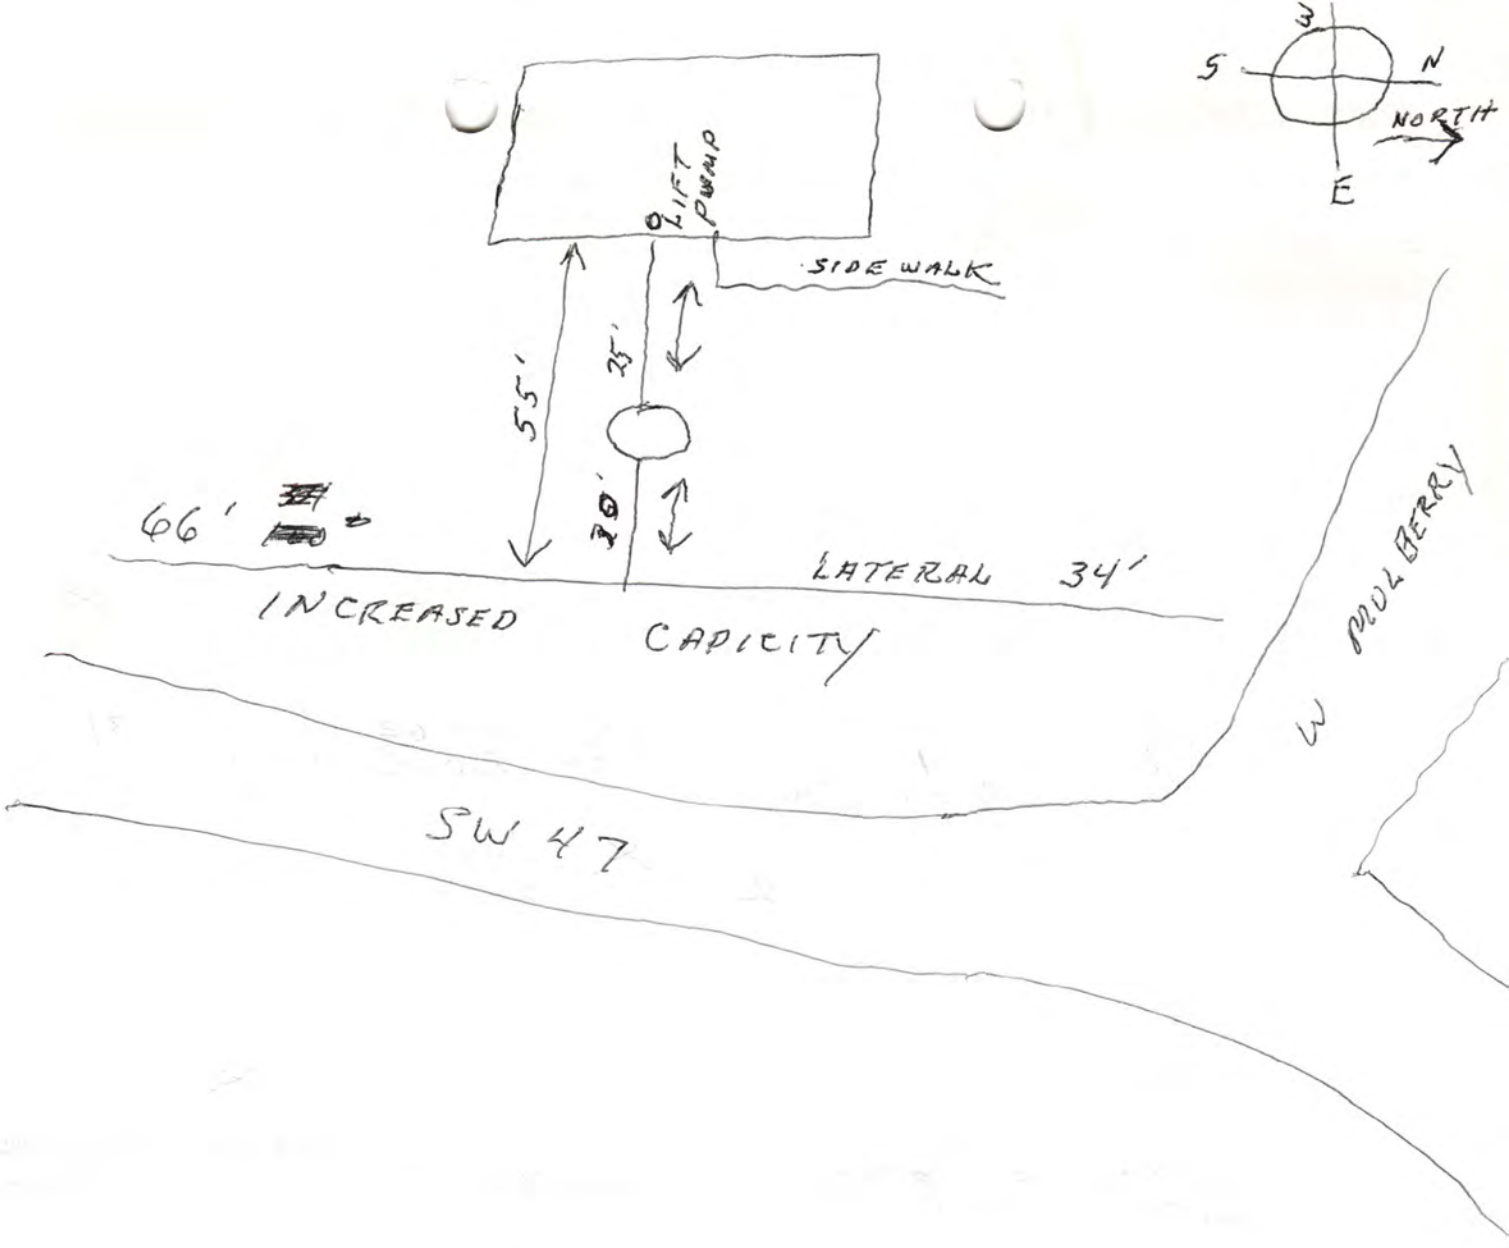
W
S
N
E
NORTH
LIFT PUMP
SIDE WALK
55'
35'
30'
66'
LATERAL 34'
INCREASED CAPICITY
W MULBERRY
SW 47

FILE NO. 267

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

November 23, 1972 — THIS LICENSE OR PERMIT EXPIRES

Robert Gilliam — LICENSEE OR PERMITTEE

Route #6 Lincoln, Nebraska — ADDRESS

T10N; R6E; Sec. 31; Bl. 6; Lot 1; High Ridge Acres Add. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

LEGAL DESCRIPTION

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 267

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 6; Lot 1; Addition _____;
Street Address Highridge Terr.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bedrooms 2. Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: _____ ft.

Robert Dillon
Signature of Applicant (owner or lessee)

Rt 6 Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/19/72. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 5/24/72. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 5-23-72 ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 5-23-72. Signature: Chas. Seal By J.L.

3. Dep. City Engineer: Date Rec'd. 5-23-72. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. " . Signature: J. L. Blessing

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 267

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 6E; Section 31;
Block 6; Lot 1; Addition _____;
Street Address Highridge Acres

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 2 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Robert Dillman
Signature of Applicant (owner or lessee)

Rt 6 Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 8/7/72 by: L.E.H.
Date: 8/31/72 by: L.E.H.
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 5/19/72
by: Jerrold E. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 8/31/72 by: Jerrold E. Hood

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 267

SPECIFICATIONS

DATE: May 19 1972


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor ___in.
3. Distance between dwelling and septic tank 43 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material FIBERGLASS; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 48 in.
3. Factory Built: Yes ☒ (Company CORRIGATED FIBERGLASS) No ☐
4. Manholes: Over Inlet; diam. ___in.
Over Outlet; diam. ___in.
Below Grade ___in.
5. Inlet: Baffle ☒; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade 40 in.
8. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 4'10" ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF Round
2. Lateral Lines: Depth below grade ___in. Number 1; Length of each line 100 ft Total length of Laterals 100 ft.; Slope 6 in/100 ft. Diameter of pipe 16 in.; Shape ⌒
Material: concrete ☐; fiber asbestos ☐; clay ☐; other FIBERGLASS
Distance between lateral lines ___ft.
3. Trench Dimensions: Depth ___in.; Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom ___in.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: ___minutes/inch

TYPICAL SKETCHES

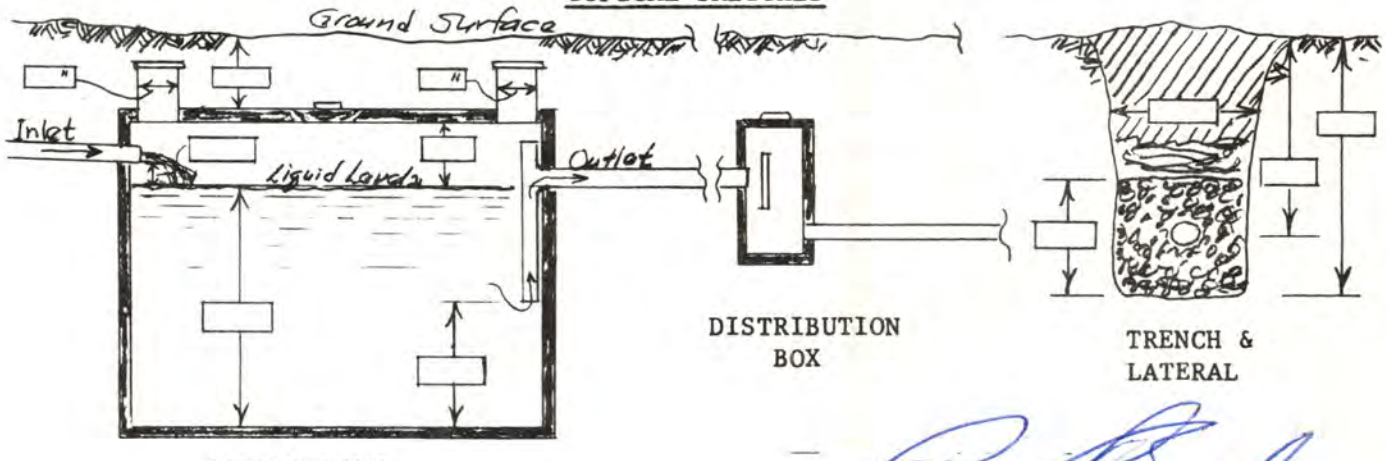

Signature of Applicant

ROAD
N
W
E
S
34'
43'
HOUSE
20'
66'