LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2650-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF PERMIT

OCTOBER 7, 1988
THIS PERMIT EXPIRES

MICHAEL P. DIETZ, WAVERLY PLUMBING, BOX 116, 14150 LANCASHIRE, WAVERLY 68462
ISSUED TO ADDRESS

T11N; R7E; Sec NE¼ 11; 11000 No. 98 Street
LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
MC	4-11-88	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. 2650

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 4-7-88

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☐, or REPAIR ☒ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11N; Range R7E; Section 11 NE¼;
Block ——; Lot ——; Addition ——
Street Address 13000 N 98 th

2. Property Use: Residential X ☐; Commercial —— ☐
No. Bedrooms 2 Describe ——
Other Use ☐
Describe ——

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: ADD 52' concrete Lateral

5. Work to be done by: Owner ☐; or Contractor ☒, Waverly Plumbing & Well Co
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	OVER $100.00

Michael P Duffy
Signature of Applicant (owner or lessee)

~~13000 N 98th~~ Box 116 Waverly Neb 68462
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: ——
Filing Fee: $ 30.00

2. Site Visits:
Date: 4/7/88 by: J.C.H.
Date: —— by: ——
Date: —— by: ——

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hoak


4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/11/88 by: J.C. Hoak

Owner
Merle Lipe
R + 3
Lincoln Neb. 68505

OLD house
13000 N 98th

INSTALLED 4-7-88
Waverly Plumbing & Well Co.
Box 116
Waverly Nebr.
Mike Dietze

Road

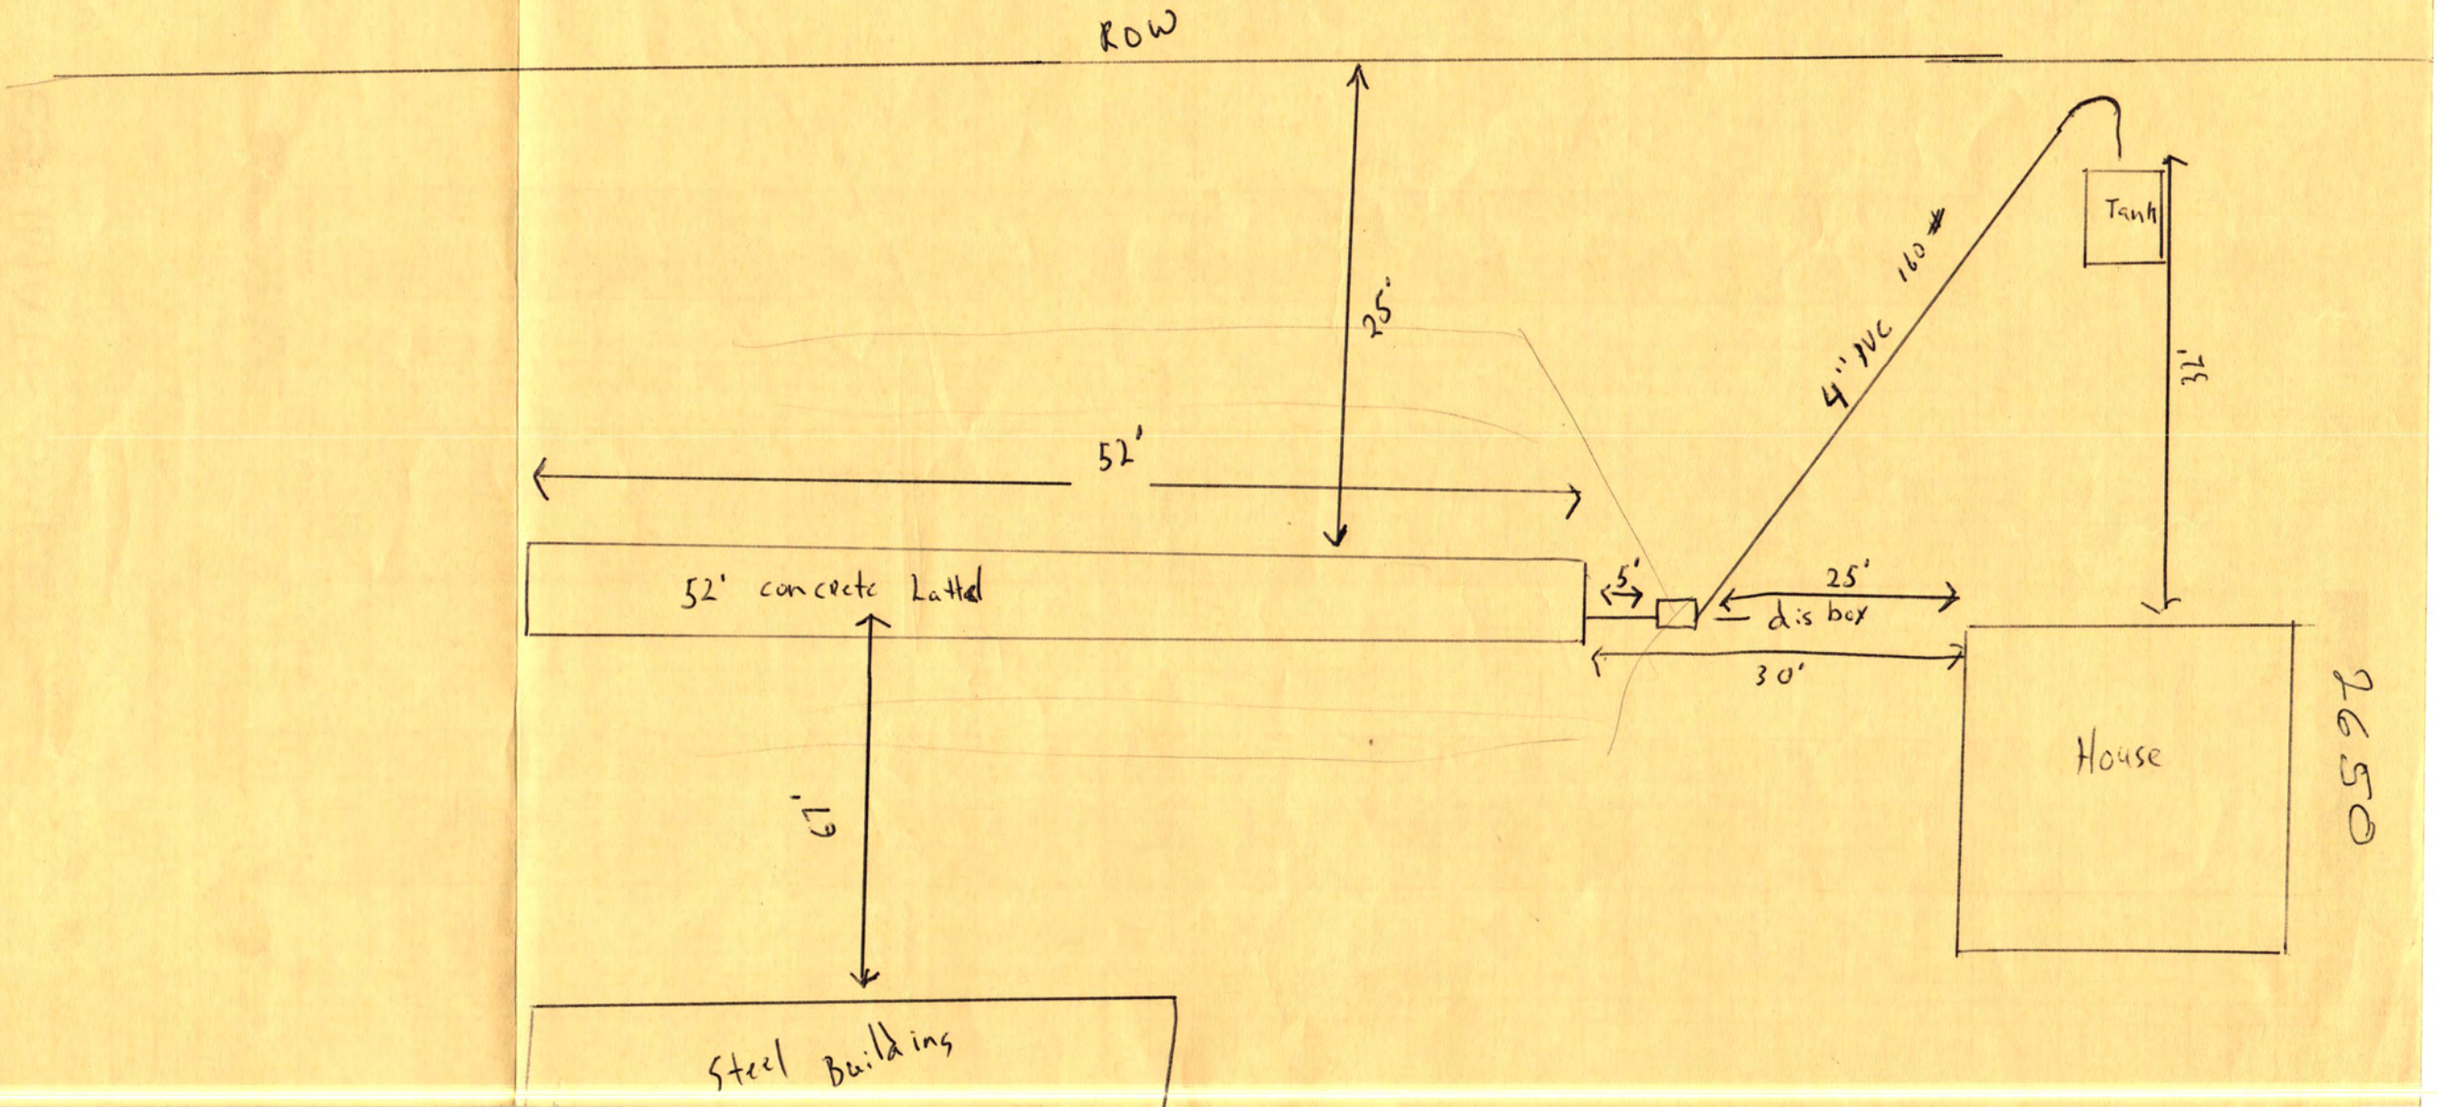

2650

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☐ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 13001 N. 98th St

Twp 11N Range 7E Section 11 1/4 ___ 1/4 ___ Block ___ Lot 56 Addition NE 11-11-7

Directions to Property Call L.A.

Location of Well _____ Tap Location: Inside ☐ Outside ☐

Location of Sewage System _____ Year Installed _____

	NAME	ADDRESS	PHONE
Present Owner:	Ted & Harriett Beeson	13001 N. 98 Lincoln, NE. 68517	786-2795
Tenant/Buyer:	Kelley & Barb Eckenkamp	508 W. Jack Lincoln, NE. 68521	438-0132
Return to:	ATI Title Connie Calver	770 N. Cotner Suite 407 Lincoln, NE. 68505	

Signature of Applicant Nancy L. Peterson (Home Realty) Address 7211 So. 27th Lincoln, NE. 68512 Date 08/09/99

HEALTH DEPARTMENT USE ONLY

RECEIVED

Date 08/12/99
Initials JS
Amount 150.00
Check No. 4473

DATA ENTRY

Date ___/___/___
Case No. _____
Initials _____

PRELIMINARY STATUS--By Ron Maynard **DATE:** 8/12/99

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ ____ /ml
Nitrate	raw ☒ 9.1 ppm treated ☒ 1.4	☐ ____ ppm

SEWAGE SYSTEM (tank pumped)

Approved	☐
Provisional	☒
Disapproved	☐

Additional Site Visits

Date ___/___/___ by ___
Date ___/___/___ by ___
Date ___/___/___ by ___

Comments: Recommend checking to see if septic tank needs pumping. Construction of this sewage treatment system predates County regulations. No permit of record of inspection can be found. There a provisional approval. There was no sewage violation at the time of inspection. ☐ See Attached Letter

See P8525-85

FINAL STATUS * Raw water is approaching the 10 ppm limit — Recommend drinking treated water

WATER SYSTEM: Approved ☒ **SEWAGE DISPOSAL SYSTEM:** Approved ☐ Provisional Approval ☒

Approved by Ron Maynard, RS. Date 8/19/99

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95

NO3 (Raw) P7617-68 NO3 (Treated) P7617-69

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: October 16, 1991

☒ Evaluation of the Sewage Disposal System ☐ Enclosed is $150.00

Legal Description of Property: TWP. 11; RANGE 12; SECTION 11; BLOCK ___

LOT 56; ADDITION _____; Street Address _____

Directions to Property Hwy 6 to 98, North 3½ miles - Home on West Side of Road

Location of Well 30 of House - Between House & TRAILER Tap Location: Inside ☐ Outside ☐

Location of Sewage System West of house beyond split rail fence Year Installed _____

Rubber ring marks the spot.

	NAME	ADDRESS	PHONE
Present Owner:	DAVID SUNDEEN	13000 NO 98TH	786-2236
Tenant/Buyer:	Ted Beeson	40900 S. E. London Rd. Corbett, Ore.	503-695-2797
Return to:	Sandra HARDER, Woodbrass, 3201 Pioneer Blvd Lincoln, 68502		483-4157

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Ted Beeson Address 40900 S. E. London Rd Corbett, Ore 97019

==========

HEALTH DEPARTMENT USE ONLY

Date Received 10-15-91 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 10-16-91

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☐	Date 10-16-91 by Jim
Bacteria	☒ 0	☐	Provisional:	☐	Date _____ by ___
Nitrate	☒ 6.0	☐	Disapproved:	☐	Date _____ by ___

Comments: Recommend checking to see if septic tank needs pumping. Construction of original septic system apparently predates County regulations. There is no record of a permit or construction of the original system. Thus, a provisional approval. See Attached Letter ☐

503-695-2797

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☐	Provisional Approval: ☒

APPROVED BY Ron Maynard RS DATE 10-25-91

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832