FILE NO. 733

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

May 19, 1976 — THIS LICENSE OR PERMIT EXPIRES

Bob Gilliam — LICENSEE OR PERMITTEE

Route #7, Lincoln — ADDRESS

TION: R6E: Sec. 31: Bl. 2; Lot 1; High Ridge West Acres 1st Add. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
38230	MAY 25	30.00

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 733

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: Nov. 18, 1975

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 6E ; Section 31
Block 2 ; Lot 1 ; Addition High Ridge West Acres 1st Add.
Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐
No. of Bedrooms 3. Describe: _____
Other Use ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Mrs. Bob Gilliam
Signature of Applicant (Owner or Lessee)

Rt. #7 Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 11/18/75. Date Frwd. 11/19/75.
ACTION: Approved ☒ Disapproved ☐
Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 11-19-75. Date Frwd. 11-19-75.
ACTION: Approved ☐ Disapproved ☒
Signature: Wilkinson

3. City ~~or County~~ Engineer: Date Rec'd. 11-19-75. Date Frwd. 11-19-75.
ACTION: Approved ☒ Disapproved ☐
Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO._____

DATE: Nov. 18, 1975

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N ; Range 6E ; Section 31 ; Block 2 ; Lot 1 ; Addition High Ridge West 1st Add.
Street Address 6 Acres.

2. Property Use: Residential [ ]; Commercial [X]
No. of Bedrooms 3
Describe:

Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Mrs. Bob Gilliam
Signature of Applicant (owner or lessee)

Rt. #7 Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: 5-7-76 by: mm
Date: by:
Date: by:

3. Date: Approved [X]; Disapproved [ ] 11/19/75
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 5-7-76 by: Ron Mayfield

Lot 1, Block 2
High Ridge West acres 1st add

$19\frac{3}{8}$ $21 = 1\frac{5}{8}$

$13\frac{1}{2}$ $14\frac{1}{2} = 1$

$17\frac{1}{8}$ $18\frac{3}{8} = 1\frac{1}{4}$

$21\frac{5}{8}$ $23\frac{1}{4} = 1\frac{5}{8}$

$18\frac{1}{2}$ $20\frac{1}{8} = 2$

$15\frac{7}{8}$ $17 = 1\frac{1}{8}$

21 min/in

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material Plastic; Diameter 4 in.
2. Distance above basement floor ____in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 60 ft.
4. Number of clean-outs ____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Con; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ____in.
3. Factory Built: Yes ☑ (Company Precast) No ☐
4. Manholes: Over Inlet; diam. ____in.
Over Outlet; diam. ____in.
Below Grade ____in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
Depth of outlet below inlet 2 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material Conc; No. available outlets ____.
2. Factory Built: Yes ☑, (Company Precast) No ☐
3. Dimension: Length 24 in.; Width 12 in. Depth 12 in.
4. Distance from Septic Tank 6 ft.
5. Serial Distribution: Yes ☐, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: 4" Plastic
2. Lateral Lines: Depth below grade 36 in. Number 3; Length of each line 100 ft Total length of Laterals 225 ft.; 100 25
Slope 0 in/100 ft. Diameter of pipe 4 in.; Shape Round
Material: concrete ☐; fiber asbestos ☐; clay ☐; other Plastic
Distance between lateral lines 16 ft.
3. Trench Dimensions: Depth 36 in.; Width 36 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 14 in.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: ____minutes/inch

TYPICAL SKETCHES

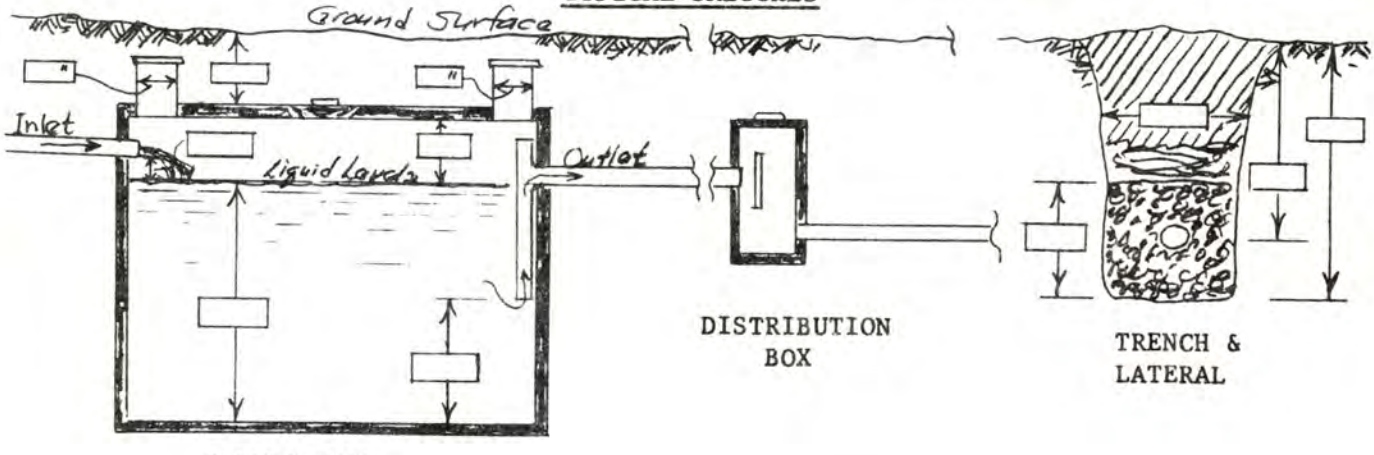

_____
Signature of Applicant

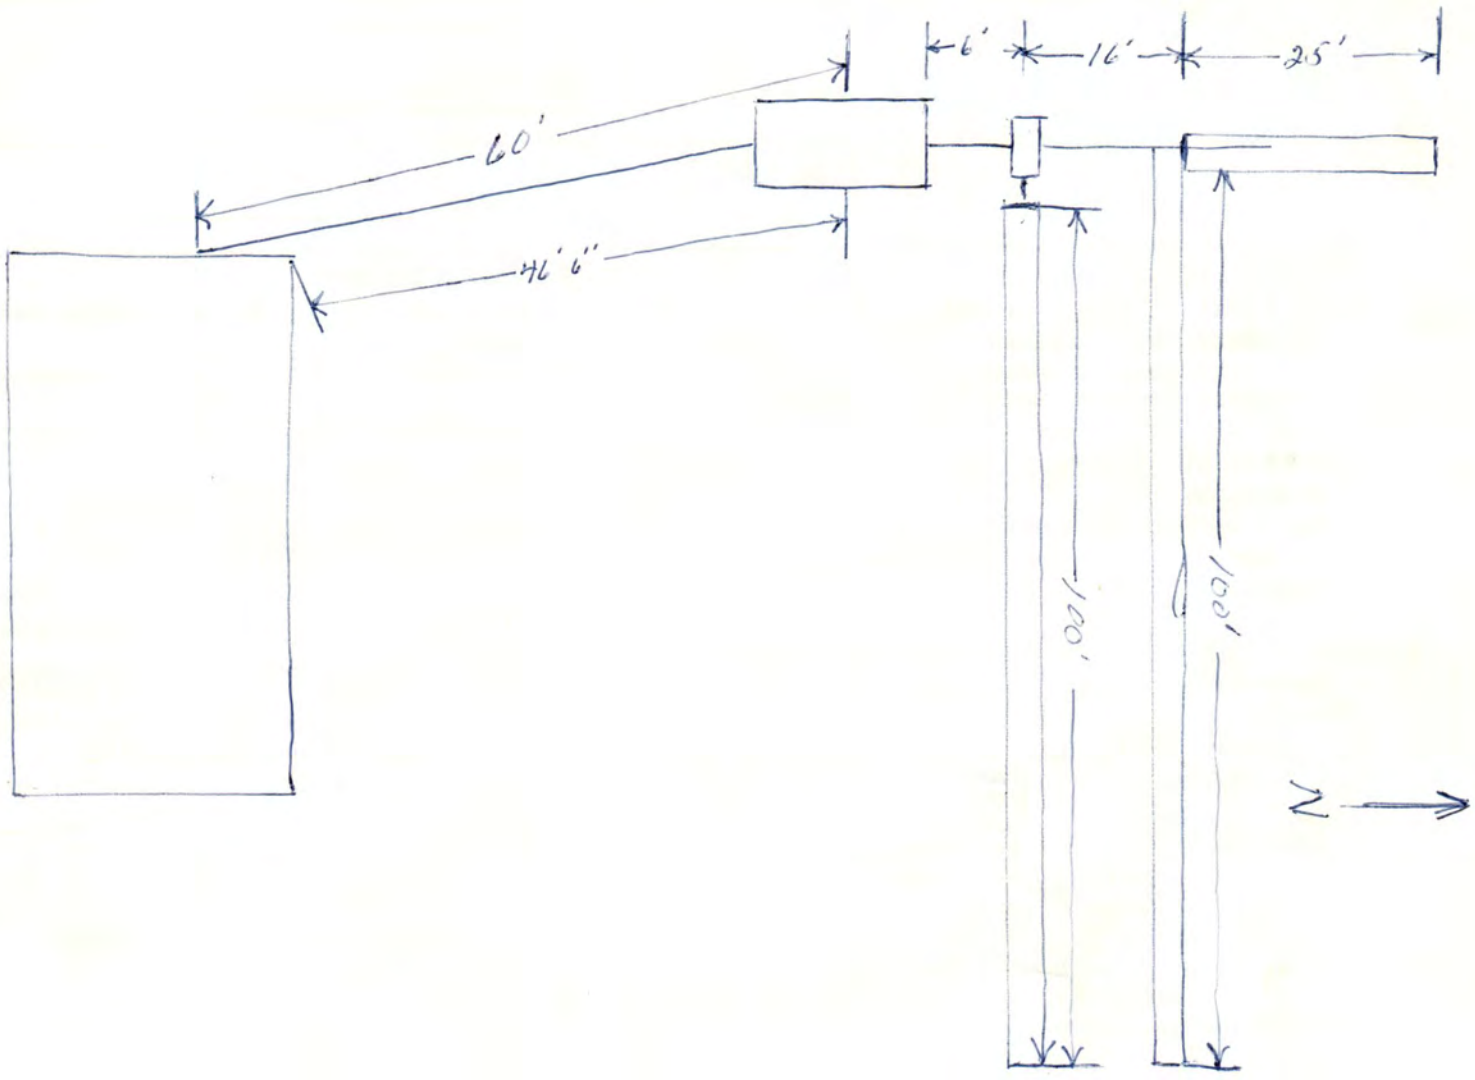

5-7-76

Harold L Casement

016

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☑ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 5100 West Sumner Circle 1st ADDITION

Twp 10N Range 6E Section 31 1/4 ___ 1/4 ___ Block 1 Lot 1 Addition HIGH RIDGE WEST ACRES

Directions to Property West on A to SW 50th - turn left to Sumner → turn right - and house on right - name on mailbox

Location of Well middle of front yard Tap Location: Inside ☑ Outside ☐

Location of Sewage System west of clothesline in backyard Year Installed 1976

	NAME	ADDRESS	PHONE
Present Owner:	Claude/Nadine Frerichs	5100 W. Sumner Cr	438-3291
Tenant/Buyer:	(same)		
Return to:	Commercial Federal c/o Mike Neuman	5555 "O" Street 68510	

Signature of Applicant Nadine Frerichs Address 5100 W. Sumner Cr. Date 6/15/93

HEALTH DEPARTMENT USE ONLY

Date Received 6/16/93 Received $150.00 Check ☑ Cash ☐

PRELIMINARY STATUS--By Jerrold Hood **DATE:** 6/16/93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☑	☐	Approved ☑	Date___/___/___by___
Bacteria	☑ 0 /ml	☐ ____ /ml	Provisional ☐	Date___/___/___by___
Nitrate	☑ 0.9 ppm	☐ ____ ppm	Disapproved ☐	Date___/___/___by___

Comments: ___ See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☑ **SEWAGE DISPOSAL SYSTEM** Approved: ☑ Provisional Approval: ☐

Approved by Jerrold C. Hood R.E.H.S. Date 6/24/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

199