LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 2438-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

JULY 5, 1987 — THIS PERMIT EXPIRES

PAUL VON BILLERN, for WALTER MINCHOW, ROUTE #3, LINCOLN, NE 68505 — ISSUED TO / ADDRESS

T11N; R7E; Sec SE¼ 2 — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE NEW CONSTRUCTION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY: PB — DATE: 7/5/87 — AMOUNT:

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

REC'D DEC 31 1986

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2438-C

DATE: 12-30-86

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 11N ; Range 7E ; Section 2 SE¼
   Block _____ : Lot _____ : Addition _____
   Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 2 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: Over ft.

Walter Minchow & Irene Minchow
Signature of Applicant (Owner or Lessee)

RFD 3 Waverly Ne.
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 1/2/87 . Date Frwd. 1/5/87 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 1/5/87 . Date Frwd. 1/5/87 . ACTION: Approved ☒ Disapproved ☐ Signature: _____

3. City or County Engineer: Date Rec'd. 1-5-87 . Date Frwd. 1-5-87 . ACTION: Approved ☒ Disapproved ☐ Signature: Harold E. Sothan

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 12-23-86 by: mm
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 1-5-86 By: Ron Marquardt

REC'D DEC 18 1986

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2435-C

PROPERTY WHERE SOIL TESTED:

Location: Township 11N ; Range 7E ; Section & ¼ Section 2 .
Property Dimensions: Farm ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☒ ; Clay Loam ☐ .
Dates of Tests: 12-15-86 to 12-16-86. Weather: Precip. 0 Temp. 43.

OWNER: Walter F. Jr Meinhow
Address: RFD 3 # Lincoln, Ne

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	42"	12/16	1130 AM	12/16	11:00 AM	12/16	11:00 AM	10"	12/16	8	60	2	60 2
2				12/16					3:30 P.M.	8		2	Min 2
3										4 1/2		5 1/2	5 1/2
4										4 1/2		5 1/2	5 1/2
5										4 3/4		5 1/4	5 1/4
6										3 1/4		6 3/4	6 3/4

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Signature of Person Conducting Test

Address 18100 N 1st Phone 466-0429 705-7755

(Do not write below this line)

REVIEWING ACTION

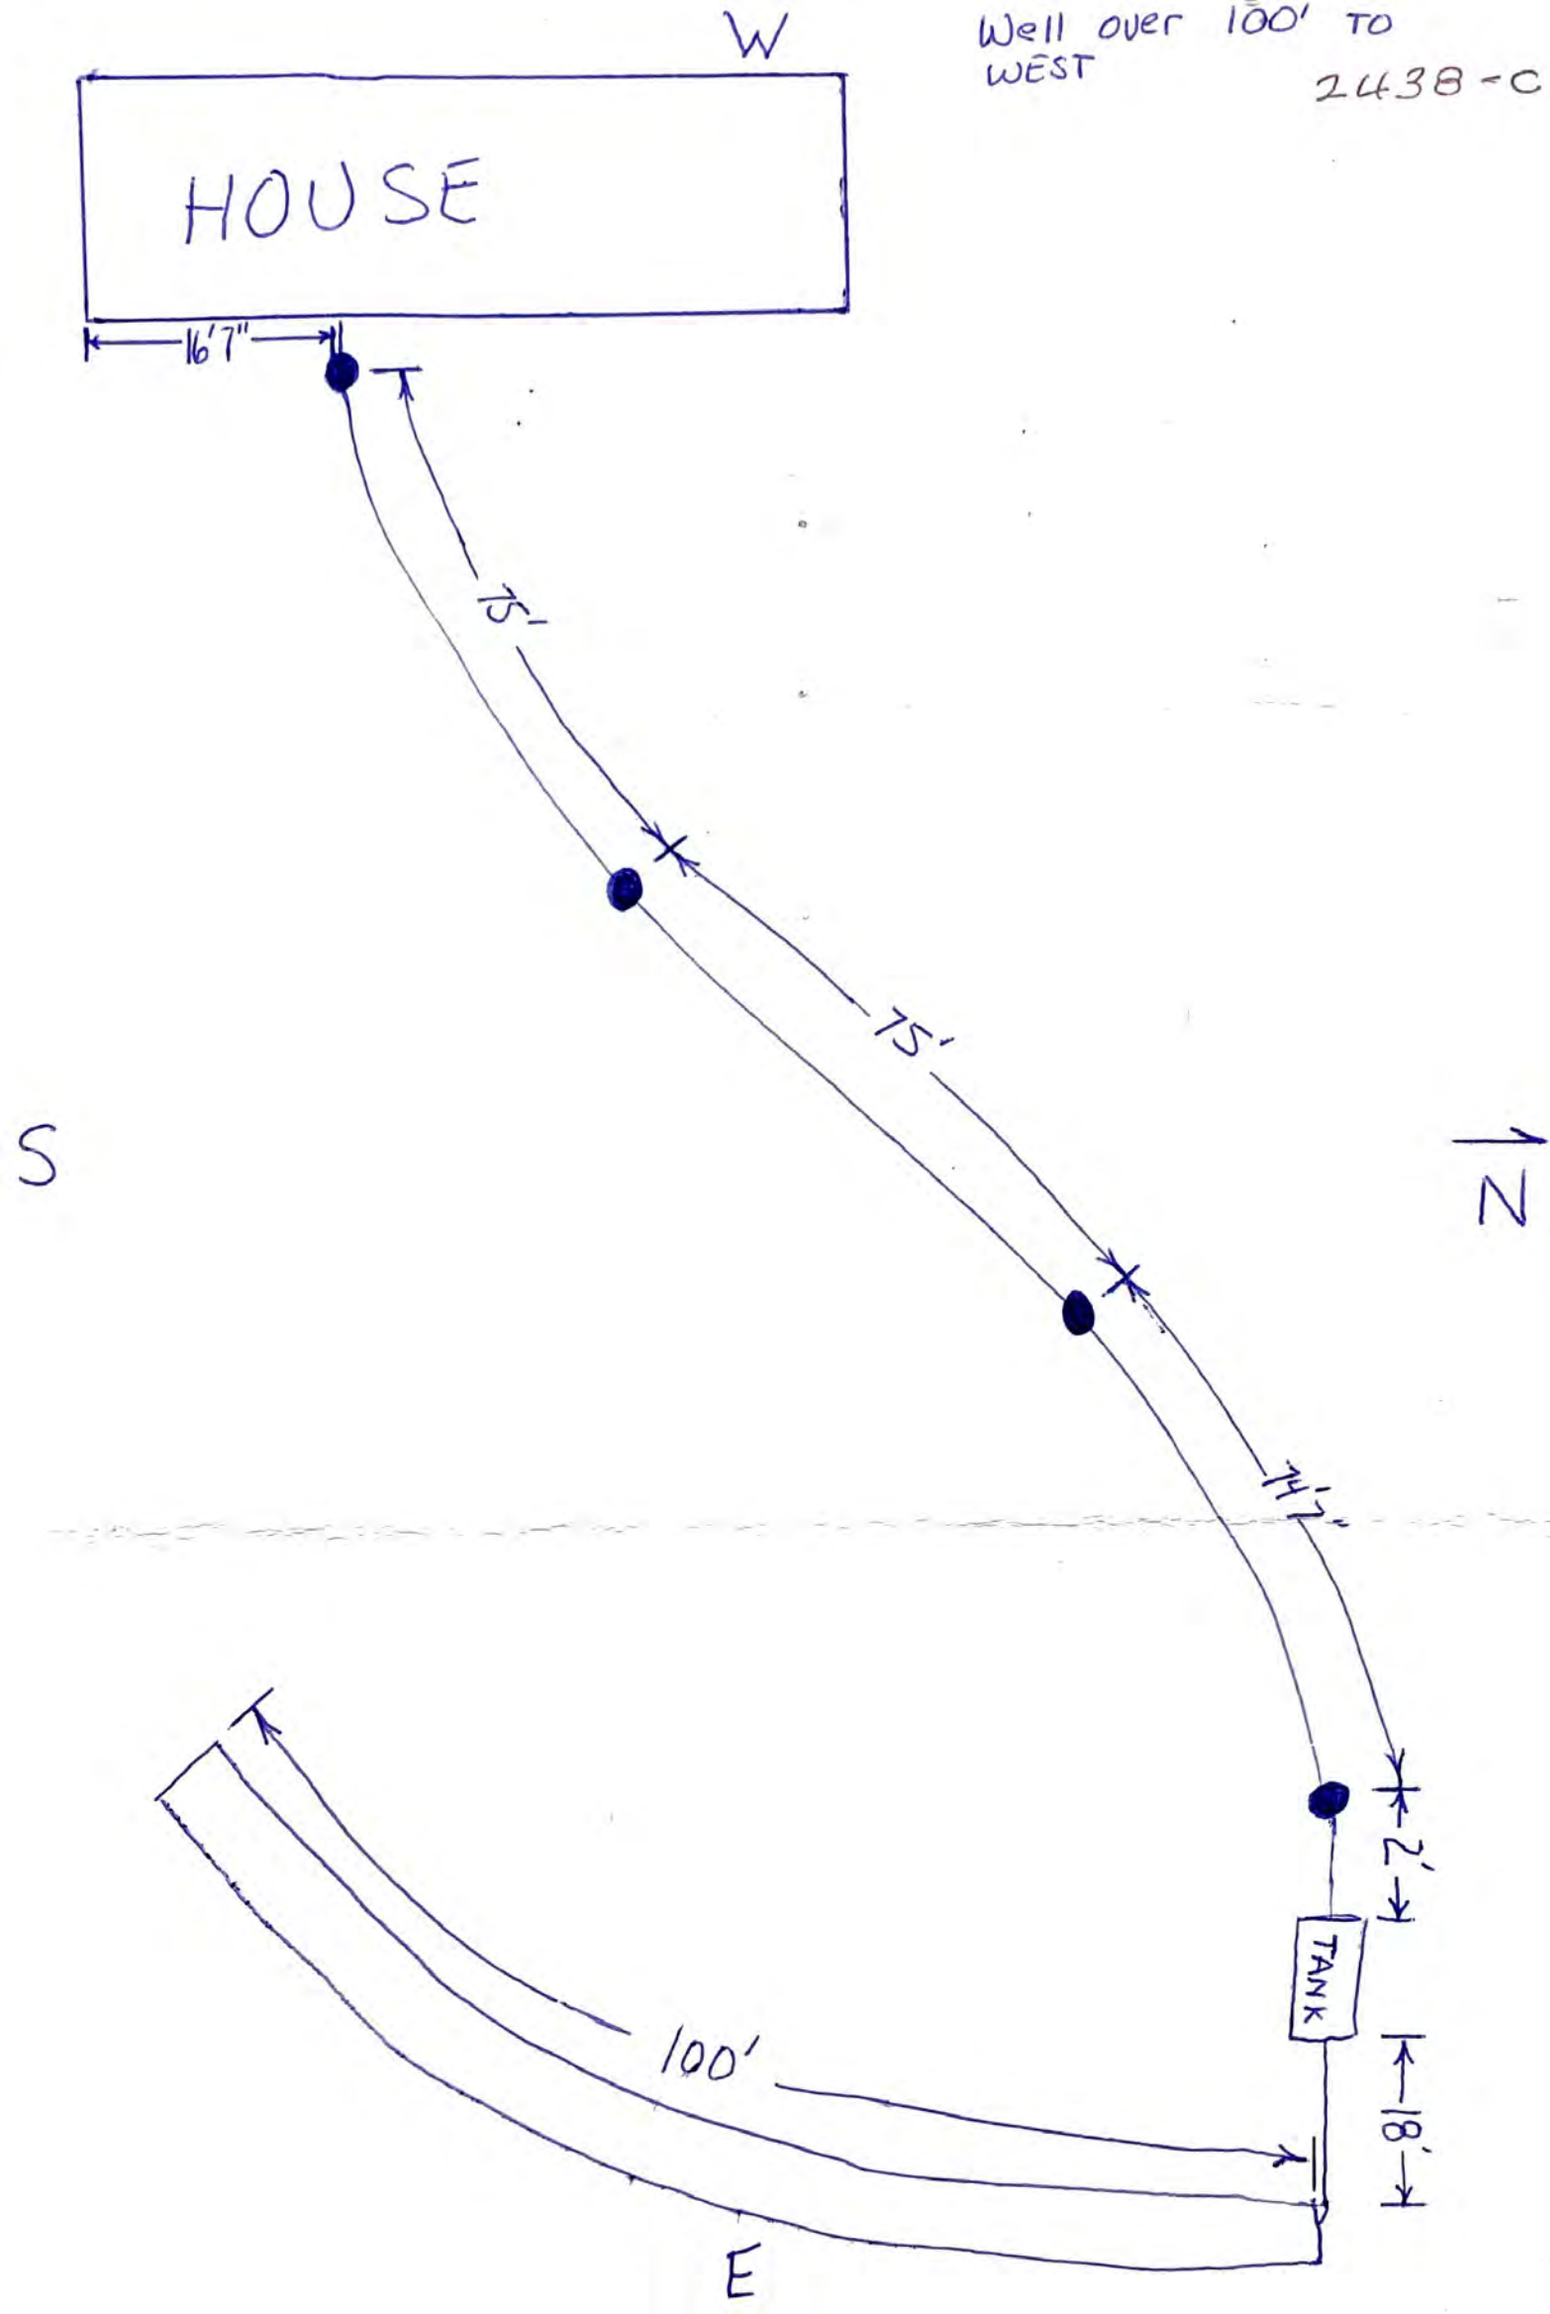
Remarks: _____

Soil Type (SCS): _____

Date: _____

Approved Percolation Rate (a)
A. 13 min./inch
B. _____ min./inch
C. _____ min./inch

Signature of Reviewing Official


W
Well over 100' TO WEST
2438-C
HOUSE
16'7"
75'
75'
74'7"
S
N
2'
TANK
18'
100'
E