FILE # 2714

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

6 MONTHS — THIS LICENSE OR PERMIT EXPIRES

ROY WELDING SERVICE — LICENSEE OR PERMITTEE

1130 WEST VAN DORN — ADDRESS

LINCOLN, NE 68522-1961

T10N; R6E; Sec 34; Lot 92 I.T. — NAME OF ESTABLISHMENT, IF ANY

1130 W. VAN DORN — ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2714

DATE: 8/12/88

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 6E ; Section 34 ; Block _____ : Lot 92 I.T. : Addition ~~SOUTHWEST 34-10-6~~
   Street Address 1130 W. VAN DORN

2. Property Use: Residential ☐ ; Commercial ☒ Other Use ☐
   No. of Bedrooms _____. Describe WELDING SHOP

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒

4. Distance to public sewer: _____ ft. HOLDING TANK

Signature of Applicant (Owner or Lessee)

1130 W. VAN DORN
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/12/88. Date Frwd. 8/12/88. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nook

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 8-12-88. Date Frwd. 8-12-88. ACTION: Approved ☒ Disapproved ☐ Signature: Paul Bourne

3. City or County Engineer: Date Rec'd. 8/12/88. Date Frwd. 8/12/88. ACTION: Approved ☒ Disapproved ☐ Signature: [signature]

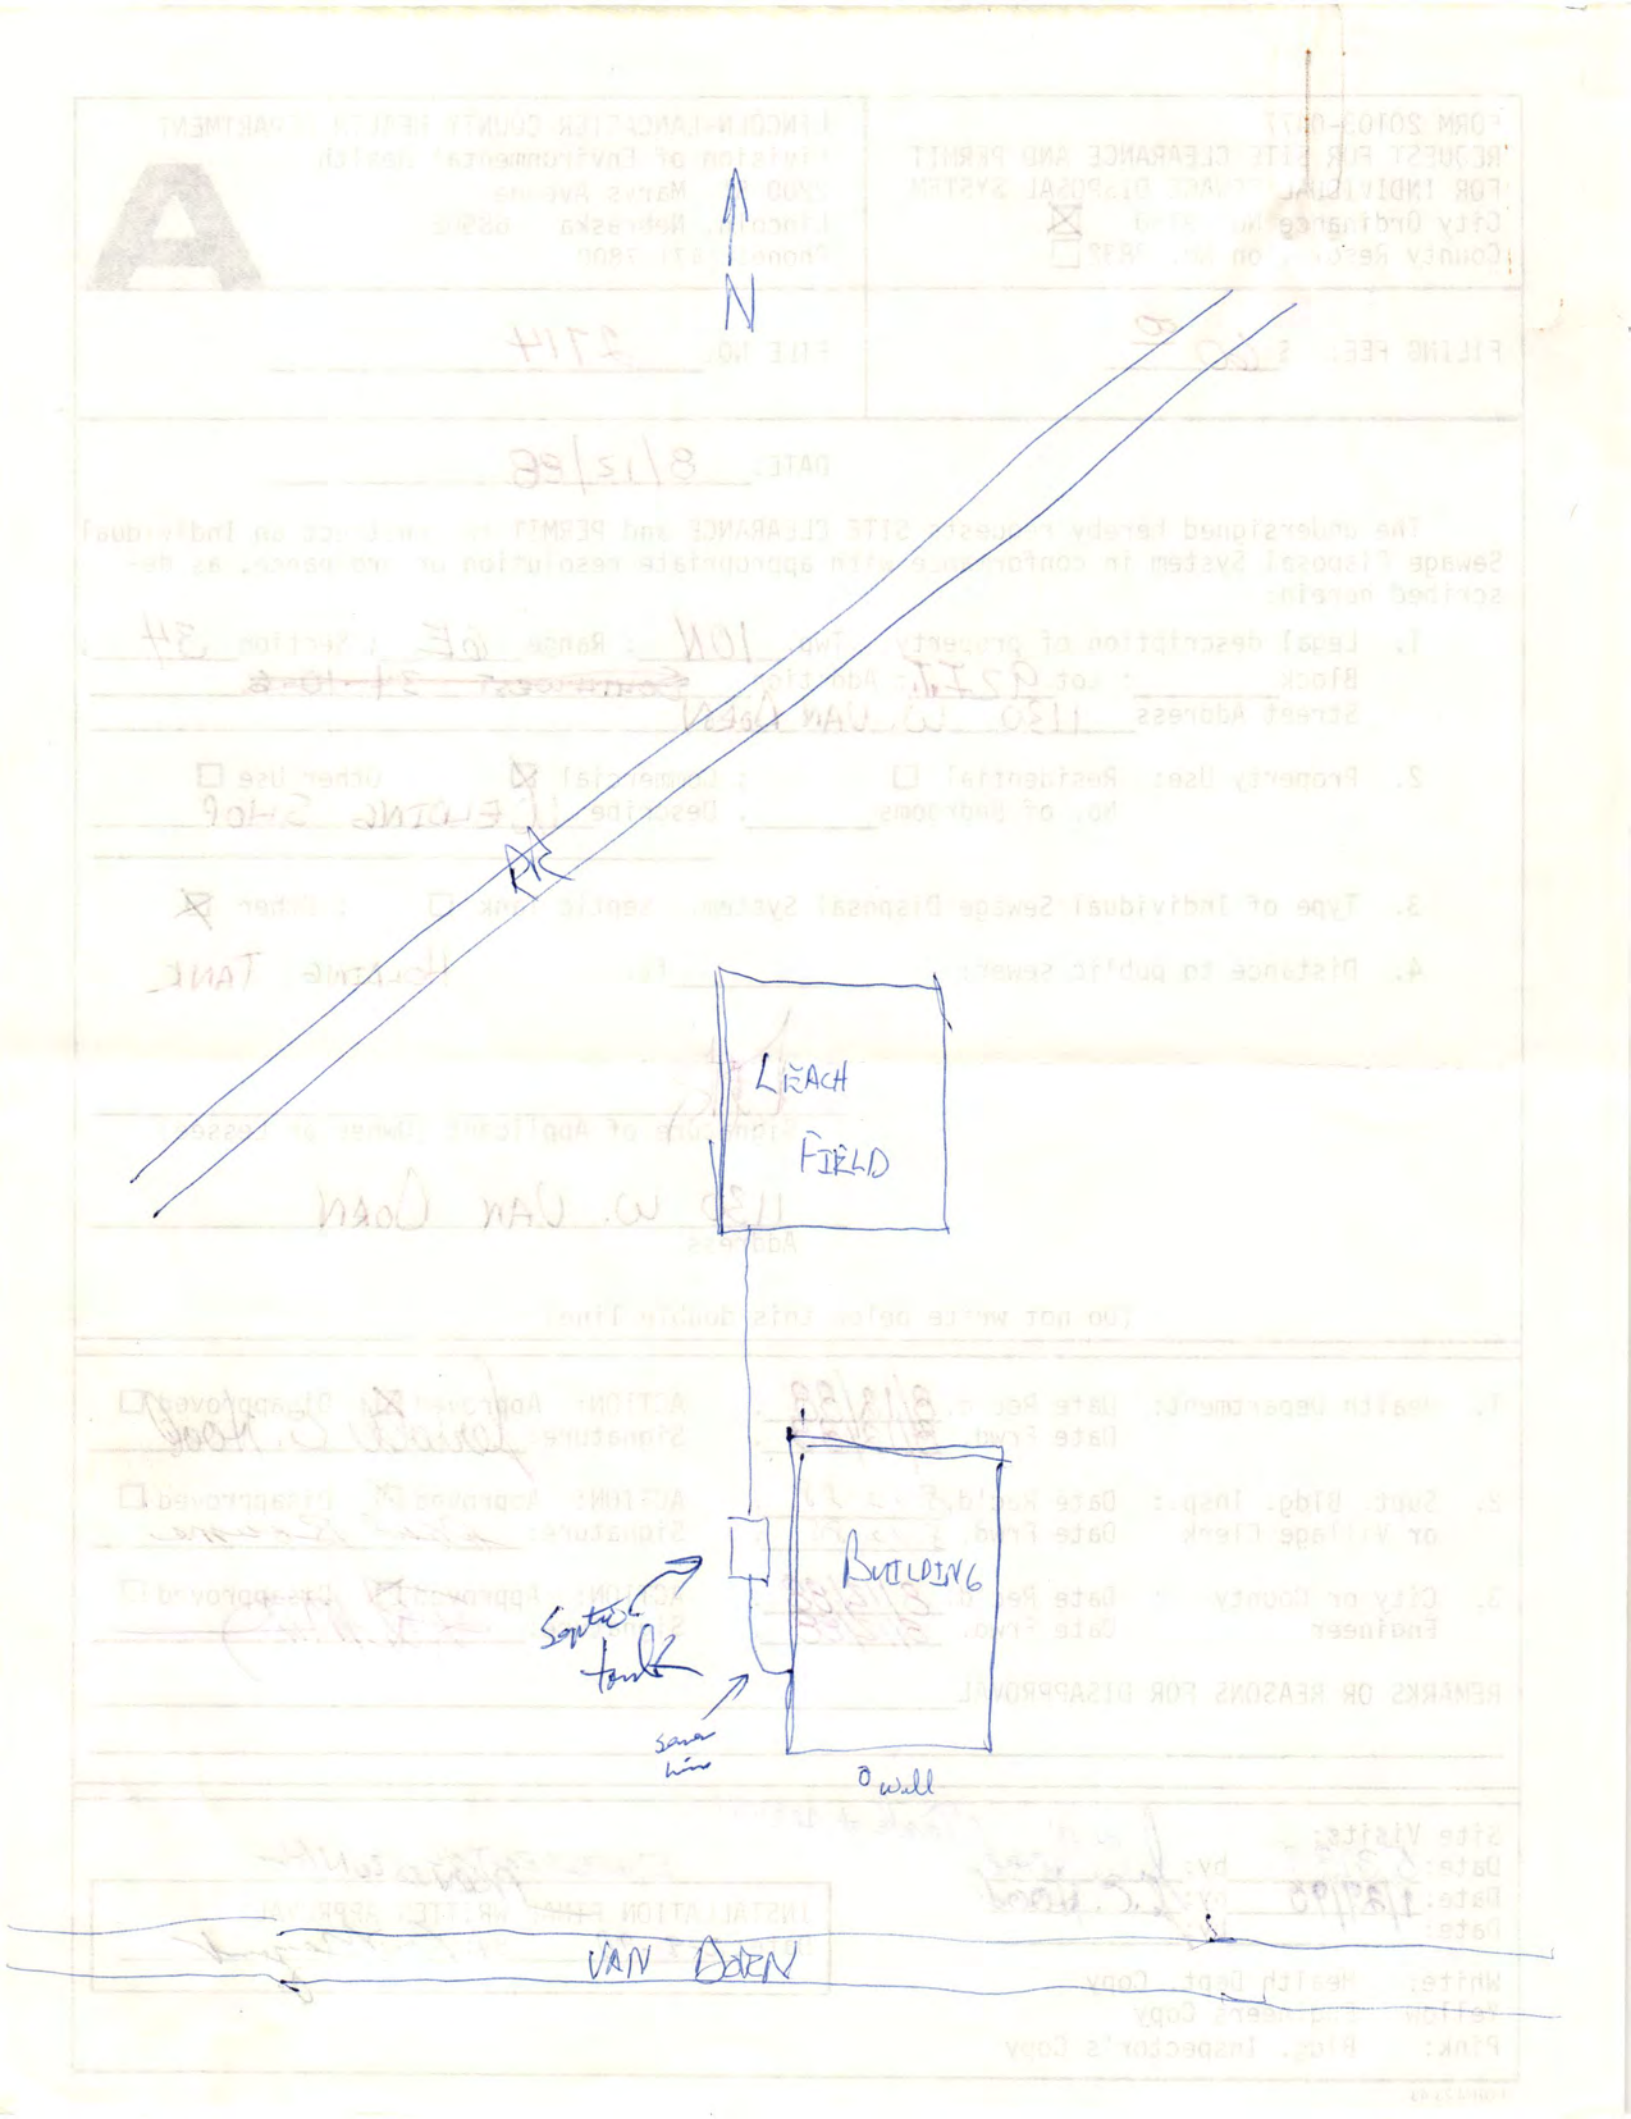
REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 5/3/89 by: J. C. Nook Tank + sewer
Date: 1/29/90 by: J. C. Nook
Date: _____ by: _____

EXPERIMENTAL ~~PROVISIONAL~~
INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 2-9-90 By: Ron Maynard

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43


N
LEACH
FIELD
BUILDING
Septic tank
sewer line
wall
VAN DORN

FILE # W-270

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL WATER WELL CONSTRUCTION — TYPE OF LICENSE OR PERMIT

6 MONTHS — THIS LICENSE OR PERMIT EXPIRES

ROY WELDING SERVICE — LICENSEE OR PERMITTEE

1130 WEST VAN DORN, LINCOLN, NE 68522-1961 — ADDRESS

T10N; R6E; Sec 34; Lot 92 I.T. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 45.00	019851	$ 45.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM: 20222-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN, NEBRASKA 68502
PHONE: 471-7800

FILING FEE $45.00

FILE NO. W-270

DATE: 8/12/88

The undersigned hereby requests: Site Clearance and Permit to construct a new individual water well ☐ ; Permit existing well ☐ ; well repair or alteration involving opening of well ☐ ; in conformance with appropriate ordinance, as described herein:

1. Legal description of property: Twp. 10N : Range 6E : Section 34
   Block _____ : Lot 92 I.T. Addition ~~in Southwest 34-10-6~~
2. Well use: Residential ☐ ; Commerical ☒ ; Other Use ☐
   Describe WELDING SHOP
3. Distance to Public Water Supply: _____ Ft.
4. Intended use of well DOMESTIC

Signature of Applicant (owner or lessee)

NO CITY WATER.

1130 W. VAN DORN
Address

Sewage Permit Applied For Yes ☒ No ☐ Not Applicable ☐

1. Health Department: Date Rec'd 8/12/88. Date Frwd. 8/12/88. Action: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd 8-12-88. Date Frwd. 8-12-88. Action: Approved ☒ Disapproved ☐ Signature: Paul Bowne
3. City or County Engineers: Date Rec'd 8/12/88. Date Frwd. 8/12/88. Action: Approved ☒ Disapproved ☐ Signature: John D Murray

REMARKS OR REASONS FOR DISAPPROVAL _____

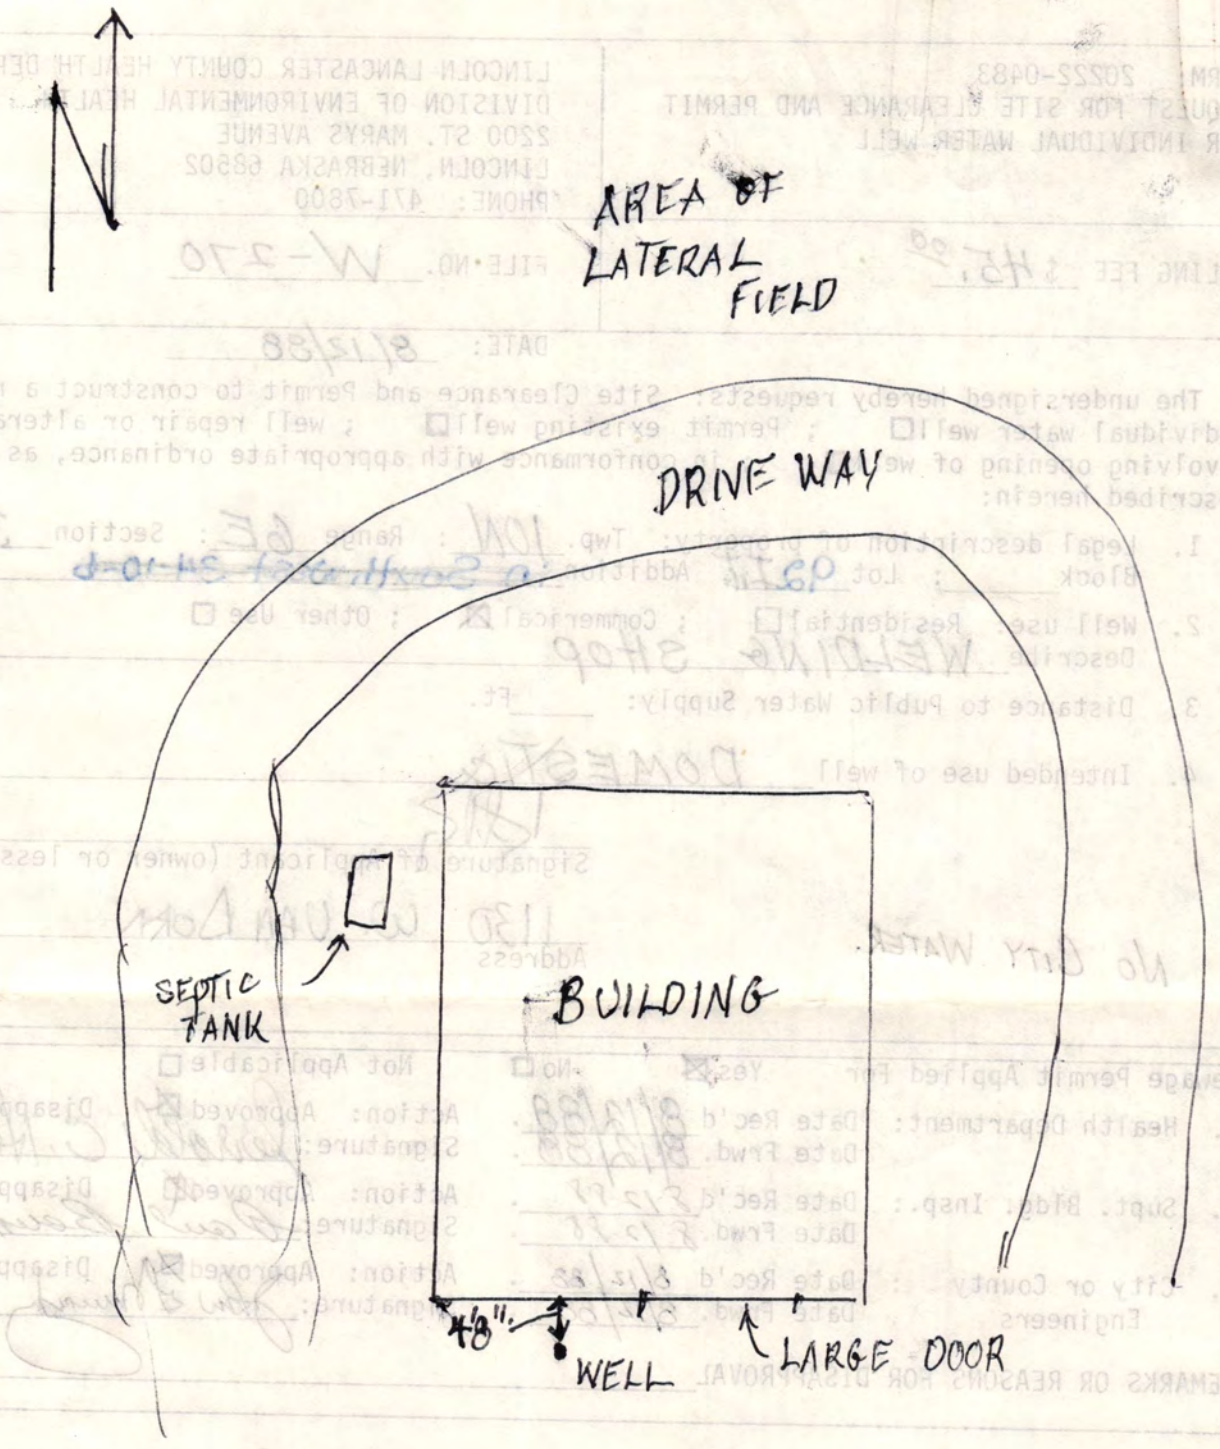
Site Visits:
Date: 1/30/90 by J. C. Hood
Date: 2/12/90 by J. C. Hood
Date: _____ by _____

Nitrate Level 2.3 PPM
Bacteriological Analysis Satisfactory
Yes ☐ No ☐

INSTALLATION FINAL WRITTEN APPROVAL
Date: 2/21/90 By: J. C. Hood

Health Department copy: White
Engineers Copy: Light Green
Building Inspectors Copy: Light Blue

FORM 23-13


N
AREA OF
LATERAL
FIELD
DRIVE WAY
SEPTIC
TANK
BUILDING
48"
WELL
LARGE DOOR

W-270

RECEIVED FEB 5 1990

DATE: 8/25/1988

Earnest Pump Co.

WELL DRILLING & REPAIR
P. O. BOX H 400 2ND ST.
MILFORD, NE 68405
(402) 761-2281

NAME: RUEL ROY

ADDRESS:

CITY: LINCOLN STATE: NE ZIP: PHONE:

WELL INFORMATION

WELL DIA. 9" DEPTH 76

STATIC WATER LEVEL 11'

ESTIMATED G.P.M. 40

GRAVEL PACK "2"

CASING

SIZE 4" TYPE 200 PSI

SCREEN

SLOT #16 LENGTH 20' TYPE ROBERTS

WELL LOG

FEET	FORMATION
0'-2'	FILL
3'-5'	BLACK DIRT
5'-16'	DARK BROWN CLAY
16'-30'	SAND & GRAVEL
30'-38'	BROWN CLAY
38'-75'	SANDSTONE (MED)

FEET	FORMATION

PUMP: INSTALLED BY OWNER

DROP PIPE: — CABLE: —

PRESSURE TANK: —

PREPARED BY Ben Ernst II

KNOWLEDGE EXPERIENCE national water well association CERTIFIED ABILITY C.W.D./P.I.