LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 471-8000

NON TRANSFERABLE

P E R M I T

Permit
SEWAGE INSTALLATION

No. 92380090201

Issued 08/24/92
Expires 02/24/93
Revenue Code 18754

Establishment
VANCE STOHL
T10N R7E SEC 14
LOT 46
9040 HOLDREGE STREET

FEES: $150.00

TOTAL $150.00

Permittee
VANCE STOHL
9040 HOLDREGE ST
LINCOLN NE 68505

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $_____

FILE NO._____

DATE: 8-20-92

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 7E ; Section 14 ;
   Block _____ : Lot 46IT : Addition _____
   Street Address 9040 Holdrege

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 2-3 Miles ft.

Signature of Applicant (Owner or Lessee)

3546 So 76 Lincoln 68506
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/20/92. Date Frwd. 8/24/92. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 8/24/92. Date Frwd. 8/24/92. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]
3. City or County Engineer: Date Rec'd. 8-24-92. Date Frwd. 8-24-92. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: ~~10-12-92~~ by: ~~[illegible]~~
Date: 10-12-92 by: [illegible]
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 11-12-92 By: Ron Magnuson

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED: SE Corner of SE ¼ Section

Location: Township 10 ; Range 7 ; Section & ¼ Section 14 . Lot 46
Property Dimensions: 457.5 ft. x 482.4 ft. Area: 5 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☑ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 8-18-92 to 8-19-92 . Weather: Precip. None Temp. 80° .

OWNER: Vance Stahl

Address: 9040 Holdrege
Lincoln, Ne 68505

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	3'	8/18/92	7:30	8/19/92	7:30	8/19/92	7:15	12		13½	30 min	1½	
2	"	"	"					13¼		15½		2¼	
3	"	"	"					14¼		16		1¾	
4	"	"	"					26½		29		2½	
5	"	"	"					12		14		2	
6	"	"	"					9		10		1	
7	"	"	"					7½		9⅛		1⅝	
8	"	"	"					16¼		18½		2¼	

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Vance Stahl
Signature of Person Conducting Test

Address 3540 So 76th Phone 483-2362 437-6689

(Do not write below this line)

REVIEWING ACTION

Approved Percolation Rate (a)
A. 16 min./inch
B. _____ min./inch
C. _____ min./inch


Remarks: _____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date: AUGUST 20, 1992

Jerrold C. Hood
Signature of Reviewing Official

Vance Stohl 9040 Holdrege 477-6689 483-2362

FORM 20102-0477 PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application) City Ordinance No. 9150 ☐ County Resolution No. 2832 ☐	LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT Division of Environmental Health 2200 St. Marys Avenue Lincoln, Nebraska 68502 Phone: 471-7800 **C**
Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.	FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

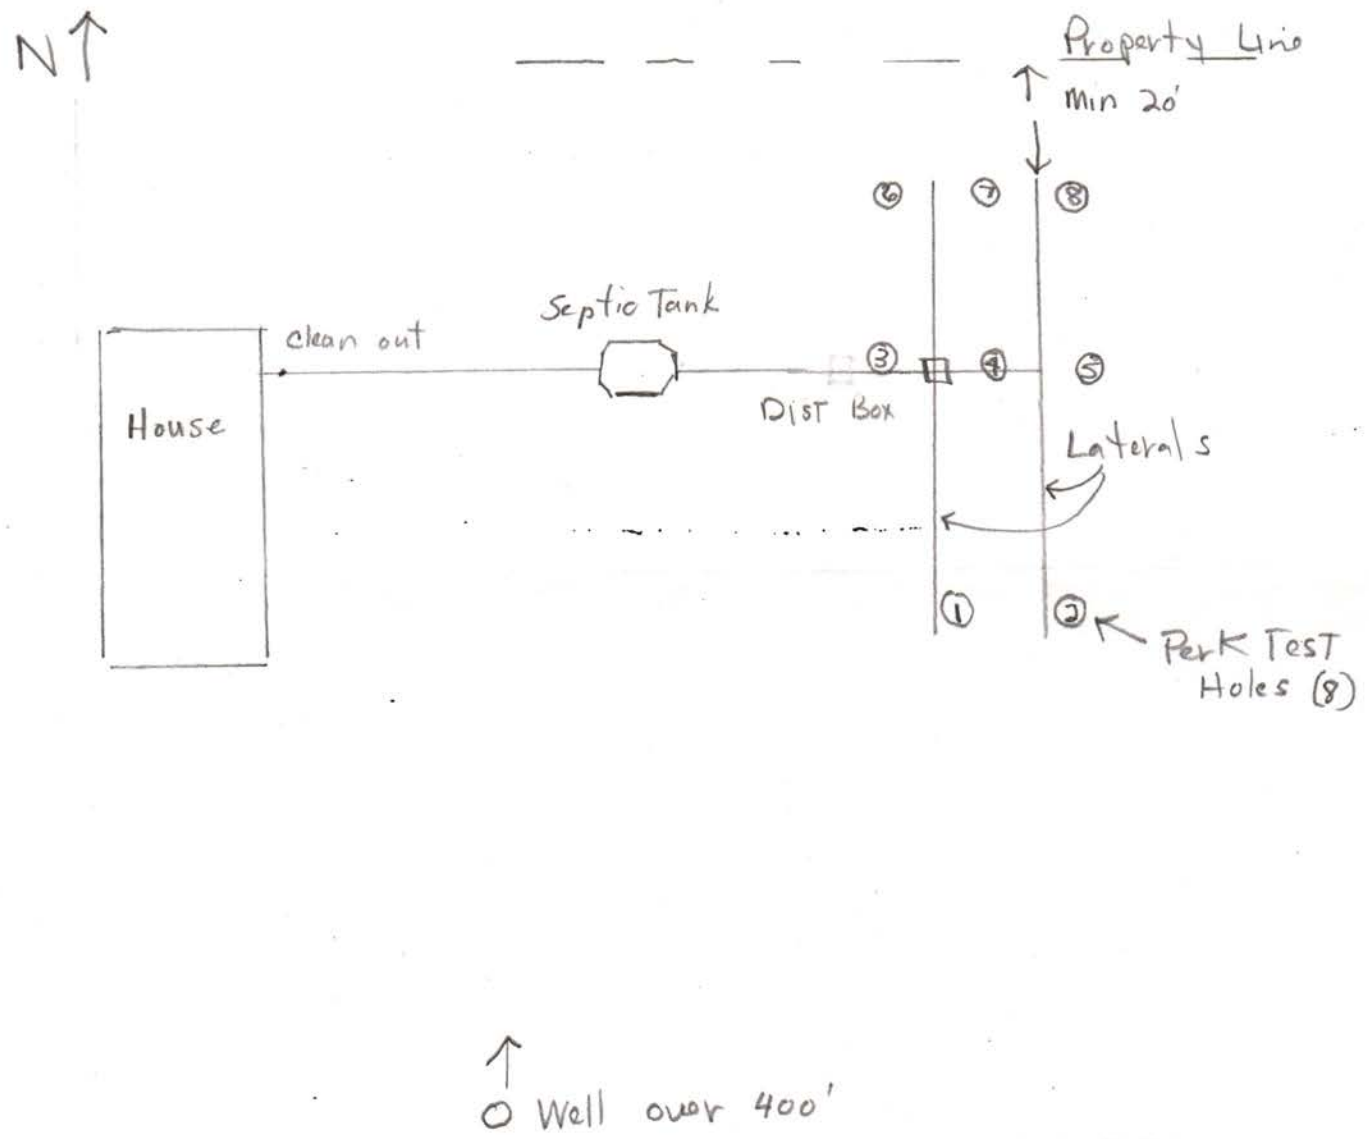

REVIEWING ACTION

Remarks: _____

Date: August 20, 1992

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 583 sq.ft.

Jerrold C. Hoge
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 11-11-92

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material Sched 40; Diameter 4 in.
2. Distance above basement floor ____ in., or below basement floor 10 in.
3. Distance between dwelling and septic tank 85 ft.
4. Number of clean-outs 2
5. Distances to: Well or Suction Line 300' ft.; Stream 120' ft.; Pressure Line — ft.; Property Line 25 ft.

B. SEPTIC TANK:
1. Material Concrete; No. of compartments 3
2. Capacity 1000 gals.;
3. Factory Built: Yes ☑ No ☐ (Company precast)
4. Manholes: Over Inlet; diam. — in. Over Outlet; diam. — in. Riser Above ☑ Below ☐ Grade 2 in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
7. Depth of top of tank below finished grade 10 in.
8. Distances to: Well or Suction Line 300 ft.; Stream 175 ft.; Pressure Line — ft.; Property Line 23' ft.

C. DISTRIBUTION BOX:
1. Material Plastic; Number available outlets 5
2. Factory Built: Yes ☑ No ☐ (Company ?)
3. Distance from Septic Tank 30 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☑ Diameter of Half Round ____ or Perforated Pipe 4" Material: fiberglass ☐; plastic ☑; concrete ☐; other ____
2. Lateral Lines: Number 3; Length of each line 75', 75', 50', ____, ____ ft.; Total length of laterals 200' ft.; Distance between lateral lines 10 ft.
3. Trench dimensions: Width 3 ft.; Slope 3 in/100 ft.; Average Depth 30 in.
4. Filter Material: Gravel Depth of Material 18 in.
5. Distances to: Well or Suction Line 225' ft.; Stream 120' ft.; Pressure Line — ft.; Property Line 25' ft.

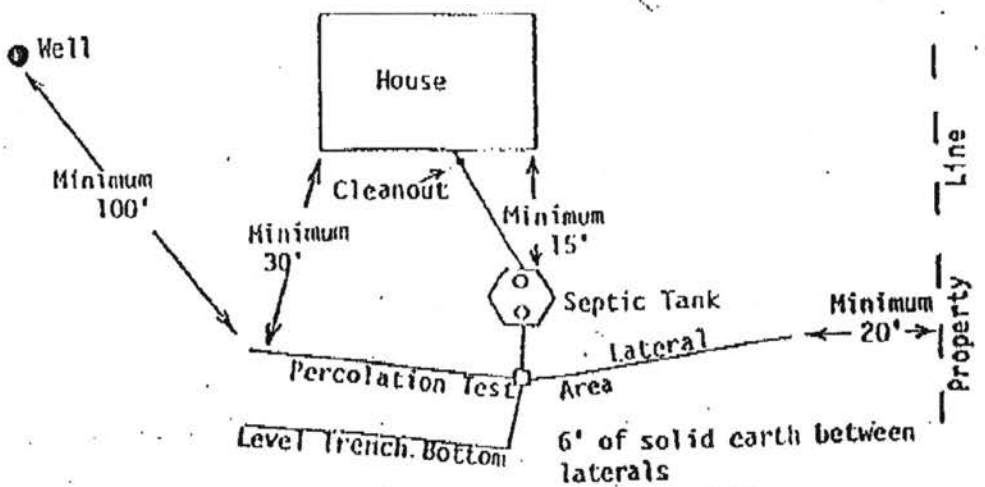


TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

Wellmann Plumbing

Stahl Residence

9040 East Holdrege

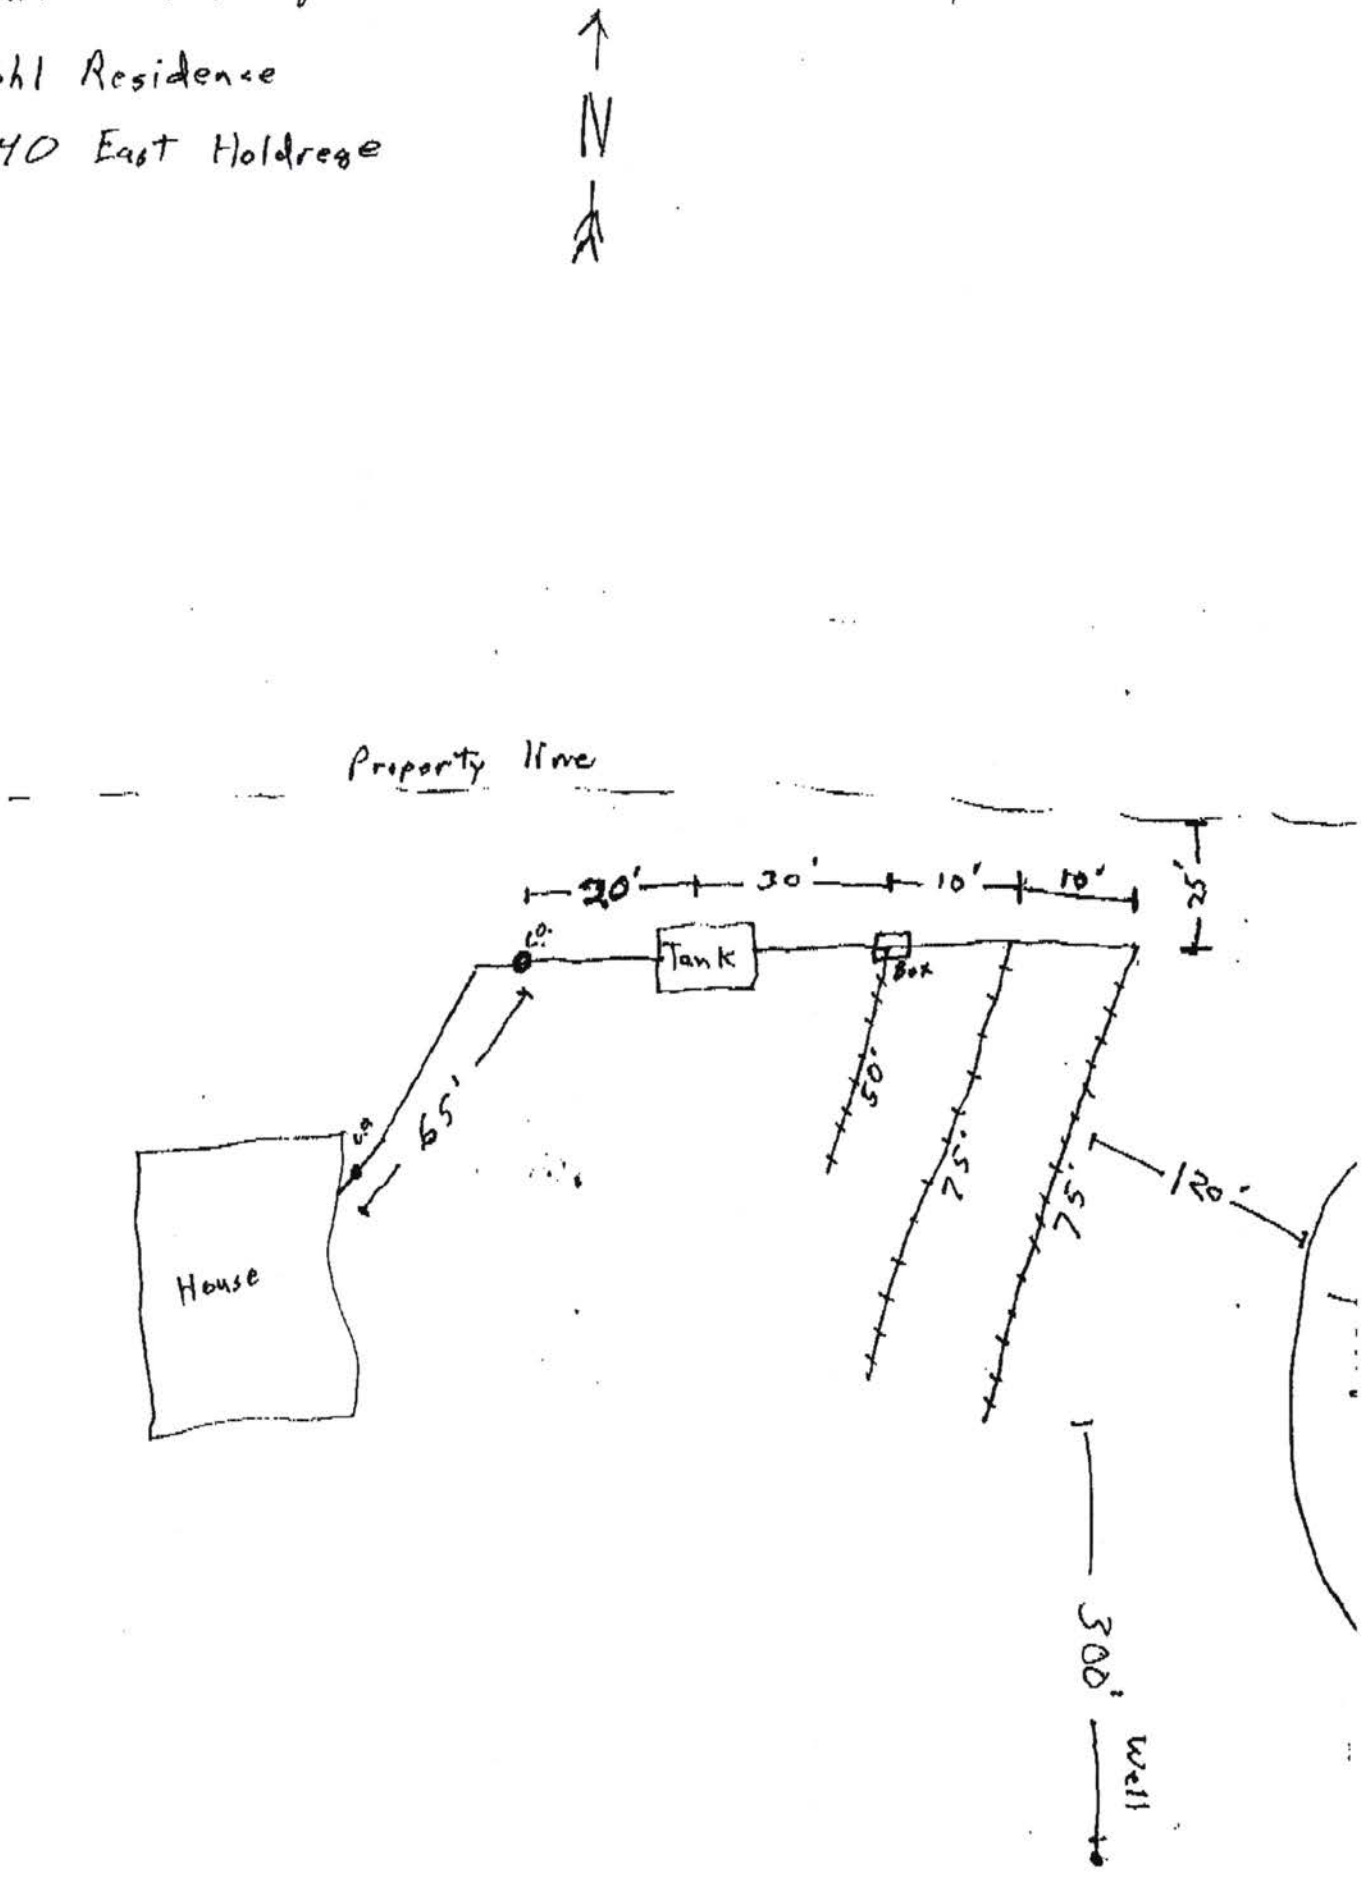

AS BUILT DRAWING OF INSTALLATION IN RELATION TO BUILDINGS, PROPERTY LINES, OTHER WELLS, AND SOURCES OF CONTAMINATION. INDICATE NORTH.

