LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

SEWAGE INSTALLATION

No. 91380069301

Issued 04/29/91
Expires 10/29/91

ESTABLISHMENT

GALEN WULF
T10N R7E SEC 14
LOT 60
9220 LEIGHTON STREET

FEES: Permit 018754 $150.00

Total $150.00

PERMITTEE

GALEN WULF
3340 N 68 ST
LINCOLN NE 68507

Issued By COUNTY HEALTH

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

DATE	AMOUNT
5/13/91	PAID

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ ~~60.00~~ 150.00

FILE NO. _____

DATE: April 18, 1991

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 7E ; Section 14 ;
   Block _____ : Lot 60 I.T. : Addition _____
   Street Address 9220 Leighton Lincoln, Ne.
2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____
3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☒ Lagoon
4. Distance to public sewer: NA ft.

+ Linda E. Wolf
Super. Lenco (Waverly)
786-2000

Galen Wulf
Signature of Applicant (Owner or Lessee)

3340 N. 68th Lincoln, Ne. 68507
Address

(Do not write below this double line)

1. Health Department:	Date Rec'd. 4/25/91. Date Frwd. 4/25/91.	ACTION: Approved ☒ Disapproved ☐	Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: or Village Clerk	Date Rec'd. 4/25/91. Date Frwd. 4/25/91	ACTION: Approved ☒ Disapproved ☐	Signature: Mel Godehoff
3. City or County Engineer :	Date Rec'd. 4/25/91. Date Frwd. 4/25/91.	ACTION: Approved ☒ Disapproved ☐	Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 8-29-91 by: RM experimental shallow wide seepage beds
Date: _____ by: _____
Date: _____ by: _____

Experimental wide seepage PROVISIONAL Bed *

INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: Dec-1-97 By: Ron Magana


White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

* See enclosed letter

FORM 23-43

FORM 20102-0477 PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application) City Ordinance No. 9150 ☐ County Resolution No. 2832 ☒	LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT Division of Environmental Health 2200 St. Marys Avenue Lincoln, Nebraska 68502 Phone: 471-7800 **C**
Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.	FILE NO._____

Indicate on sketch if residence and well are exisiting or proposed.

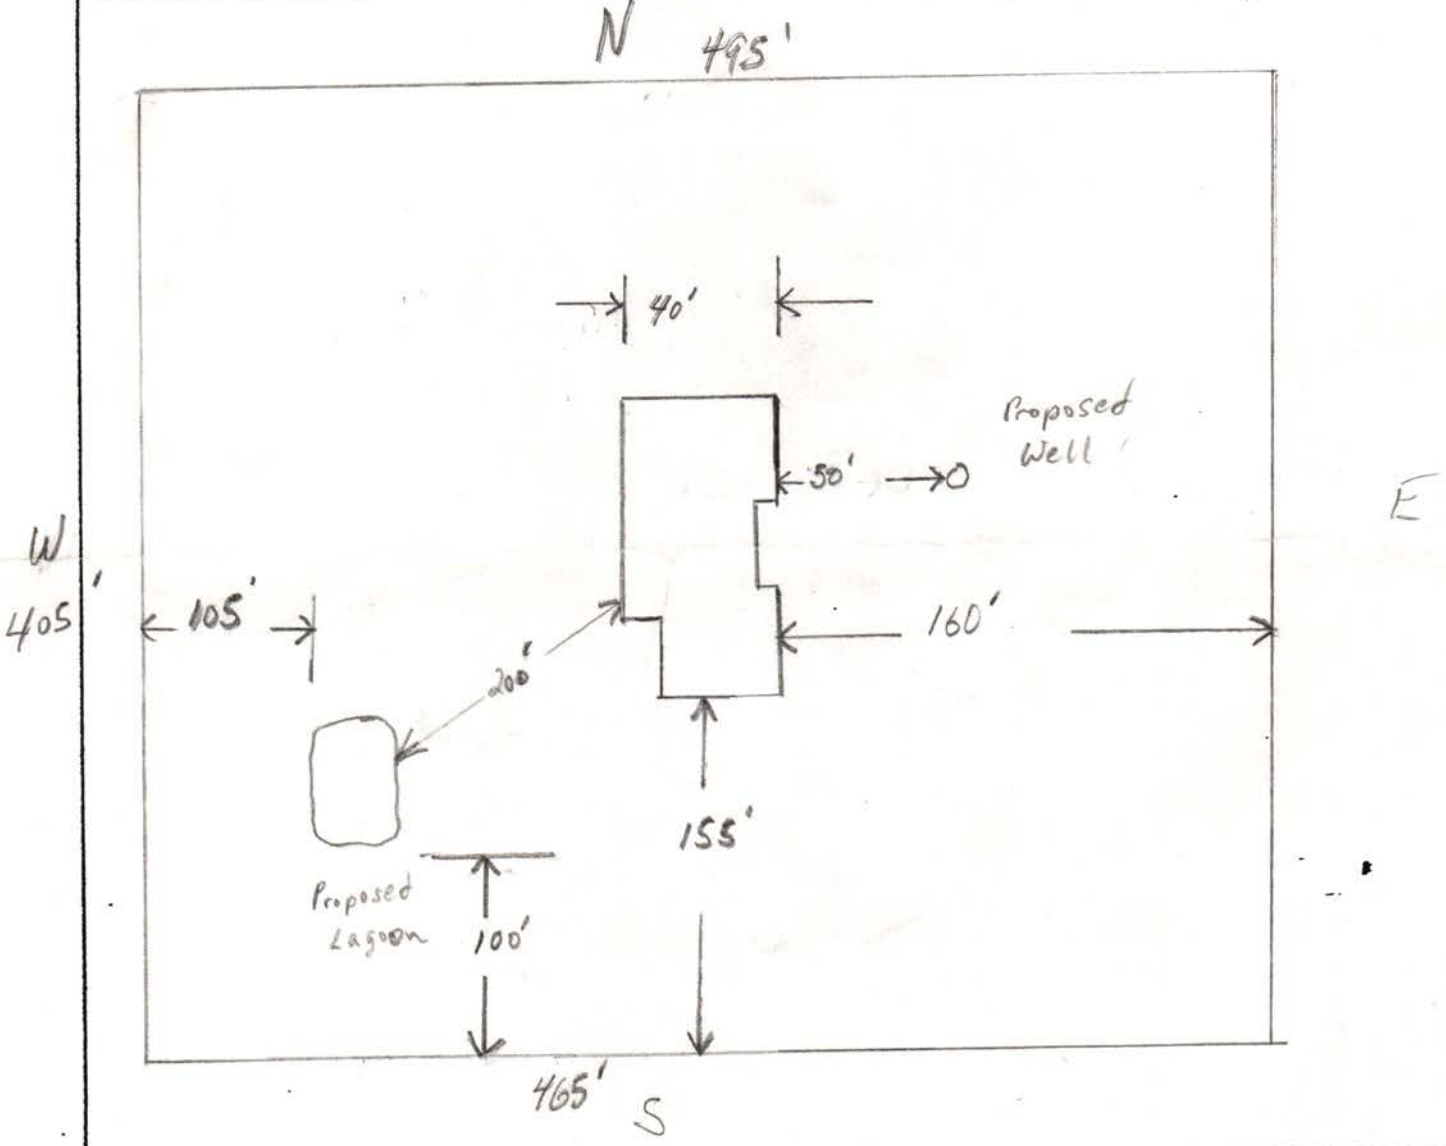

REVIEWING ACTION

Remarks: _____

_____

Date: _____

Minimum Design Requirement

1. Capacity of Septic Tank _____ gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed _____ sq.ft.

_____

Signature of Reviewing Official

RECEIVED SEP 0 3 1991

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: Sept. 1, 1991

FILE NO. Galyn Wulf


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material PVC; Diameter 4 in.
2. Distance above basement floor ____ in., or below basement floor 18 in.
3. Distance between dwelling and septic tank 55 ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line 100'+ ft.; Stream 100'+ ft.; Pressure Line ____ ft.; Property Line 100'+ ft.

B. SEPTIC TANK:
1. Material Concrete; No. of compartments one.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☑ No ☐
(Company Pre-Cast)
4. Manholes: Over Inlet; diam. ____ in.
Over Outlet; diam. ____ in.
Riser Above ☐ Below ☒ Grade 6 in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 6 in.
8. Distances to:
Well or Suction Line 100'+ ft.; Stream 100'+ ft.; Pressure Line 100'+ ft.; Property Line 100'+ ft.

C. DISTRIBUTION BOX:
1. Material Concrete; Number - available outlets ____.
2. Factory Built: Yes ☑ No ☐
(Company Pre-Cast)
3. Distance from Septic Tank 12 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☑
Diameter of Half Round ____ or Perforated Pipe 4 & 6.
Material: fiberglass ☐ ; plastic ☑ ; concrete ☑ ; other ____.
2. Lateral Lines:
Number 2 ; Length of each line 100', ____, ____, ____, ____ ft.;
Total length of laterals 200 ft.;
Distance between lateral lines — ft.
3. Trench dimensions: Width 4 & 6' ft.;
Slope 4 in/100 ft.; Average Depth 24 in.
4. Filter Material: Road gravel
Depth of Material 20 in.
5. Distances to:
Well or Suction Line 100'+ ft.; Stream — ft.; Pressure Line — ft.; Property Line — ft.

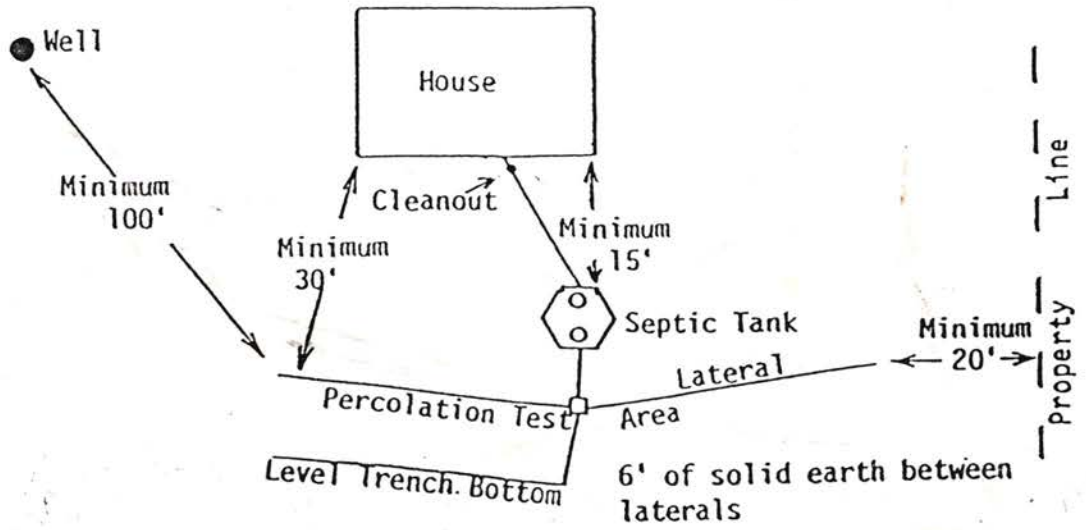

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

$175.00

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 9220 Leighton

Twp 10N Range 7E Section 14 1/4 ___ 1/4 ___ Block ___ Lot ___ Addition ___

Directions to Property 84th Street North "O" to Leighton, east on Leighton to 1st group of mailboxes on N Side of road about 1/8th, Blue House

Location of Well ___ Tap Location: Inside ☐ Outside ☐

Location of Sewage System ___ Year Installed ___

	NAME	ADDRESS	PHONE
Present Owner:			
Tenant/Buyer:	Kyle & Suzanne Williams	6230 Sumner Lincoln, Ne. 68516	483-5271
Return to:	Linda Wibbels	Woods Bros Realty 3737 S. 27 68502	434-3559

Signature of Applicant Linda K. Wibbels Address 3737 S. 27 Lincoln, Ne 68502 Date 11/14/97

HEALTH DEPARTMENT USE ONLY

Date Received 11/18/97 Received $150.00 Check ☒ Cash ☐ #1879 Pd. 175.00

PRELIMINARY STATUS--By R. Marquardt **DATE:** 11/19/97

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**	**Additional Site Visits**
Construction	☒	☐	Approved ☐	Date ___/___/___ by ___
Bacteria	☒ 0 /ml	☐ ___ /ml	Provisional ☒	Date ___/___/___ by ___
Nitrate	☒ 0.6 ppm	☐ ___ ppm	Disapproved ☐	Date ___/___/___ by ___

Comments: An experimental wider, shallow, seepage bed drain field was installed on this septic system. Thus, a provisional approval. There was no visible malfunction at the time of inspection. Recommend checking to see if septic tank needs pumping


See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Hood R.E.H.S. Date 11/24/97

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

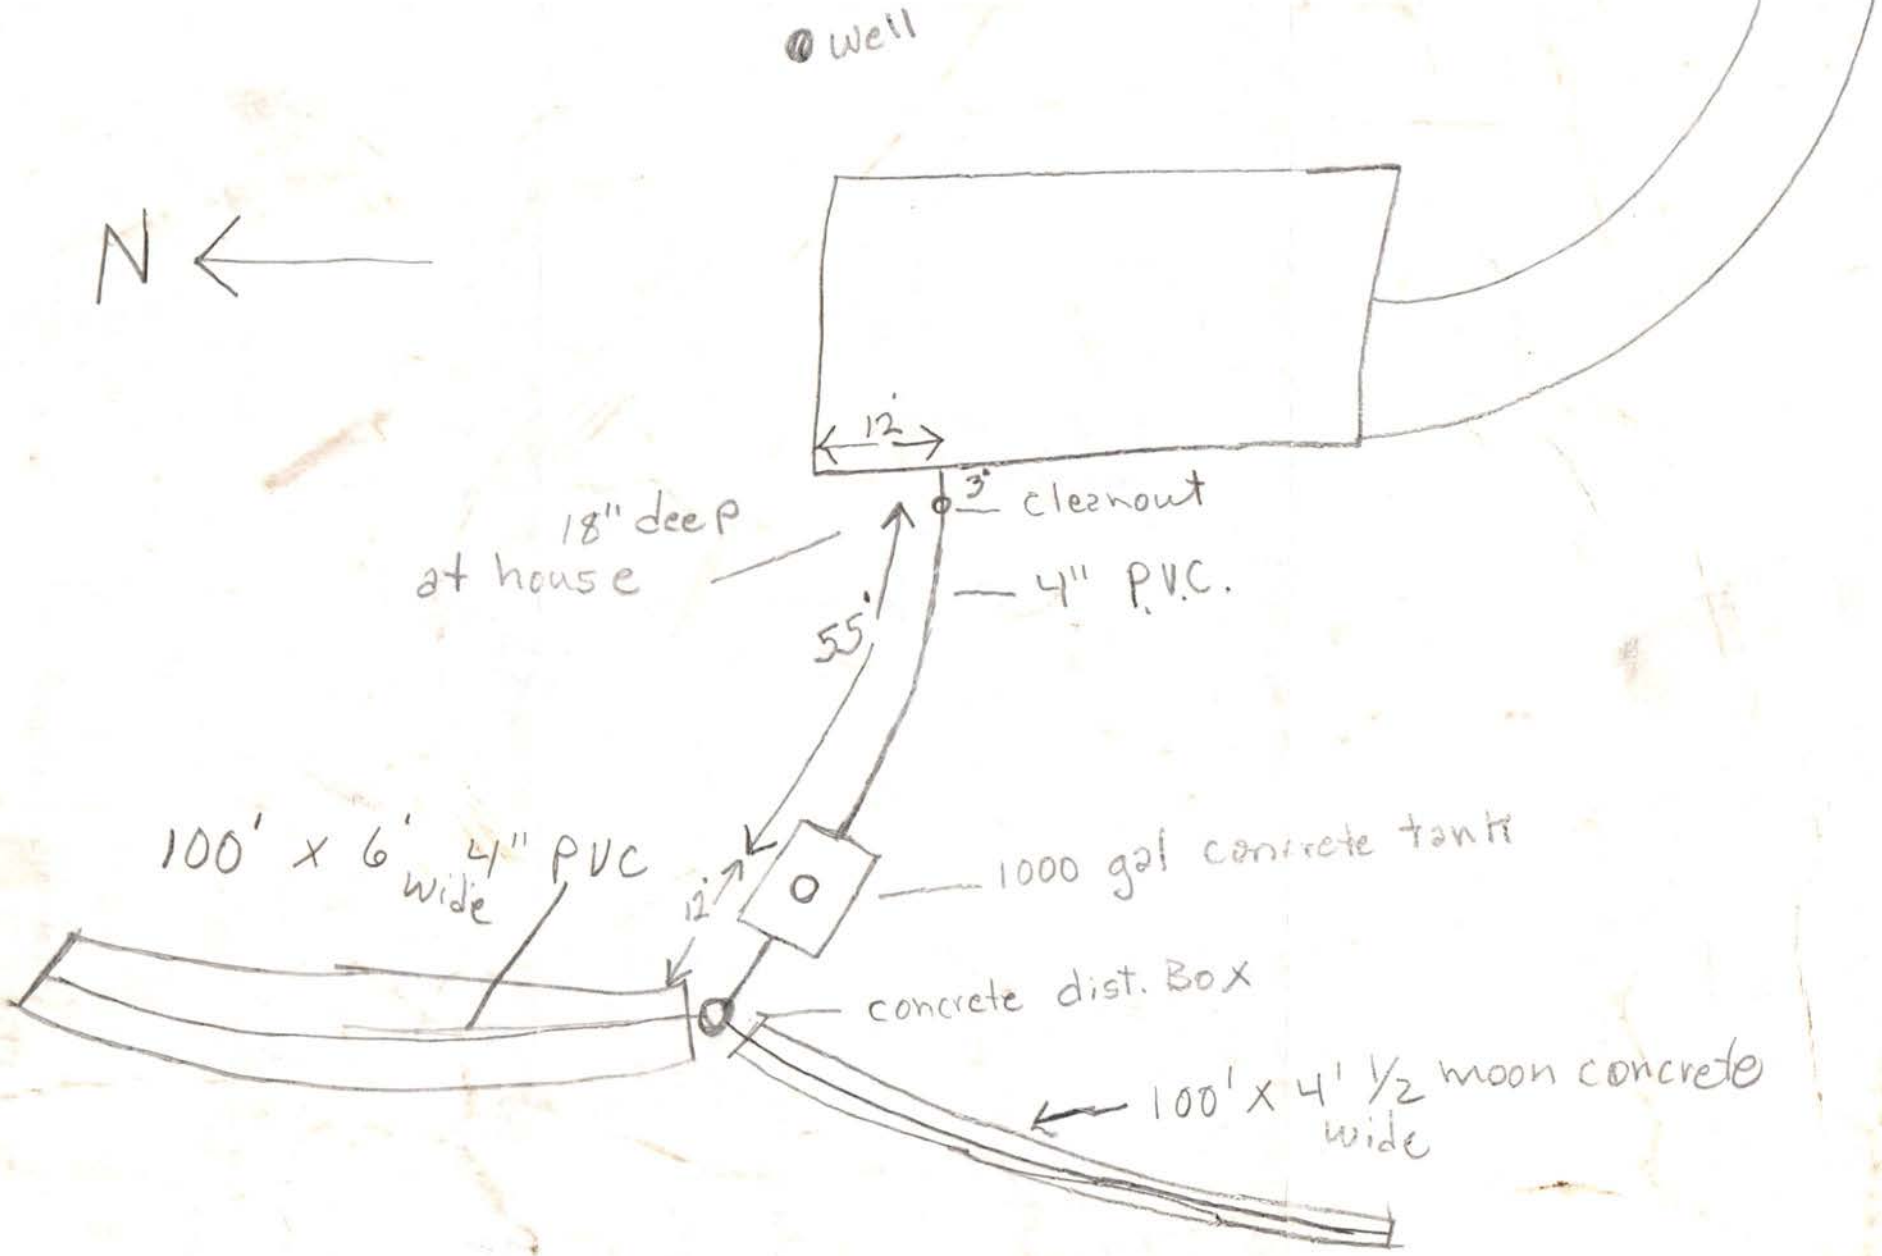
well
N
12'
3" cleanout
18" deep at house
4" P.V.C.
55'
100' x 6' wide
4" PVC
12'
1000 gal concrete tank
concrete dist. Box
100' x 4' 1/2 moon concrete wide