LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

No. 94380123801

Permit
SEWAGE INSTALLATION

Issued 10/24/94
Expires 04/24/95
Revenue Code 18754

Establishment
MARY ARTZ
T10N R7E SEC 23
SUNRISE ESTATES BLK 4 LOT 2
8831 AVON LANE

FEES: $150.00

TOTAL $150.00

Permittee
MARY ARTZ
9420 LEIGHTON AV
LINCOLN NE 68507

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $_____

FILE NO._____

DATE: 10-23-94

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 7E ; Section 23 ; Block 4 : Lot 2 : Addition SUNRISE ESTATES
   Street Address 8831 AVON LANE, LINCOLN, NEBR.
2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 4. Describe ACREAGE HOMESTEAD
3. Type of Individual Sewage Disposal System: Septic Tank ☑ ; Other ☐
4. Distance to public sewer: 1/4 mile ft.

ARTZ & SONS CONSTRUCTION
Mary Artz
Signature of Applicant (Owner or Lessee)
432-1459
9420 LEIGHTON AVE
Address
LINCOLN, NE 68507

(Do not write below this double line)

1. Health Department: Date Rec'd. 10/24/94. Date Frwd. 10/24/94. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold E. Reed
2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 10/24/94. Date Frwd. 10/24/94. ACTION: Approved ☒ Disapproved ☐ Signature:
3. City or County Engineer : Date Rec'd. 10-24-94. Date Frwd. 10-24-94. ACTION: Approved ☒ Disapproved ☐ Signature:

REMARKS OR REASONS FOR DISAPPROVAL OWNER TOOK CARE OF WELL PERMIT?

Site Visits:
Date: 10-28-94 by: nm Line taken + ultimately
Date: 10-31-94 by: nm
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 10-31-94 By: Ron Magnuson

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

432-0566

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

Test Location 8831 E. Avon Ln. Test #2 FILE NO.

PROPERTY WHERE SOIL TESTED:

Location: Township ; Range ; Section & ¼ Section .
Property Dimensions: ft. x ft. Area: acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ■ .
Dates of Tests: 10-3-94 to 10-4-94 . Weather: Precip. 0 Temp. 65°.

OWNER: Wellmann Plumbing
Address: Suit B 3301 S. 6th Lincoln, NE. 434-2400

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./Day)	Time (Hr./Min.)	Date (Mo./Day)	Time (Hr./Min.)	Date (Mo./Day)	Time (Hr./Min.)	Water Level (in.)	Time (Hr./Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5½"	30m	½"	
2	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5½"	30m	½"	
3	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5⅜"	30m	⅝"	
4	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5½"	30m	½"	
5	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5¼"	30m	¾"	
6	36"	10-3	6:30 pm	10-4	3:00 pm	10-4	3:00 pm	6"	7:00 pm	5½"	30m	½"	

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:

Mike Hoorbaum
Signature of Person Conducting Test
Address 2700 Dan Ave Lincoln NE Phone 464-0638
Precast Products Inc.

(Do not write below this line)

REVIEWING ACTION

Remarks:
Soil Type (SCS):
Date:

Approved Percolation Rate (a)
A. 55 min./inch
B. min./inch
C. min./inch

Gerrald C. Hood
Signature of Reviewing Official

441-8323

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 10-31-94

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER: 2241
1. Material Plastic; Diameter 4" in.
2. Distance above basement floor — in., or below basement floor 12" in.
3. Distance between dwelling and septic tank 109 ft.
4. Number of clean-outs 2.
5. Distances to:
Well or Suction Line 80 ft.; Stream — ft.; Pressure Line 3 ft.; Property Line 130 ft.

B. SEPTIC TANK:
1. Material Concrete; No. of compartments 3.
2. Capacity 1250 gals.;
3. Factory Built: Yes ☑ No ☐
(Company Precast)
4. Manholes: Over Inlet; diam. — in.
Over Outlet; diam. — in.
Riser Above ☑ Below ☐ Grade 6" in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
7. Depth of top of tank below finished grade 6" in.
8. Distances to:
Well or Suction Line 150 ft.; Stream — ft.; Pressure Line 25 ft.; Property Line 130 ft.

C. DISTRIBUTION BOX:
1. Material Plastic; Number - available outlets 5.
2. Factory Built: Yes ☑ No ☐
(Company _____)
3. Distance from Septic Tank 30 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☑
Diameter of Half Round _____ or Perforated Pipe 4".
Material: fiberglass ☐; plastic ☑; concrete ☐; other _____.
2. Lateral Lines:
Number 5; Length of each line 95, 90, 90, 85, 60 ft.;
Total length of laterals 420 ft.;
Distance between lateral lines 12 ft.
3. Trench dimensions: Width 3 ft.;
Slope 2 in/100 ft.; Average Depth 3 in.
4. Filter Material: Gravel
Depth of Material 20" in.
5. Distances to:
Well or Suction Line 175 ft.; Stream — ft.; Pressure Line 30 ft.; Property Line 35 ft.

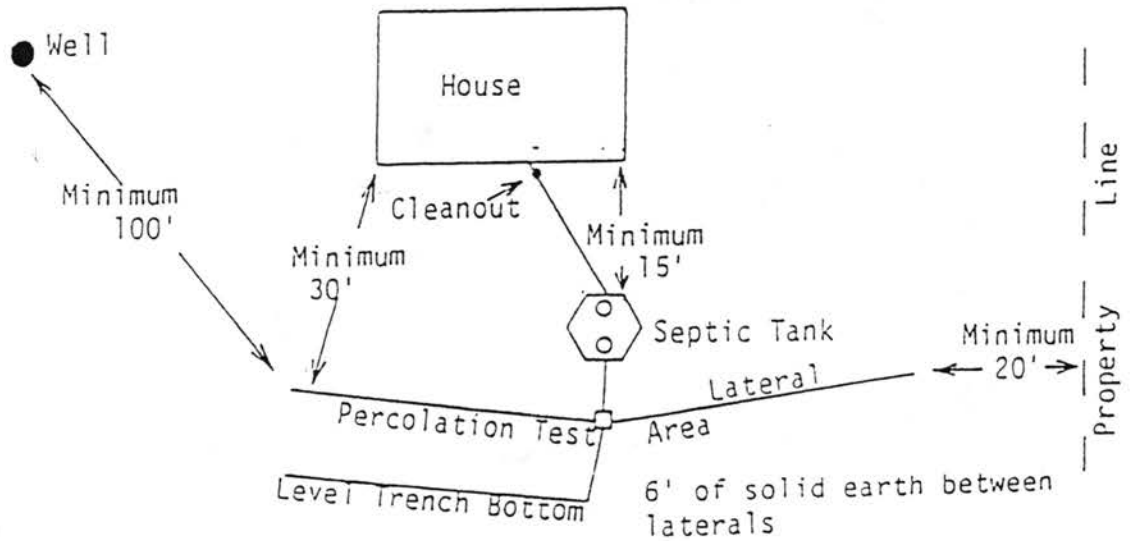


TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

8831 East Avon Lane

Wellmann Plumbing

North

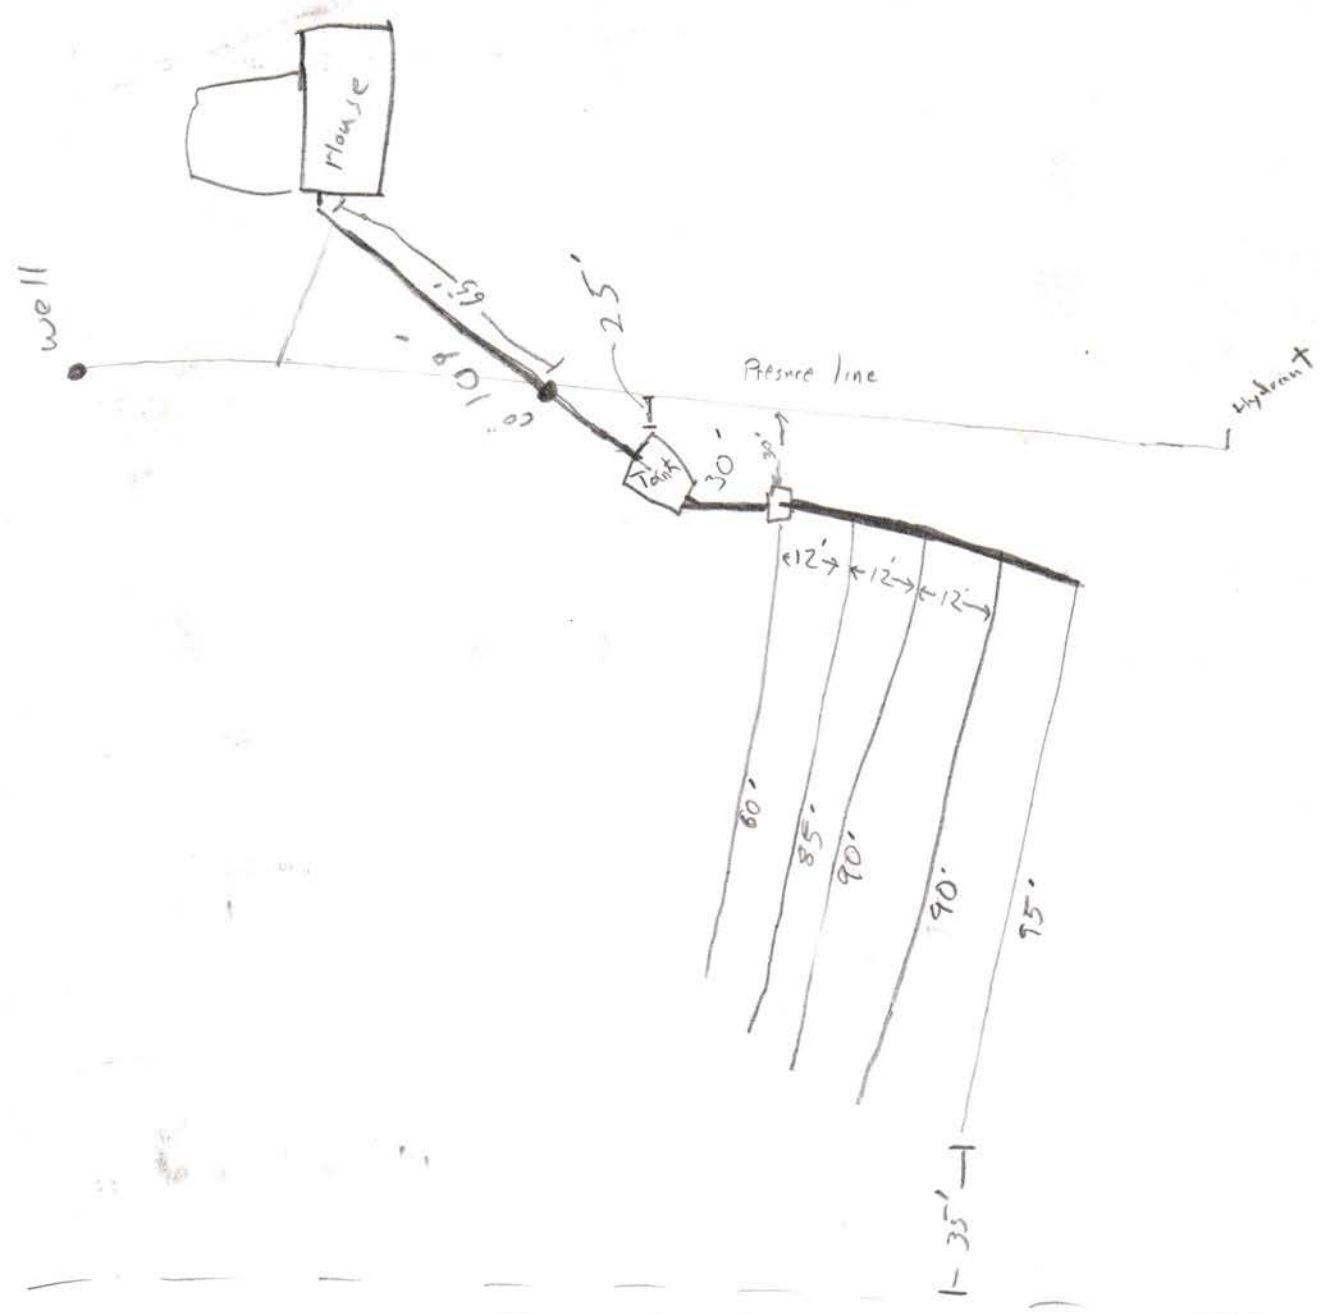

Property line