CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 10

INDIVIDUAL SEWAGE DISPOSAL SYSTEM (Septic Tank)
TYPE OF LICENSE OR PERMIT

January 17, 1968
THIS LICENSE OR PERMIT EXPIRES

Paul Weiler
LICENSEE OR PERMITTEE

5745 Colby
ADDRESS

Paul Weiler
NAME OF ESTABLISHMENT, IF ANY

T10, R 7E, Section 25 NE¼
(Legal Description)
ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
143-1535	10.0116	24.0114	6-2

SERIAL NO.	DATE	AMOUNT
01655	JA17	30.00

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 10

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10; Range 7E; Section 25;
Block NE¼; Lot ____; Addition ____;
Street Address RFD 7.

2. Property Use: Residential ____ ☑; Commercial ____ ☐
No. of Bedrooms 3. Describe: ____

Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: none ft.

Paul Weiler
Signature of Applicant (owner or lessee)

5745 Colby
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. July 17, 1967. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. July 17, 1967 Signature: per Weed

2. Supt. Bldg. Insp.: Date Rec'd. July 17 1967 ACTION: Approved ___ ☑ Disapproved ☐
Date Frwd. July 17, 1967 Signature: [illegible]

3. City Engineer: Date Rec'd. 7-17-67. ACTION: Approved ___ ☑ Disapproved ☐
Date Frwd. " ". Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☒ Disapproved ☐

Date Applicant Notified: July 17, 1967 Signature Weed

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 10

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10; Range 7E; Section 25;
Block NE¼ Lot _____; Addition _____;
Street Address RFD 7.

2. Property Use: Residential _____ [✓]; Commercial _____ [ ]
No. of Bed Rooms 3 Describe: _____
_____
Other Use _____ [ ]
Describe: _____
_____

3. Type of Individual Sewage Disposal System: Septic Tank [✓]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Paul Tuleiken
Signature of Applicant (owner or lessee)

5745 Colby
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: July 17, 1967
Filing Fee: $ 30.00 _____

2. Date Site Clearance July 17 1967

3. Site Visits:
Date: July 14, 67 by: Dell Weed
Date: _____ by: _____
Date: Aug 31, 1967 by: Dell Weed

4. Date: Approved [✓]; Disapproved [ ]: 7/17/67
by: Dell Weed

5. BUREAU OF LICENSES & PERMITS
Date Notified: July 17 1967
Date Issued: 7/17/67 Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: Aug 31, 1967 by: Dell Weed

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 10

PROPERTY WHERE SOIL TESTED:
Location: Township 10
Section & ¼ Sect. NE
Property Dimensions: 384.4 ft. x 208.71 ft.
Area: 2 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Paul Wheeler
Address 5745 Colby

Dates of Tests: July 14 to July 18. Weather: Precip. ____ Temp. ___F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36"	7/14	1 PM	7/14	6 PM	7/14	6 PM				20	1"	20
2	"	7/14	"	7/14	"	7/14	"				20	1"	20
3	"	7/14	"	7/14	"	7/14	"				32	1½"	20
4	"	7/14	"	7/14	"	7/14	"				32	1¾"	19

Sum of Percolation Rates 79
Average of Rates: 20
Mean of Rates: ____

Paul B Wheeler
Signature of Person Conducting Test

Address ____
Phone: ____

(Do not write below this line)

REVIEWING ACTION

REMARKS: ____

Approved Percolation Rate(s)
A. ____ min./inch
B. ____ min./inch
C. ____ min./inch

DATE: July 17, 1967

Del Weed
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 10

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material Cast ; Diameter 4" in.
2. Distance above basement floor ___ in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 85 ft.
4. Number of clean-outs 1 .
5. Distances To:
Well or Suction Line 50 ft.;
Stream — ft.; Pressure Line 50 ft.;
Property Line 100 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material concrete; No. of compartments 1 .
2. Capacity 1000 gals.; Liquid depth 51 in.
3. Factory Built: Yes ☑ (Company Jannes)
No ☐
4. Manholes: Over Inlet; diam. 18 in.
Over Outlet; diam. ___ in.
Below Grade 6 in.
5. Inlet: Baffle ☐; or Tee ☑
6. Outlet: Baffle ☐; or Tee ☑
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 150 ft.;
Stream — ft.; Pressure Line 100 ft.;
Property Line 100 ft.

C. DISTRIBUTION BOX
1. Material Concrete; No. available outlets 6 .
2. Factory Built: Yes ☑, (Company Tanner)
No ☐
3. Dimension: Length 18 in.; Width 12 in. Depth 12 in.
4. Distance from Septic Tank 5 ft.
5. Serial Distribution: Yes ☐, No ☑
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: ½ mound Concrete
2. Lateral Lines: Depth below grade 18 in.
Number 2 ; Length of each line 60 ft
Total length of Laterals 120 ft.;
Slope 4 in/100 ft. Diameter of pipe 24" in.; Shape ½ mound
Material: concrete ☑; fiber asbestos ☐; clay ☐; other ___
Distance between lateral lines — ft.
3. Trench Dimensions: Depth 30 in.; Width 30 in.
4. Filter Material: Gravel .
Depth of material from trench bottom 12 in.
5. Distances To:
Well or Suction Line 100 ft.;
Stream None ft.; Pressure Line 100 ft.
Property Line 100 ft.
6. Percolation Rate: 20 minutes/inch

TYPICAL SKETCHES

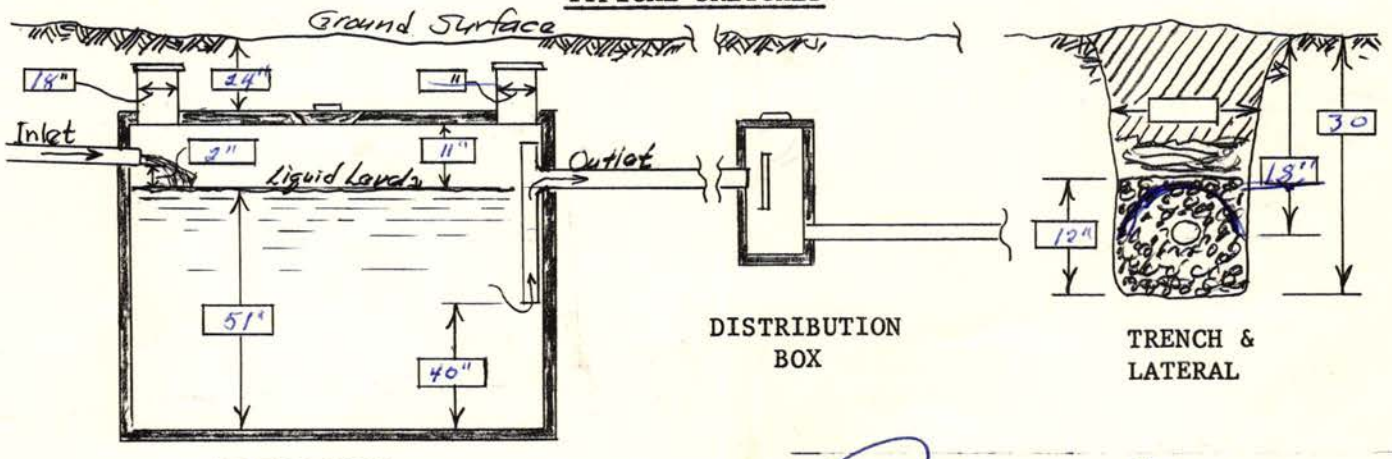


SEPTIC TANK

DISTRIBUTION BOX


TRENCH & LATERAL

Paul R Weiler
Signature of Applicant

PLAN LAYOUT

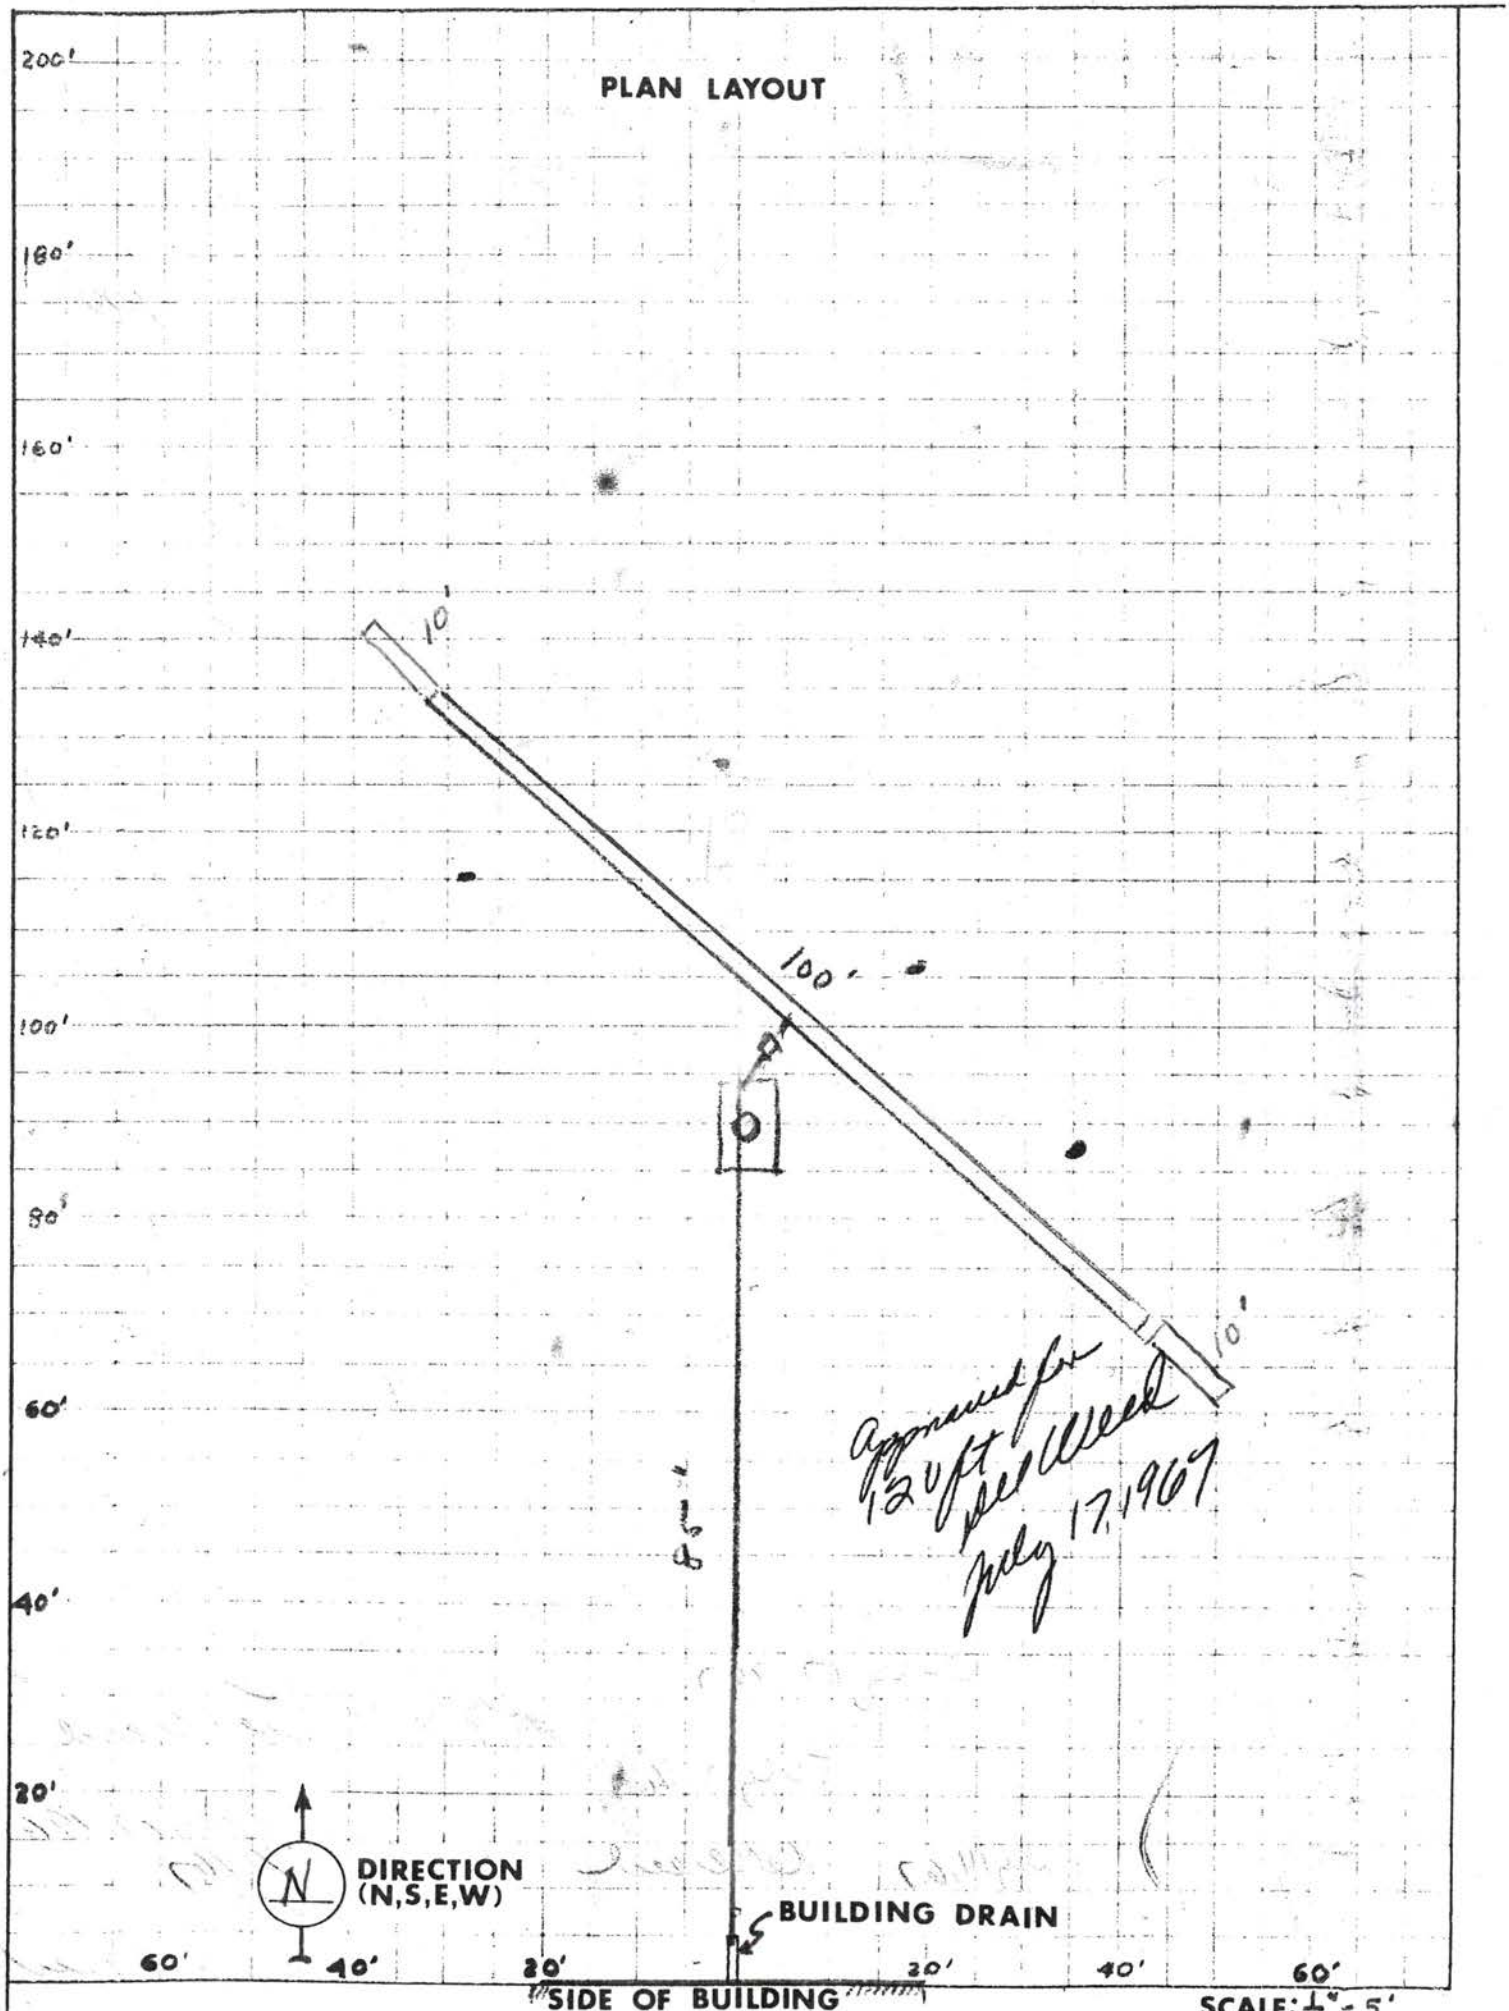
200'
180'
160'
140'
120'
100'
80'
60'
40'
20'
10'
100'
10'
10'
Approved for
120 ft per Week
July 17, 1967
N
DIRECTION
(N,S,E,W)
BUILDING DRAIN
60'
40'
20'
20'
40'
60'
SIDE OF BUILDING
SCALE: 1/4" = 5'

DETAIL DRAWINGS

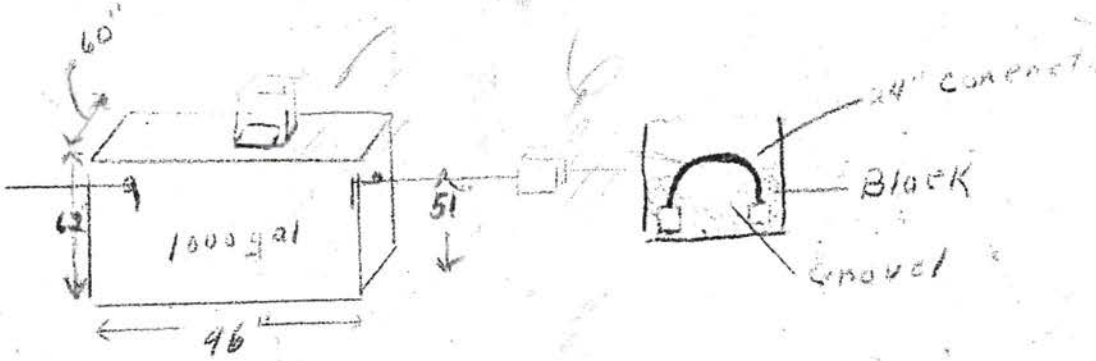

FORM HD 32 b(67): PLANS FOR INDV SEWAGE SYSTEM	Date
Name Address	FILE NO. 10