LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 95390047101

Issued 09/06/95
Expires 03/06/96
Revenue Code 18754

Establishment
BRAD SOUTHWICK
T10N R7E SEC 25 QTR SE
LANCAS

FEES: $50.00

TOTAL $50.00

Permittee
BRAD SOUTHWICK
17201 S 72 ST
HICKMAN NE 68372

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☐

Lincoln-Lancaster County
HEALTH DEPARTMENT
3140 "N" STREET LINCOLN, NE 68510-1514

FILE NO. _____

11242 + 0 ft.

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 8-30-95

The undersigned hereby applies for a permit to ALTER ☒, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 10 ; Range 7 ; Section 25 NE¼ ;
Block _____; Lot _____; Addition ½ S. Swartzlander
Street Address _____

2. Property Use: Residential _____ ☐; Commercial _____ ☒
No. Bedrooms _____
Describe Green house - (5-6) people for 4-6 hr Daily
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: abandon existing lateral (approx 76' of 3" sch) 4 star II Distribution box + 100' x 3 pressure laterals

5. Work to be done by: Owner ☐ ; or Contractor ☒ , Southwick Sewer & Drain
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$ 7400	00

Dick Colenick Brad Southwick
Signature of Applicant (owner or lessee)

17201 S. 72
Address
Hickman, Ne 68372

(Do not write below this line)


REVIEWING ACTION

1. Date Rec'd: 8-30-95
Filing Fee: $ 50.00

2. Site Visits:
Date: 8-30-95 by: MM (located 15' from building)
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Ron Magnuson
PROVISIONAL

4. INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 12-4-97 by: Ron Magnuson

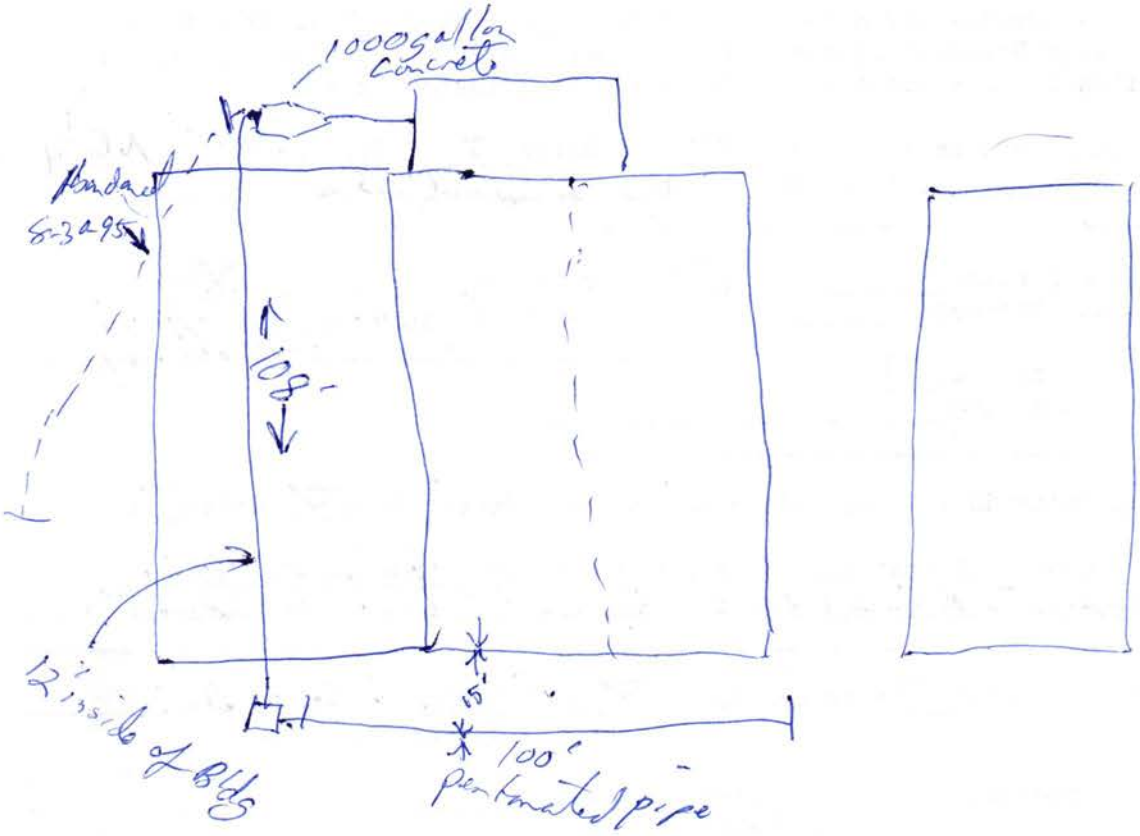
1000 gallon concrete
Standard
S-3a-95
10'-
2' inside of Bldg
5'
100'
perforated pipe
well


Wedgewood Lake
22
27
34
35
26
23
25
24
36
(Joins sheet 32)
425 000 FEET
1 Mile
5000 Feet
Scale 1:20000

FILE #2144

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

APRIL 18, 1985 — THIS LICENSE OR PERMIT EXPIRES

GLORIA M. COLERICK — LICENSEE OR PERMITTEE

7211 WHITESTONE CIR. LINCOLN, NE 68506 — ADDRESS

T10N; R7E; Sec 25; Lot 37 I.T.; 701 So. 112th St. — NAME OF ESTABLISHMENT, IF ANY / ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2144

DATE: October 1

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 7E ; Section 25 ;
   Block _____ : Lot 3 7IT : Addition _____
   Street Address 701 South 112

2. Property Use: Residential ☐ ; Commercial ☒ Other Use ☐
   No. of Bedrooms _____. Describe GREEN HOUSE
   3 EMPLOYEES

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Gracia M. Colwick
Signature of Applicant (Owner or Lessee)

7211 Whitestone Circle
Address Lincoln, NE 68506

(Do not write below this double line)

1. Health Department: Date Rec'd. 10/18/84. Date Frwd. 10/19/84. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 12/4/84. Date Frwd. 12/4/84. ACTION: Approved ☒ Disapproved ☐ Signature: Gary M. Shorman

3. City ~~or County~~ Engineer: Date Rec'd. 10-19-84. Date Frwd. 10-19-84. ACTION: Approved ☒ Disapproved ☐ Signature: M Long

REMARKS OR REASONS FOR DISAPPROVAL NEED WELL PERMIT YET.

Site Visits:
Date: 12-11-84 by: nm
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 12-14-84 By: Ron Mayeur

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2144

PROPERTY WHERE SOIL TESTED:

Location: Township_____; Range_____; Section & ¼ Section_____.
Property Dimensions: _____ft. x _____ft. Area:_____acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ■ .
Dates of Tests: 10-13-84 to 10-14-84. Weather: Precip. 0 Temp. 55°.

OWNER: Dick Colerick

Address: 7211 Whitestone Cr. 489-8500

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	10-13	7:30 Am	10-14	7:30 Am	10-14	7:30 Am	6"	8:30 Am	5 7/8"	30m	1/8"	
2	"	"	"	"	"	"	"	6"	"	5 7/8"	30m	1/8"	
3	"	"	"	"	"	"	"	6"	"	5 3/4"	30m	1/4"	
4	"	"	"	"	"	"	"	6"	"	5 3/4"	30m	1/4"	
5	"	"	"	"	"	"	"	6"	"	5 3/4"	30m	1/4"	
6	"	"	"	"	"	"	"	6"	"	5 3/4"	30m	1/4"	

William Hoogland
Signature of Person Conducting Test

Address 2701 N 27th Phone_____

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks:_____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date:_____

Approved Percolation Rate (a)
A._____min./inch
B._____min./inch
C._____min./inch

_____
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. 2144

Indicate on sketch if residence and well are exisiting or proposed.

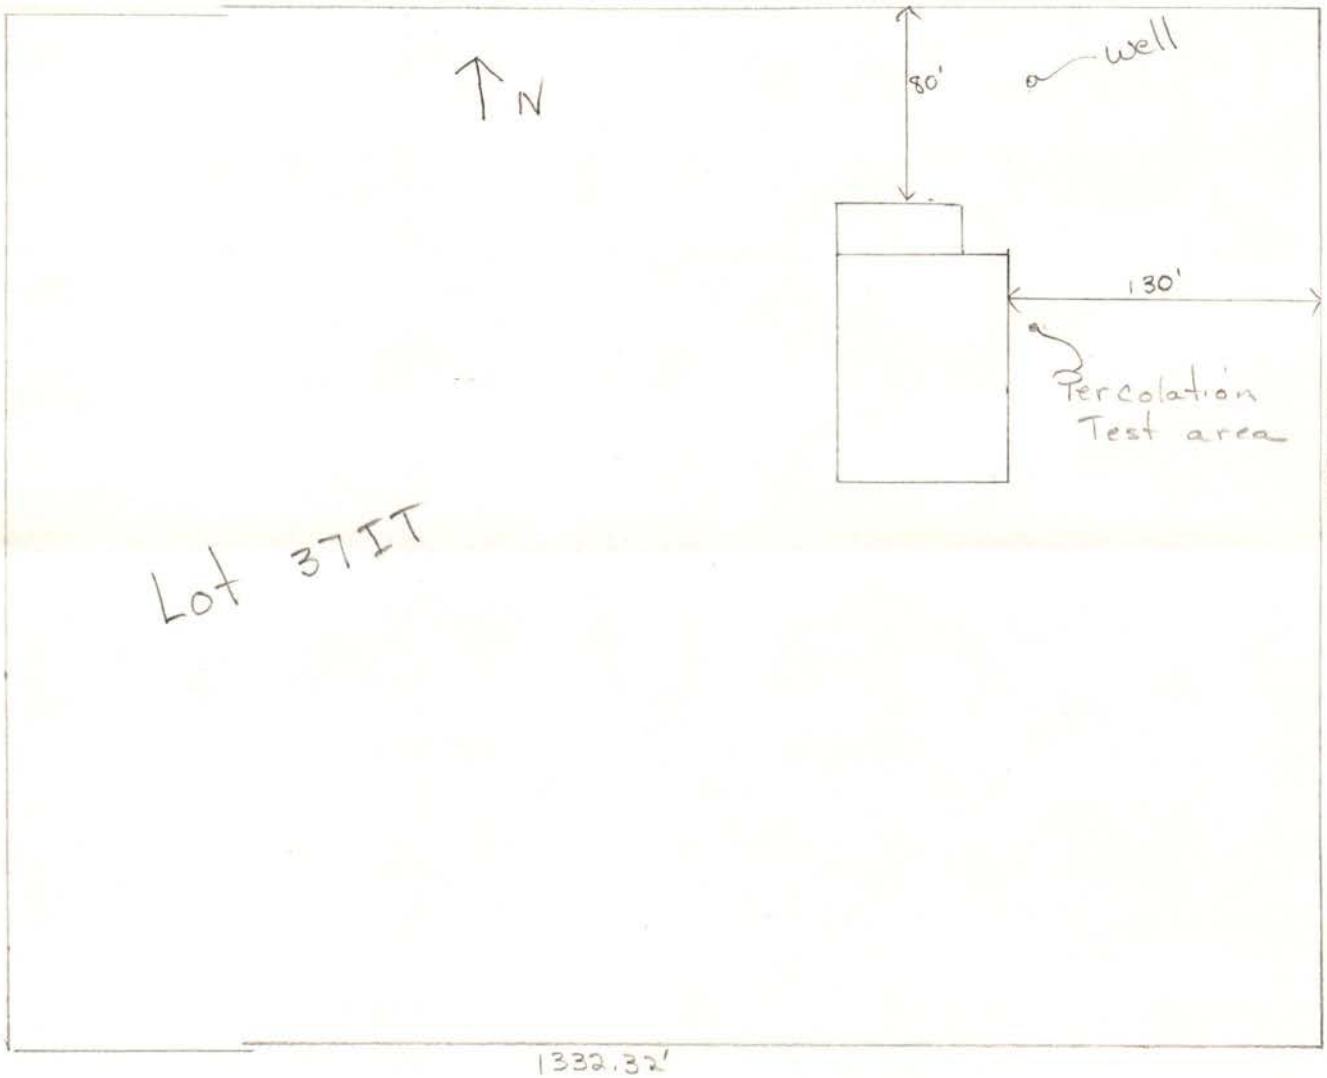


REVIEWING ACTION

Remarks: _____

Date: OCTOBER 18, 1984

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 300 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

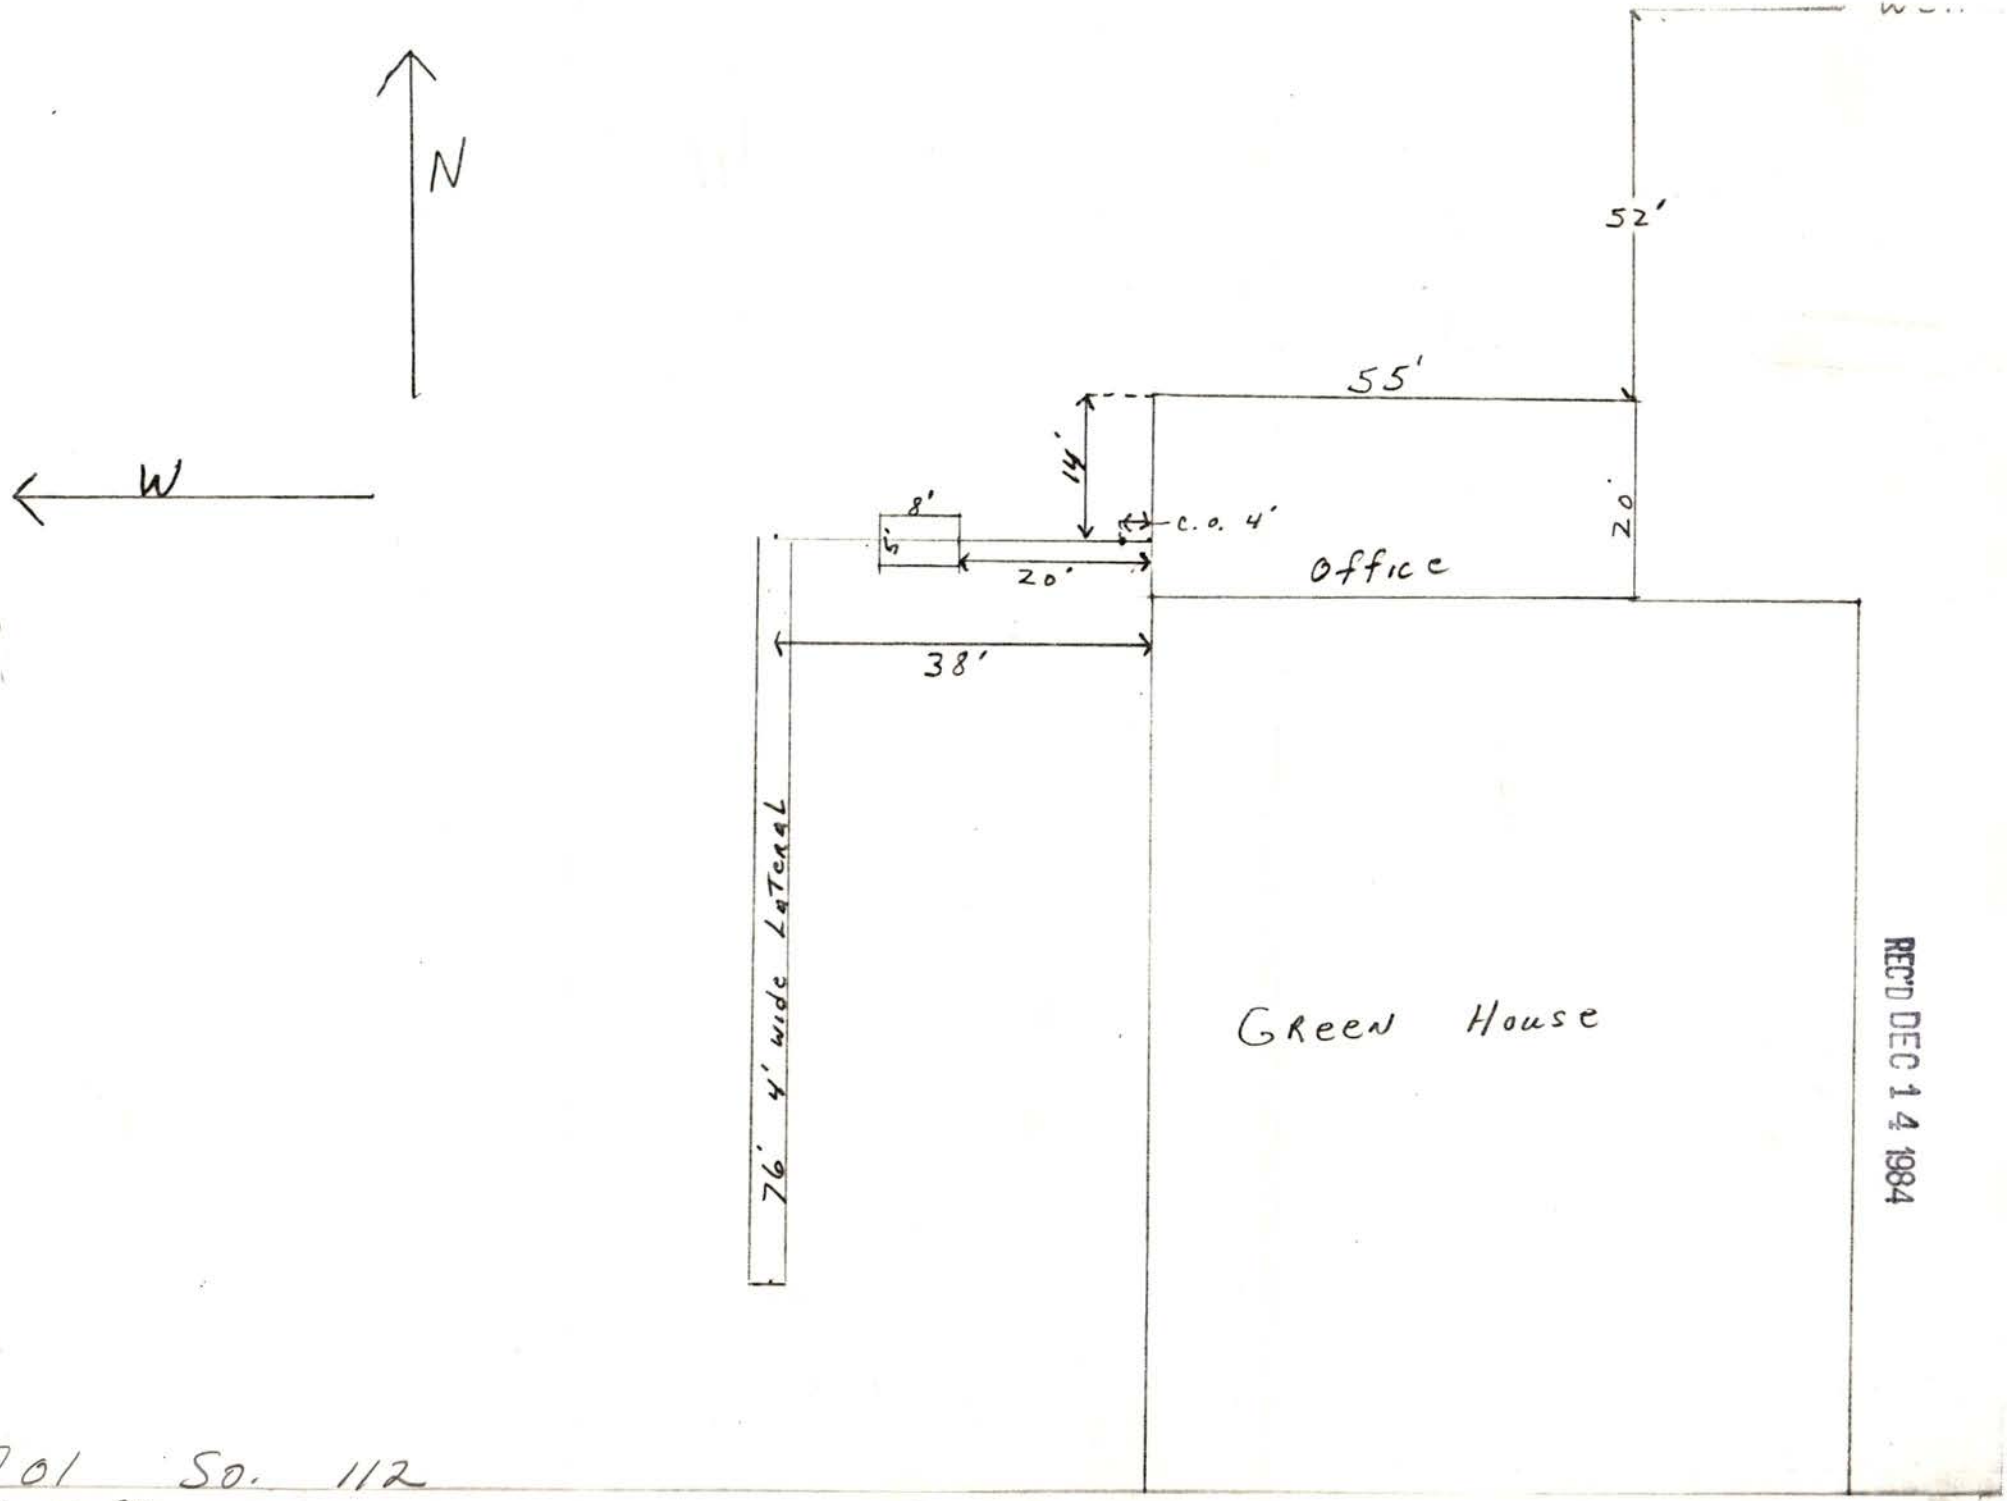

REC'D DEC 14 1984

701 So. 112
12-11-84

FILE #W-71

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL WATER WELL CONSTRUCTION — TYPE OF LICENSE OR PERMIT

APRIL 24, 1984 — THIS LICENSE OR PERMIT EXPIRES

GLORIA M. COLERICK — LICENSEE OR PERMITTEE

7211 WHITESTONE CIR. LINCOLN, NE 68506 — ADDRESS

T10N; R7E; Sec 25; Lot 37 I.T. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 45.00	019851	$ 45.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM: 20222-0483
REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL WATER WELL

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN, NEBRASKA 68502
PHONE: 471-7800

FILING FEE $45.00

FILE NO. W-71

DATE: October 23, 1984

The undersigned hereby requests: Site Clearance and Permit to construct a new individual water well ☒ ; Permit existing well ☐ ; well repair or alteration involving opening of well ☐ ; in conformance with appropriate ordinance, as described herein:

1. Legal description of property: Twp. 10 N : Range 7 E : Section 25
   Block ____ : Lot 37 I.T. : Addition ____
2. Well use: Residential ☐ ; Commerical ☒ ; Other Use ☐
   Describe ____
3. Distance to Public Water Supply: ____ Ft.
4. Intended use of well Water greenhouse plants

Gloria M. Colucink
Signature of Applicant (owner or lessee)
7211 Whitestone Circle
Lincoln, Nebraska 68506
Address

Sewage Permit Applied For Yes ☒ No ☐ Not Applicable ☐

1. Health Department: Date Rec'd 10/23/84. Action: Approved ☒ Disapproved ☐
   Date Frwd. 10/24/84. Signature: Jerrold C. Nood
2. Supt. Bldg. Insp.: Date Rec'd 10/24/84. Action: Approved ☒ Disapproved ☐
   Date Frwd. 10/24/84. Signature: [illegible]
3. City or County Engineers: Date Rec'd 10/24/84. Action: Approved ☒ Disapproved ☐
   Date Frwd. 10/24/84. Signature: Jerome G. Obrist

REMARKS OR REASONS FOR DISAPPROVAL ____

Site Visits:
Date: 4/18/85 by J.C.H.
Date: 6/5/85 by J.C.H.
Date: ____ by ____

Nitrate Level < 0.1 PPM
Bacteriological Analysis Satisfactory
Yes ☒ No ☐

INSTALLATION FINAL WRITTEN APPROVAL
Date: 6/5/85 By: J.C.Nood

Health Department copy: White
Engineers Copy: Light Green
Building Inspectors Copy: Light Blue

FORM 23-13

FORM: 20223-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL
CITY ORDINANCE NO. 13558
FILE NO. W-71

LINCOLN-LANCASTER COUNTY HEALTH
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN NE 68502
Phone: 471-7800

DATA SHEET FOR WATER WELLS

Legal Description: Sec. 25 T. 10 R. 7 Block ____ Lot 37 Addition ____

Owner Gloria M. Colerick Address 701 South 112
7211 Whitestone Circle
Lincoln, NE 68506

LOG OF WELL	
Depth Ft. to	Description
0-1	Topsoil
1-4	clay, brown
4-11	clay, tan & gray
11-18	clay, brown
18-22	clay, yellow
22-54	clay, brown & tan
54-71	shale, yellow, gray&red
71-80	sandstone, fine, lt. to medium cement
80-95	sandstone, fine to lt. cement, yellow
95-100	sandstone, fine med. cement, yellow
100-120	sandstone, fine to coarse lt. cement
120-130	sandstone, fine
130-144	sandstone, fine to medium
144-149	sandstone & shale, white
149-175	sandstone, medium, lt. cement
175-180	shale, red & yellow

WELL COMPLETION RECORD

Drilling Method: water rotary

Depth (from ground level), Ft. 174
Date Completed 9-13-84

Casing: Length, Ft. 174 ; Dia. In. 4"
Wall Thickness, Inc 200 psi type PVC

Screen: Length, Ft. 10 Dia. In. 4
Type Johnson , slot Size .025

Drop Pipe: Length, Ft. not in yet Dia. In. ____

Water Level, Surface to top of water, Ft.:
Static 56 ft. , Pumping NIL

Yield: 50 ggm, Measured ☐ , Est. ☒
Chlorination Completed Yes ☒ No ☐

The above information including "Log of Well" is a true record of the job performed by me.

Driller Richard Hedgen
(Signed)

Address Rt.6 Box 83A
Lincoln, Ne. 68502

Date 10-25-84

REMARKS ____

DO NOT WRITE BELOW THIS DOUBLE LINE

Health Department forwarded copy of record to Nebraska Conservation and Survey Department for Scientific Record ☒

FORM 23-4

AS BUILT DRAWING OF INSTALLATION IN RELATION TO BUILDINGS, PROPERTY LINES, OTHER WELLS, AND SOURCES OF CONTAMINATION. INDICATE NORTH.

