FILE NO. 798

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — October 30, 1976

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Dean Satterthwaite — 1901 Oakdale — Lincoln, NE

LICENSEE OR PERMITTEE — ADDRESS

T10N; R7E: Sec. 36-SW¼ of NW¼ - N-210 Feet of West 660 Feet.

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
110.15	110.16	148.14	6-2	

624-1535

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒

County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 798

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: April 22, 1976

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10 N.; Range 7E; Section 36.
~~Block~~ ____; ~~Lot~~ ____; ~~Addition~~ SW¼ of NW¼ N-210 feet of West 660 feet.
Street Address ____

2. Property Use: Residential ____ ☑; Commercial ____ ☐
No. of Bedrooms 3. Describe: ____
Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Distance to public sewer: NA. ft.

W. Dee Sallenbach
Signature of Applicant (Owner or Lessee)

1901 Oakdale. Lincoln 68520
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 4/22/76. Date Frwd. 4/22/76. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 4-22-76. Date Frwd. 4-22-76. ACTION: Approved ☒ Disapproved ☐ Signature: Williamson

3. City ~~or County~~ Engineer: Date Rec'd. 4-22-76. Date Frwd. 4-22-76. ACTION: Approved ☒ Disapproved ☐ Signature: Al Imig

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 798

DATE: April 22, 1976

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10 N ; Range 7E ; Section 36 ; ~~Block~~ ; ~~Lot~~ ; Addition SW ¼ of NW ¼. Street Address N 210 feet of West 660 feet.

2. Property Use: Residential [ ]; Commercial [ ]
   No. of Bedrooms 3
   Describe:
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [✓]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

W Dean Sitler
Signature of Applicant (owner or lessee)

1901 Oakdale, Lincoln, 68520
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 11-15-76 by: jw
   Date: by:
   Date: by:

3. Date: Approved [X]; Disapproved [ ] 11/22/76
   by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 11-15-76 by: James Weverka

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 798

PROPERTY WHERE SOIL TESTED: Site #2 Owner: Dean Satterthwaite

Location: Township 10 North; Range 7 east.
Section & ¼ Sect. 36 Address 1901 Oakdale

Property Dimensions: 210 ft. x 660 ft.
Area: 3.18 acres. (Attach sketch of property showing hole location).

Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☑; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 8/16/75 to 8/17/75. Weather: Precip. 0 Temp. 92° F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	32"	8/16	4:30	8/18	8:30	8/17	7:00	5 1/4"	7:30	7	30	1 3/4	17
2	32"	"	"	"	"	"	7:00	6 3/4	"	8 1/2	"	1 3/4	17
3	32"	"	"	"	"	"	"	5 1/2	"	7	"	1 1/2	20
4	32"	"	"	"	"	"	"	6	"	8	"	2	15
5	32"	"	"	"	"	"	"	5	"	7 1/4	"	2 1/4	13
6	32"	"	"	"	"	"	"	7 1/4	"	8 3/4	"	1 1/2	20
	X												
	8" wide												

Dean Satterthwaite
Signature of Person Conducting Test

Sum of Percolation Rates 102
Average of Rates: 17
Mean of Rates: 16.5

Address 1901 Oakdale Lincoln.
Phone: ~~[illegible]~~ 488-8095

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 17 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: April 22, 1976

Jerrold C. Hood
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PVC; Diameter 4 in.
2. Distance above basement floor 48 in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 25 ft.
4. Number of clean-outs one.
5. Distances To:
   Well or Suction Line 200 ft.;
   Stream 150 ft.; Pressure Line 10 ft.;
   Property Line 40 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments one.
2. Capacity 1000 gals.; Liquid depth 47" in.
3. Factory Built: Yes [X] (Company Pre-cast Step Co.)
   No [ ]
4. Manholes: Over Inlet; diam. ___ in.
   Over Outlet; diam. ___ in.
   Below Grade 8 in.
5. Inlet: Baffle [X]; or Tee [ ]
6. Outlet: Baffle [X]; or Tee [ ]
   Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
   Well or Suction Line 250 ft.;
   Stream 150 ft.; Pressure Line 30 ft.;
   Property Line 30 ft.

C. DISTRIBUTION BOX
1. Material Concrete; No. available outlets Two.
2. Factory Built: Yes [X], (Company Pre-Cast Step Co. No [ ]
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 80 ft.
5. Serial Distribution: Yes [ ], No [ ] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Half Moon seepage Bed.
2. Lateral Lines: Depth below grade 12 in. Number Two; Length of each line 75 ft Total length of Laterals 150 ft.; Slope 0 in/100 ft. Diameter of pipe 15 in.; Shape Half Moon. Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other ___ Distance between lateral lines N/A ft.
3. Trench Dimensions: Depth 36 in.; Width 48 in.
4. Filter Material: gravel. 1" screened. Depth of material from trench bottom 24 in.
5. Distances To:
   Well or Suction Line 350 ft.;
   Stream ___ ft.; Pressure Line 150 ft.
   Property Line 20 ft.
6. Percolation Rate: 17 minutes/inch

TYPICAL SKETCHES

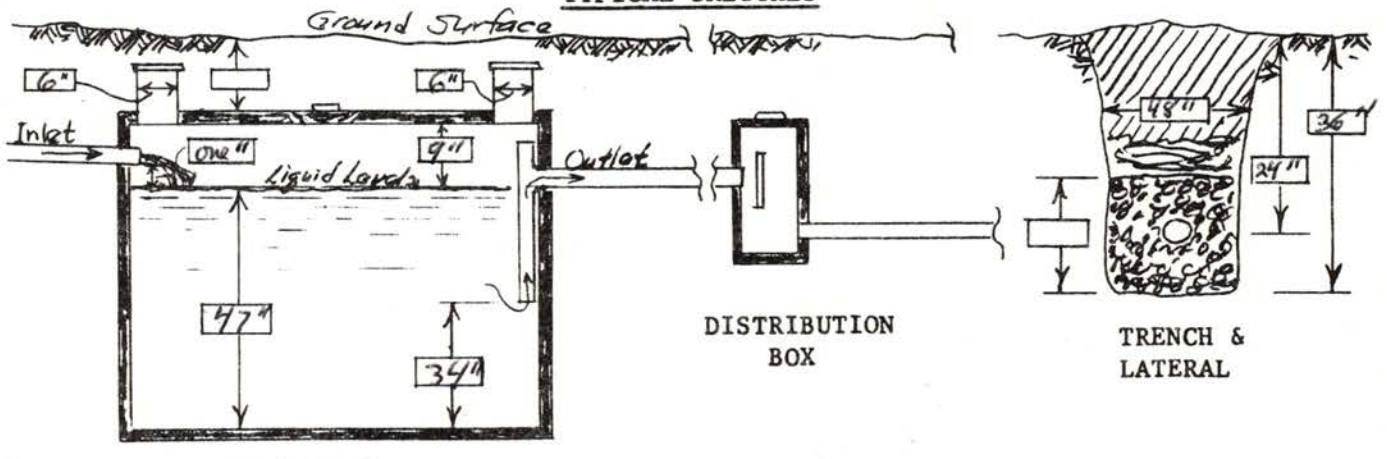


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

_____
Signature of Applicant

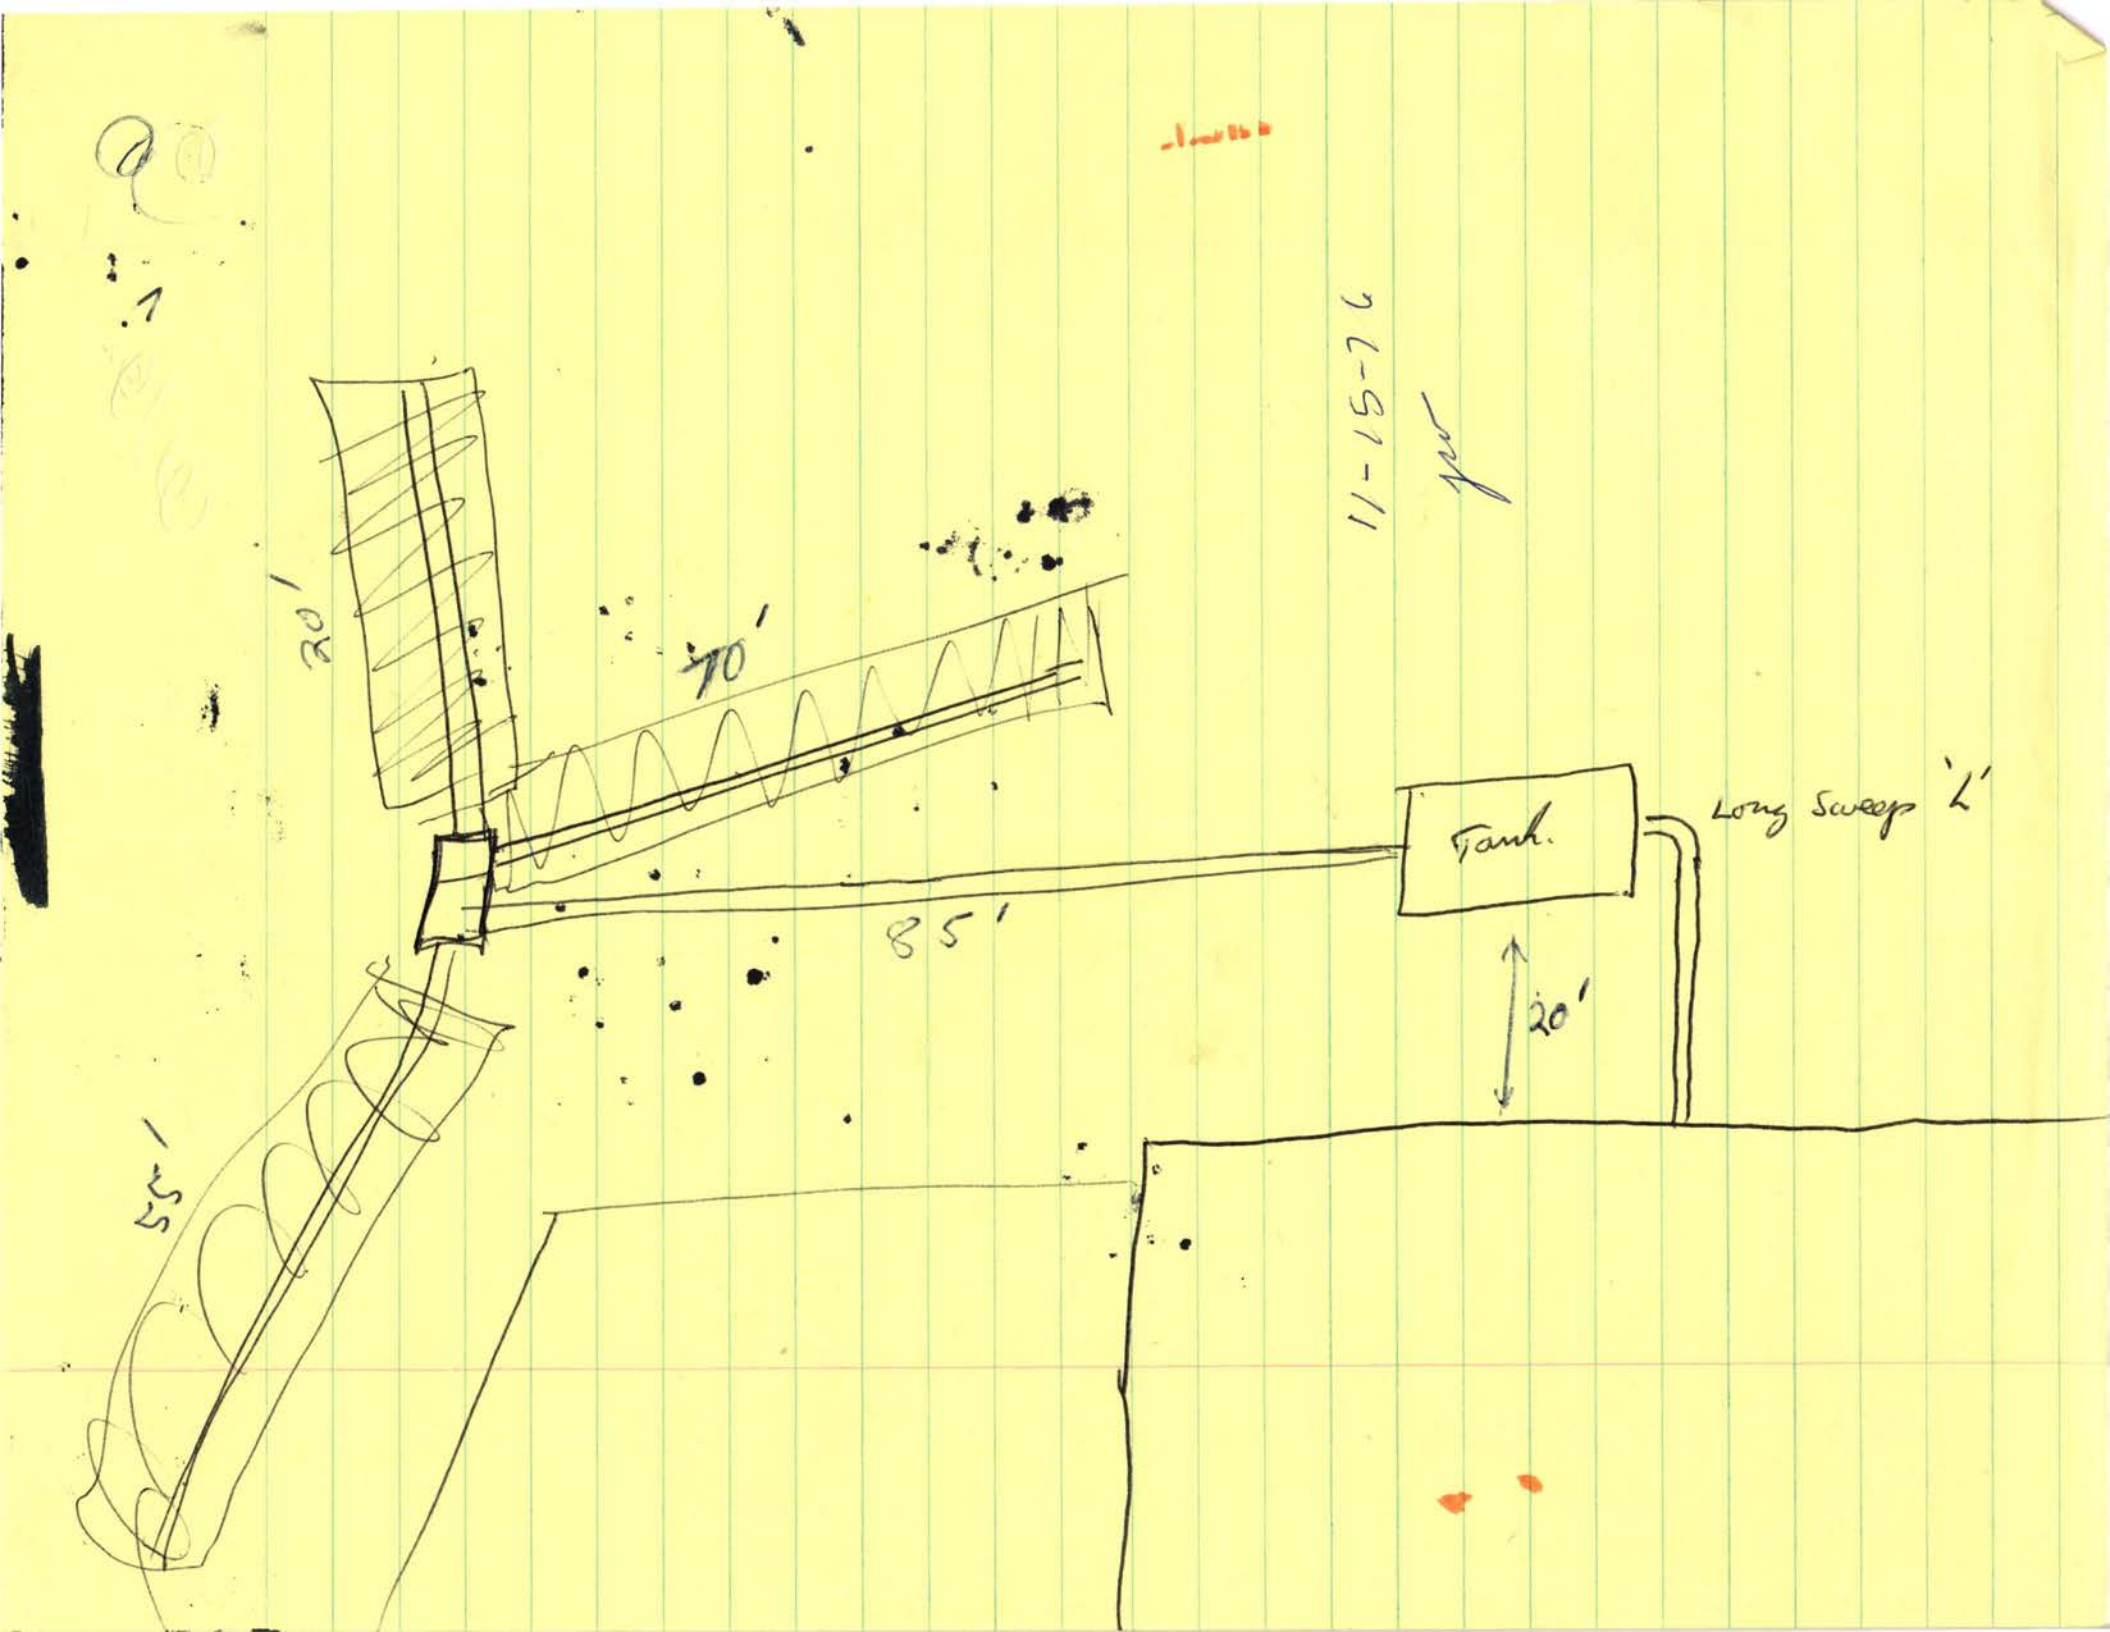
11-15-76
20'
70'
85'
Tank
Long Sweep 'L'
20'
55'