Lincoln-Lancaster County Health Department
ENVIRONMENTAL PUBLIC HEALTH DIVISION

005498

3140 N STREET · LINCOLN, NE 68510-1514

(402) 441-8000

Permit: SEWAGE SYSTEM REPAIR
SEWAGE REPAIR

Permit # 04390080001

Issued 09/15/04
Expires 03/15/05
Revenue Code 3157

Establishment:
DANA LONDON
T11N R5E SEC 33 QTR NW
10909 W HWY 34

FEES: $100.00

Permittee:
DANA LONDON
10909 W US HIGHWAY 34
LINCOLN NE 68524

TOTAL: $100.00

Bruce D. Dart

Bruce D. Dart, Health Director

EPH COPY

Individual Sewage Disposal System
Application to Alter, Extend or Repair

☐ Municipal Code 24.38 ☒ County Resolution Number 2832

Date: 9/13/04	File No.:

The undersigned hereby applies for a permit to: ☐ **ALTER** ☒ **EXTEND** ☐ **REPAIR** an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. **Legal description of property:**
   Township 11N Range 5E Section 33 1/4 Section NW
   Block _____ Lot 37 Addition _____
   Street Address 10909 HWY 34 WEST

2. **Property use:** ☑ residential ☐ commercial ☐ other use
   Number of bedrooms _____ Describe _____

3. **Type of Present Individual Disposal System:** ☑ septic tank ☐ lagoon ☐ other

4. **Description of proposed alteration, extension or repair:** TANK NEVER HAS BEEN PUMPED + PLUGGED EXISTING 4" PVC — INSTALLED 150 LF OF HI CAP INFILTRATOR + PUMPED TANK

5. **Work to be done by:** ☐ owner ☑ contractor's name DIRT WORKS PLUS INC

6. **Estimated project:** a. Repair, replace or minor extension with a cost of less than $400.00 (no fee required).
   b. Total cost is greater than $400.00 (Return fee with this application).
   c. A "construction permit" is required if the use, operation, location, or type of the system is being changed.

Print Name DANA LONDON Address 10909 W HWY 34 Phone _____
Applicant Signature (owner or lessee) Dana London % Stan Kluver

Please include the permit fee (~~$50.00~~ $100.00) with this application

(Please do not write below this line)

Date rec'd 9/15/04 REVIEW: ☒ approved ☐ disapproved By: Jerrold C. Hood


Site visits:
Date 9/14/04 By DS
Date _____ By _____
Date _____ By _____

Installation final written approval
Date 9/16/04 By Doug Snead

Return to: Lincoln-Lancaster County Health Department - Environmental Health Division
3140 "N" Street, Lincoln, NE. 68510
441-8022

White - EH Pink - Business Office Revised 1/98

09/15/04 #7172 $100.00

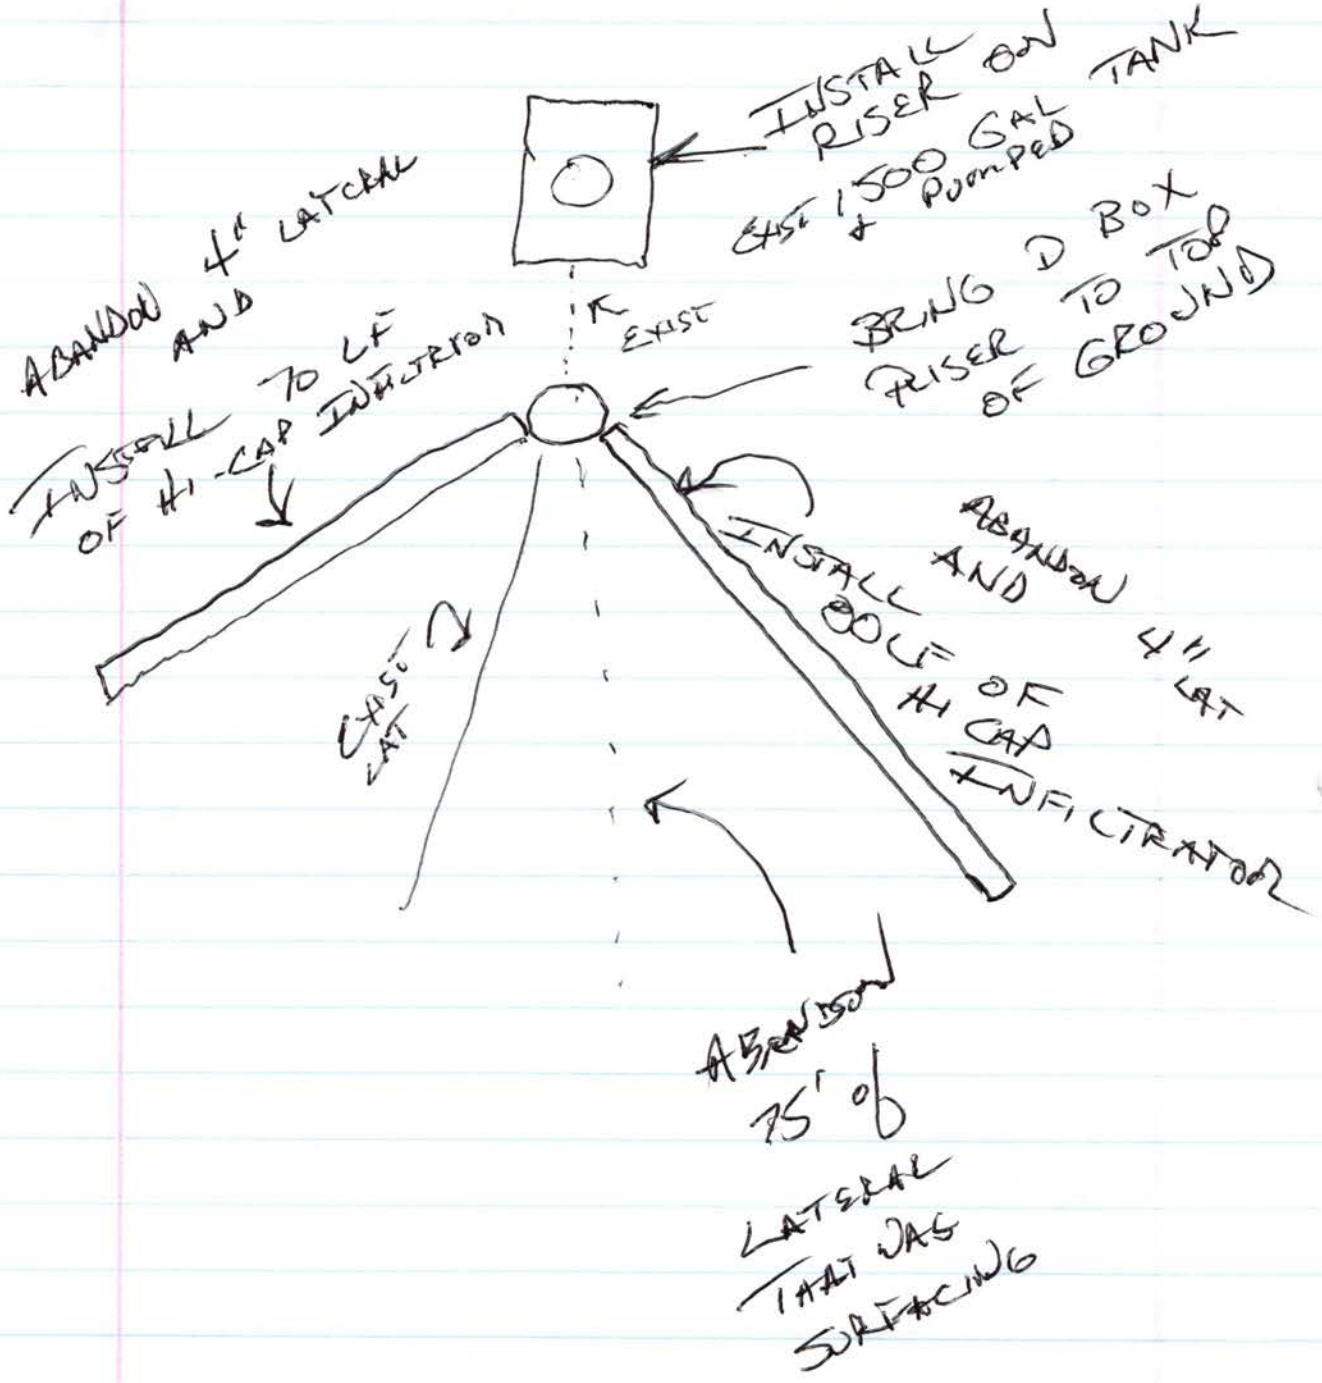

The tank was packed full (not pumped in 20+ yrs) - found that 4" perf lateral were plugged - So installed HI CAP INFILTRATOR