FILE NO. 531

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

March 26, 1975 — THIS LICENSE OR PERMIT EXPIRES

Leslie Burge — LICENSEE OR PERMITTEE

Route #2 — ADDRESS

T10N; R7E; Sec. 36-SW1/4 — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 531

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-25-74

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 7E ; Section 36
Block _____ ; Lot _____ ; Addition South West ¼ →
Street Address Route 2 Lincoln NE

2. Property Use: Residential _____ [X] ; Commercial _____ [ ]
No. of Bedrooms 2 . Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X] ; Other [ ]

4. Distance to public sewer: 1 mile ft.

Leslee Burge
Signature of Applicant (Owner, or Lessee)

R2 Lincoln N.E.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 9/26/74 . Date Frwd. 9/27/74 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Todd

2. Supt. Bldg. Insp.: Date Rec'd. 9-27-74 . Date Frwd. 9-27-74 . ACTION: Approved ☒ Disapproved ☐ Signature: Chas. Parks Williamson

3. City or County Engineer : Date Rec'd. 9-27-74 . Date Frwd. 9-27-74 . ACTION: Approved ☒ Disapproved ☐ Signature: Richard L. Robinson

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 531

DATE: 9-25-74

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N ; Range 7E ; Section 36 ; Block ; Lot ; Addition South West 1/4.
Street Address Lincoln Neb. R2.

2. Property Use: Residential [X]; Commercial [ ]
No. of Bedrooms 2
Describe:

Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Leslie Burge
Signature of Applicant (owner or lessee)

Route 2 Lincoln NE.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: Dec-6-74 by: rm
Date: by:
Date: by:

3. Date: Approved [X]; Disapproved [ ] 9/26/74
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: Dec-6-74 by: Ron Maynard

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 531

PROPERTY WHERE SOIL TESTED:
Location: Township 10 ; Range 7
Section & ¼ Sect. ____
Property Dimensions: 436 ft. x 744 ft. 243ft long at one place see map.
Area: 5.015 Net acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☒; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Leslie Burge
Address R2 Lincoln NE

Dates of Tests: 9-20-74 to 9-21-74. Weather: Precip. None Temp. 67°F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	32	9-20	12:30 PM	9-21	12:30 PM	9-21	5 PM	6	5:30	3	30	3	10-1
2	36	9-20	"	9-21	"	9-21	5 PM	6	5:30	2⅝	30	3⅜	8.5-1
3	32	9-20	"	9-21	"	9-21	5 PM	6	5:30	2¾	30	3¼	9-1
4	36	9-20	"	9-21	"	9-21	5 PM	6	5:30	2¾	30	3¼	9-1
5	32	9-20	"	9-21	"	9-21	5 PM	6	5:30	3	30	3	10-1
6	36	9-20	"	9-21	"	9-21	5 PM	6	5:30	2¾	30	3¼	9-1

Sum of Percolation Rates 55.5-6
Average of Rates: 9.2"-1
Mean of Rates:

Leslie Burge
Signature of Person Conducting Test

Address Route 2 Lincoln NE.
Phone: 488-8346

(Do not write below this line)

REVIEWING ACTION


REMARKS: _____

Approved Percolation Rate(s)
A. 9 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: September 26, 1974

Jerrold C. Hood
Signature of Reviewing Official

South

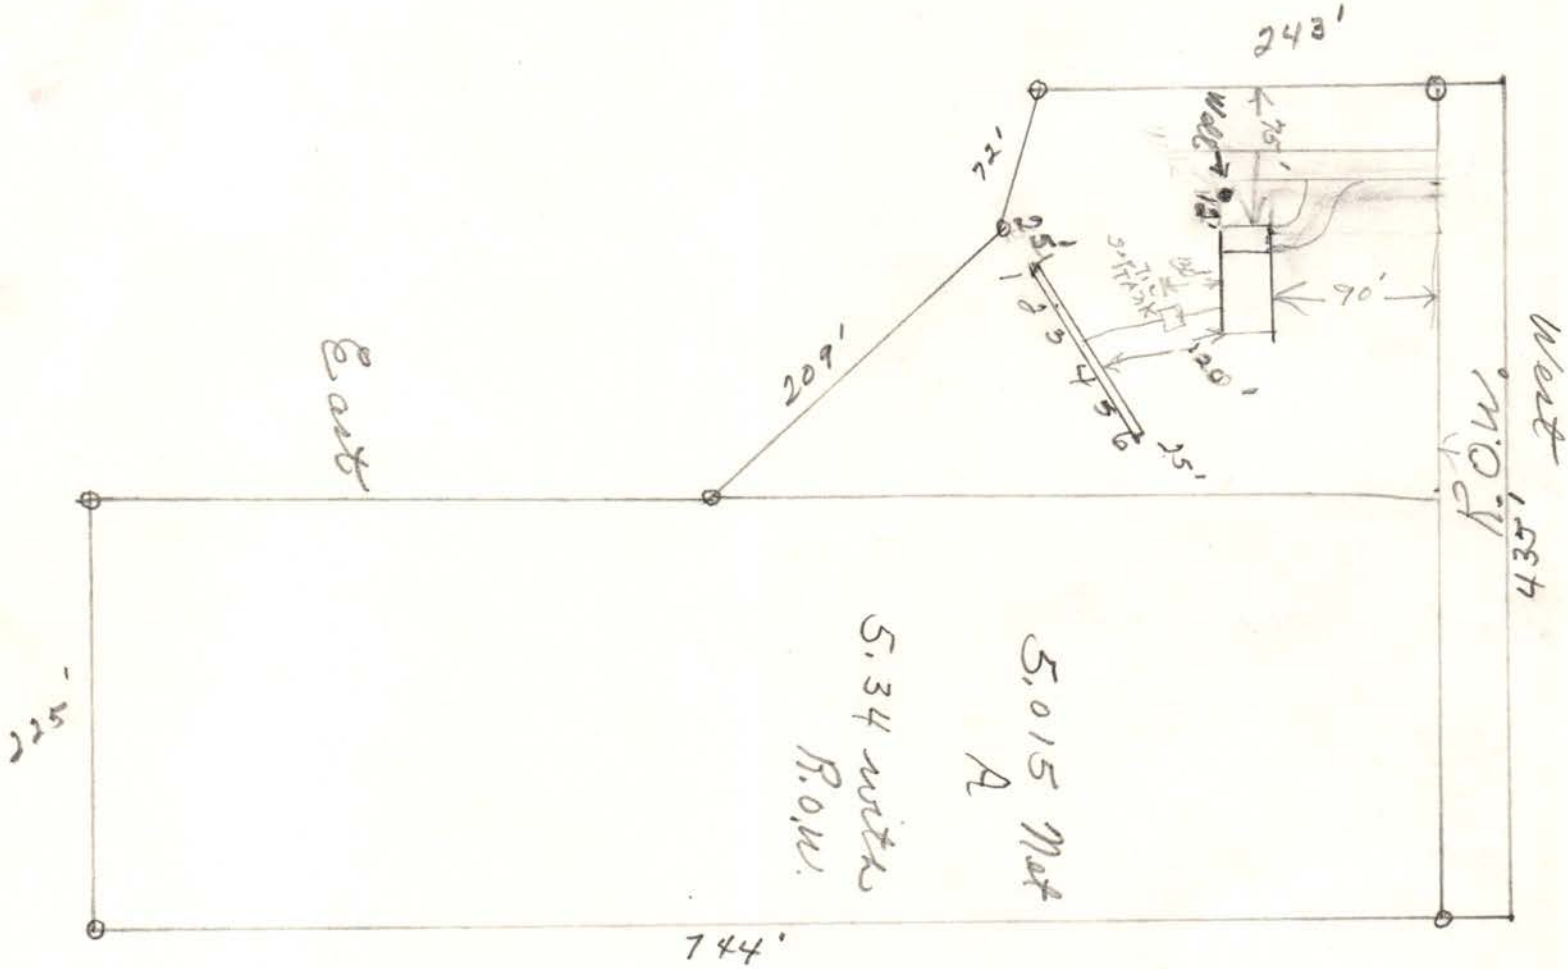

Leslie Burge

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 531

SPECIFICATIONS

DATE: Sept 25-74


A. BUILDING SEWER:
1. Material Cast Iron; Diameter ____ in.
2. Distance above basement floor ____ in.; or below basement floor 12 in.
3. Distance between dwelling and septic tank 30 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 50 ft.;
Stream 150 ft.; Pressure Line 24 ft.;
Property Line 110 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments ____.
2. Capacity 1000 gals.; Liquid depth ____ in.
3. Factory Built: Yes ☒ (Company Precast step see folder)
No ☐
4. Manholes: Over Inlet; diam. ____ in.
Over Outlet; diam. ____ in.
Below Grade ____ in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ____ in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 120 ft.;
Stream 50 ft.; Pressure Line 30 ft.;
Property Line 120 ft.


C. DISTRIBUTION BOX Use Precast see folder
1. Material Concrete; No. available outlets 2.
2. Factory Built: Yes ☒, (Company pre cast ____) No ☐
3. Dimension: Length 14 in.; Width 20 in. Depth 12 in.
4. Distance from Septic Tank 80 ft.
5. Serial Distribution: Yes ☒, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Pre cast
2. Lateral Lines: Depth below grade 18 in.
Number 2; Length of each line ____ ft
Total length of Laterals 106 ft.;
Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape tile
Material: concrete ☒; fiber asbestos ☐; clay ☐; other ____
Distance between lateral lines ____ ft.
3. Trench Dimensions: Depth 42 in.; Width 36 in.
4. Filter Material: Gravel.
Depth of material from trench bottom ____ in.
5. Distances To:
Well or Suction Line 120 ft.;
Stream 50 ft.; Pressure Line 100 ft.
Property Line 25 ft.
6. Percolation Rate: 9.2" minutes/inch

TYPICAL SKETCHES

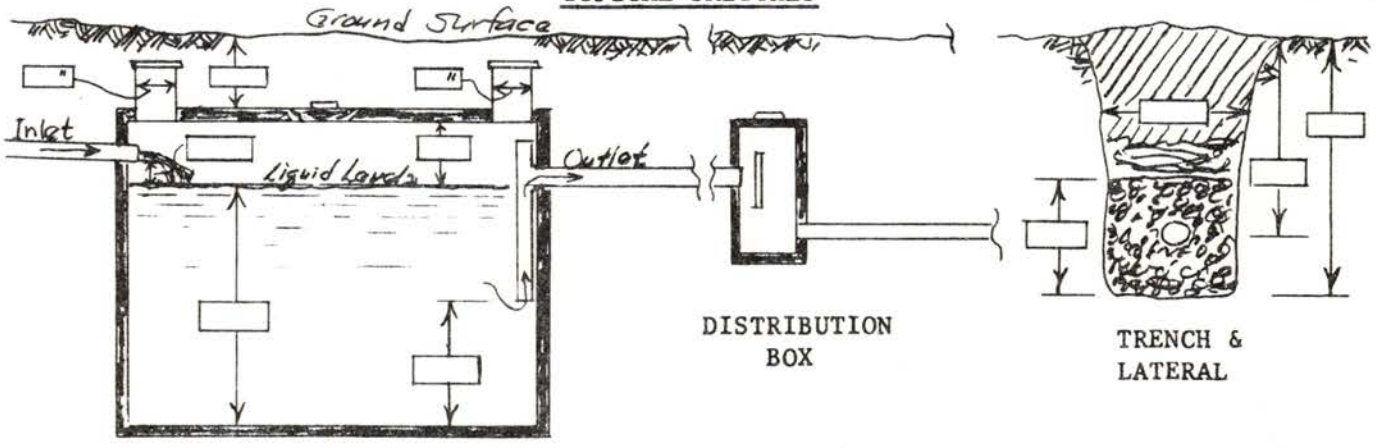

Signature of Applicant

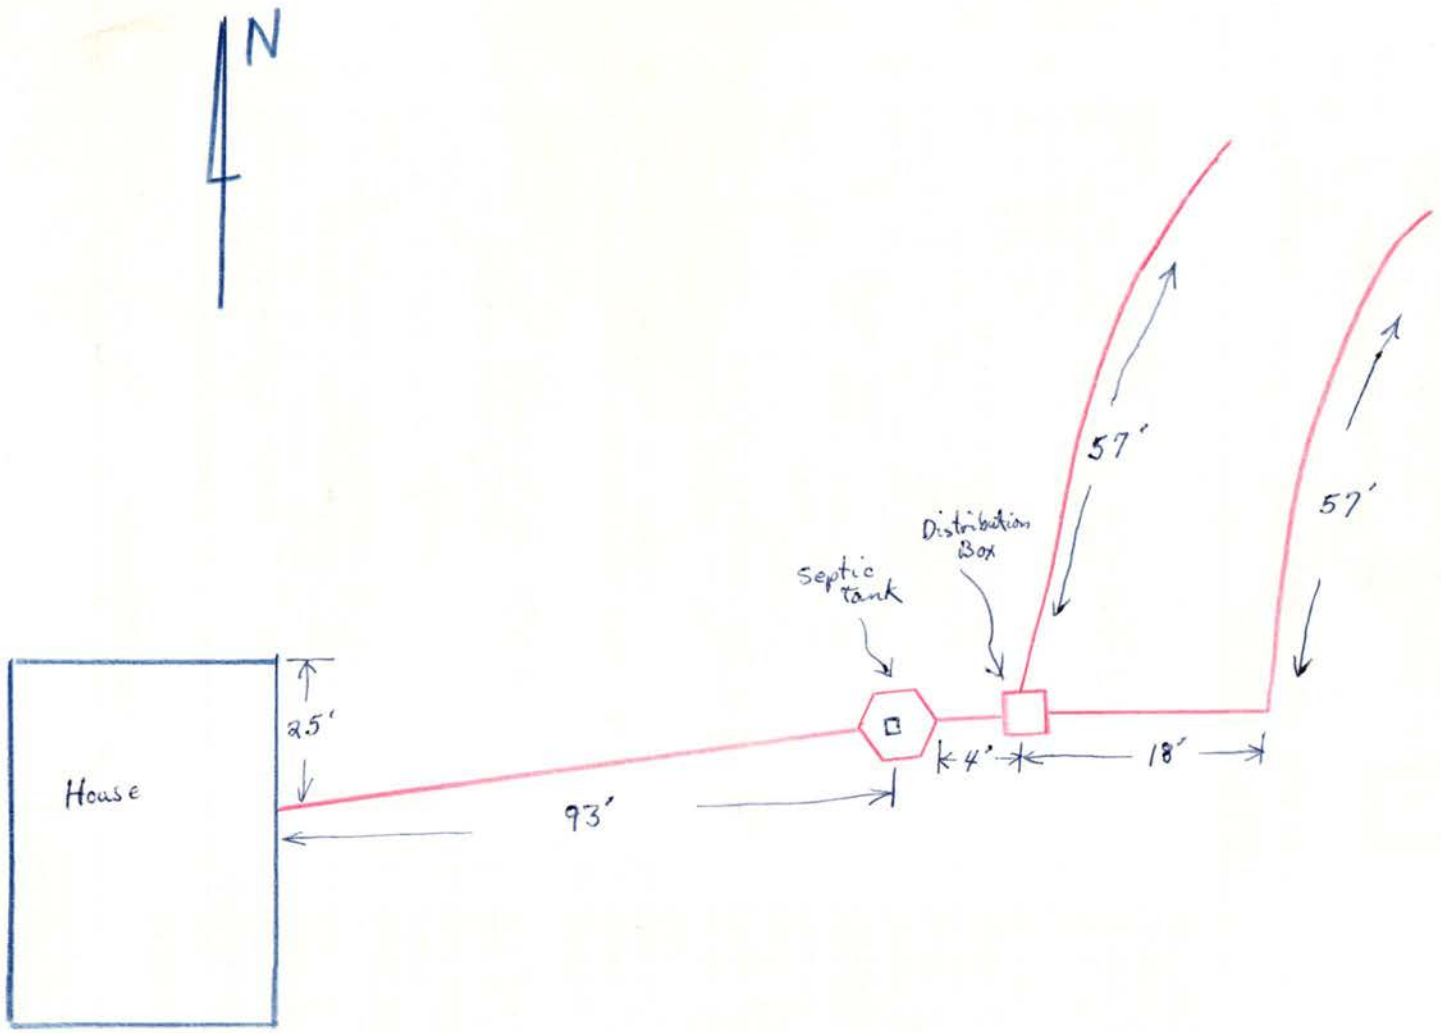

Dec-6-74

000420002

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

LCR 4307

Legal Description of Property: Street Address 2700 So. 98th

Twp 10N Range 7E Section 36 1/4 SW 1/4 Block ___ Lot 71 Addition ___

Directions to Property 1 Blk North of 98th & Van Dorn

Location of Well South of Home Tap Location: Inside ☐ Outside ☒

Location of Sewage System Septic is 90' East and 6' North of Home Year Installed 1975

	NAME	ADDRESS	PHONE
Present Owner:	Leslie & Florence Burge	2700 So. 98th 68520-9478	488-8396
Tenant/Buyer:	Craig Hundt	10121 Van Dorn	474-2000-W 483-1057-H
Return to:	Carol Hutson	7211 So 27 Lincoln, Ne 68516	430-8222

Signature of Applicant [signature] Address 10120 Van Dorn Date 4/3/00

HEALTH DEPARTMENT USE ONLY

RECEIVED

Date 4/3/00

Initials [illegible]

Amount 150.00 ✓

Check No. 3390 ✓

DATA ENTRY

Date ___/___/___

Case No. ___

Initials ___

PRELIMINARY STATUS--By John J Chess **DATE:** 4/11/2000

hydrant removed

WATER SYSTEM:	Approved	Disapproved
Construction	☐ 4-17	☒
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ 1.2 ppm	☐ ___ ppm

SEWAGE SYSTEM

Approved ☒

Provisional ☐

Disapproved ☐

Additional Site Visits

Date 4/17/00 by JK

Date ___/___/___ by ___

Date ___/___/___ by ___

Comments: hydrant is too close to the well. If the septic tank has not been pumped recently it should be checked to see if it is necessary

See Attached Letter ☒

FINAL STATUS NOT 4-11-00

WATER SYSTEM: Approved ☒ 4-17 **SEWAGE DISPOSAL SYSTEM:** Approved ☒ Provisional Approval ☐

Approved by John Chess Date 4/19/00

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95