FILE NO. 349

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

February 20, 1974 — THIS LICENSE OR PERMIT EXPIRES

Ron Williams — LICENSEE OR PERMITTEE

6341 Starr — ADDRESS

T10N; R8E; Sec. 18; Block 2; Lot 1 — NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 349

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 8E; Section 18;
Block 2; Lot ~~1,2,3,4~~ Out; Addition _____;
Street Address W Larson out dirm Lancaster Co.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bedrooms ~~1~~ 2. Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: _____ ft.

Ron Williams by Roger Bailey
Signature of Applicant (owner or lessee)

6341 Stars
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/17/73. ACTION: Approved [ ] Disapproved [X]
Date Frwd. 8/20/73. Signature: Jerrold C. Hoak

2. Supt. Bldg. Insp.: Date Rec'd. 8/20/73. ACTION: Approved [ ] Disapproved [X]
Date Frwd. _____. Signature: Charles Seale By C.G.

3. City Engineer: Date Rec'd. 8/20/73. ACTION: Approved [ ] Disapproved [X]
Date Frwd. _____. Signature: Ken Smith

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 349

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 8E; Section 18;
Block 2; Lot 1; Addition Olsen's Lancaster Co. Township Division
Street Address _____.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 2 Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Ron Williams by Roger Briney
Signature of Applicant (owner or lessee)

6341 Starr.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: _____ by: _____
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 8/20/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 1/14/74 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION
TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 349

PROPERTY WHERE SOIL TESTED:
Location: Township 10N 8E
Section & ¼ Sect. 18
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☒; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Ron Williams
Address 6341 Starr

Dates of Tests: Aug 15 to Aug 16. Weather: Precip. ____ Temp. 70 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	15		16		16	8		9:30		1:30	1½	
2												1½	
3												1½	
4												2	
5												2	
6												1	
												4½	

Signature of Person Conducting Test

Address 4131 C L F Ford Dr
Phone: _____

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

one hour and thirty min
1½

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 60 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: August 17, 1973

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 349

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor ___in.
3. Distance between dwelling and septic tank 114½ ft.
4. Number of clean-outs 2.
5. Distances To:
Well or Suction Line 50 ft.;
Stream — ft.; Pressure Line — ft.;
Property Line — ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiber; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ___in.
3. Factory Built: Yes ☒ (Company CORRUGATED FIBERGLASS) No ☐
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. ___in.
Below Grade ___in.
5. Inlet: Baffle ☒; or Tee ☐
6. Outlet: Baffle ☒; or Tee ☐
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ___in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.


C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 5 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Half Round
2. Lateral Lines: Depth below grade ___in.
Number 2; Length of each line 100 ft
Total length of Laterals ~~200~~ 100 ft.; +70
Slope 4 in/100 ft. Diameter of pipe 12 in.; Shape —
Material: concrete ☐; fiber asbestos ☐; clay ☐; other ___
Distance between lateral lines ___ft.
3. Trench Dimensions: Depth 48 in.; Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 20 in.
5. Distances To:
Well or Suction Line 100+ ft.;
Stream — ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: 60 minutes/inch

TYPICAL SKETCHES

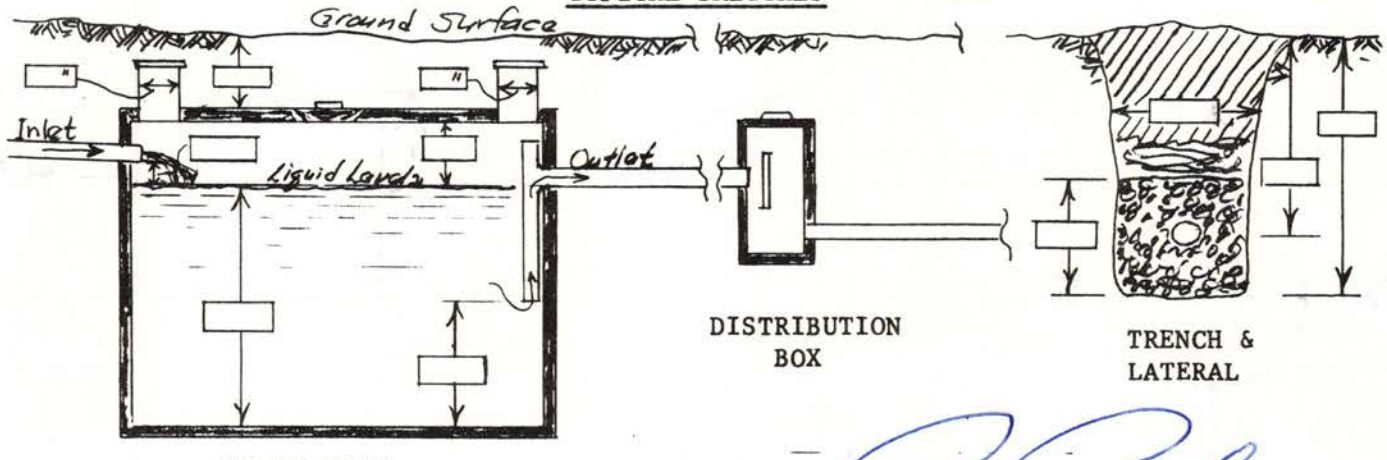

Roy Bailey
Signature of Applicant

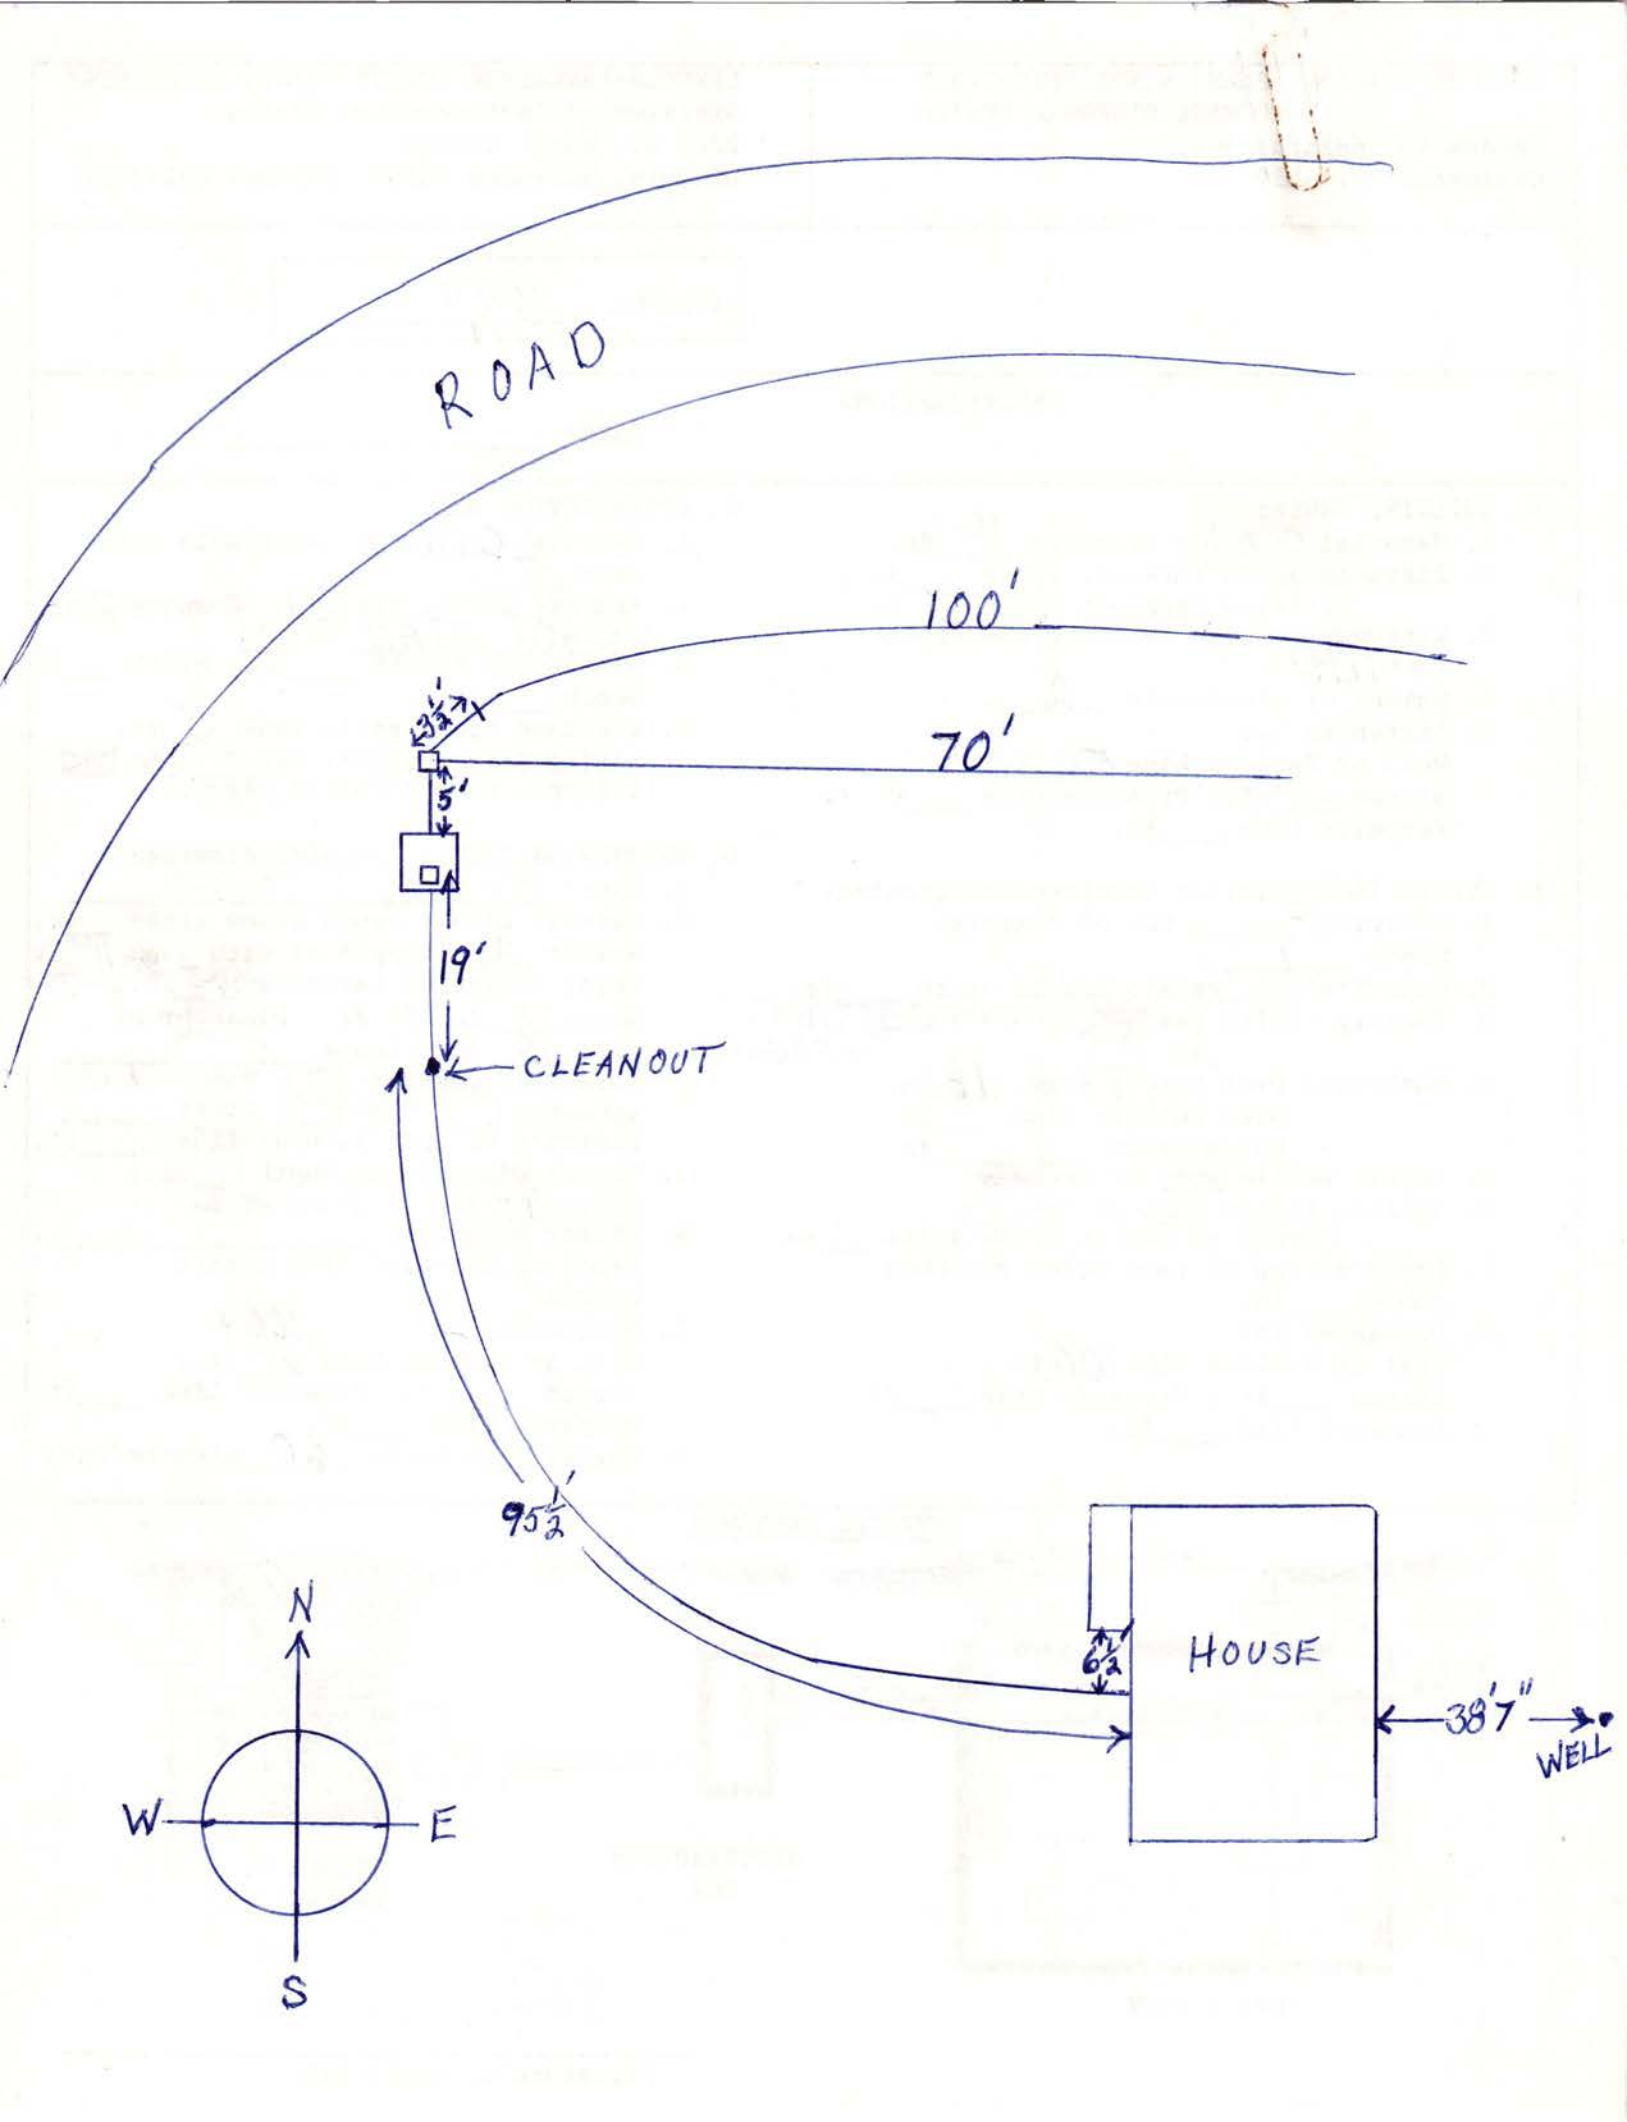
ROAD
100'
70'
3½'
5'
19'
CLEANOUT
95½'
6½
HOUSE
38'7"
WELL
N
W
E
S