FILE NO. 306

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

April 12, 1972 — THIS LICENSE OR PERMIT EXPIRES

Bouwens Plumbing — LICENSEE OR PERMITTEE

2300 South 62nd — ADDRESS

NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION

T10N; R8E; Sec. 18; Lot 4; Bl. 3; Al Larson subdivision SE1/4 of SE1/4 of Sec. 18. — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1335 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

APPLICATION

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

INTER-DEPARTMENT COMMUNICATION

TO: Charles Seale

DEPARTMENT: Building Inspections

ATTENTION:

CARBONS TO:

DATE: October 12, 1972

FROM: Jerrold C. Hood

DEPARTMENT: Health

SUBJECT: Individual Sewage System Construction
File No. 306
Bouwens Plumbing Co.
2300 South 62nd

The application and plans have been reviewed and approved for the construction of an individual sewage disposal system on property legally described as:

T10N; R8E; Sec. 18; Lot 4; Bl. 3; Al Larson Subdivision
SE 1/4 of SE 1/4 of Section 18.

Jerrold C. Hood, R. S., Chief
Section of General Sanitation
Division of Environmental Health

JCH: ch

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 306

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 8; Section 18;
Block 3; Lot 4; Addition N. Lancaster Subdivision
Street Address SE¼ of SE¼ of Section 18

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bedrooms 3. Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: ____ ft.

Brewers Plumbing
Signature of Applicant (owner or lessee)

2300 So 62nd
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/12/72. Date Frwd. 10/16/72.
ACTION: Approved ____ [X] Disapproved [ ]
Signature: Jerrold C. Wood

2. Supt. Bldg. Insp.: Date Rec'd. 10-16-72. Date Frwd. 10-16-72.
ACTION: Approved ____ [X] Disapproved [ ]
Signature: Chas Seale By E.S.

3. City Engineer: Date Rec'd. 10-16-72. Date Frwd. ".
ACTION: Approved ____ [X] Disapproved [ ]
Signature: J. L. Blessing

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 306

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 8E; Section 18;
Block 3; Lot ~~4~~; Addition Acreage outlying
Street Address ~~_____~~ SE¼ of SE¼ of Section 18

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 3 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Burnett Plumbing
Signature of Applicant (owner or lessee)

2300 So 62nd
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 10/13/72 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 10/12/72
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 10/13/72 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 306

PROPERTY WHERE SOIL TESTED:
Location: Township 10 N Range 8
Section & ¼ Sect. 18
Property Dimensions: 410 ft. x 351.5 ft.
Area: 3½ acres. (Attach sketch of property showing hole location).

Owner: Dale Stumbel
Address Country

Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☒

Dates of Tests: 9-9-72 to 9-10-72. Weather: Precip Cloudy Temp. 80 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	34	9/9	1330 PM	9/10	1200 PM	9/10	1230 PM	12"	230 PM	11¾"	30 Min	1¼	34
2	"	"	"	"	"	"	"	"	"		"	"	1
3	"	"	"	"	"	"	"	"	"		"	"	1
4	"	"	"	"	"	"	"	"	"		"	"	1
5	"	"	"	"	"	"	"	"	"		"	1¼	34
6	"	"	"	"	"	"	"	"	"		"	"	1
											"	1¼	34

Brewer Plumbing
Signature of Person Conducting Test

Address 2300 So 62nd
Phone: 489-5330

Sum of Percolation Rates
Average of Rates:
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS:

Approved Percolation Rate(s)
A. 34 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: October 12, 1972

Jerrold C. Wood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 306

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material CAST IRON; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 10 in.
3. Distance between dwelling and septic tank 69 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 200 ft.;
Stream — ft.; Pressure Line 100 ft.;
Property Line — ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CON.; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ___ in.
3. Factory Built: Yes ☒ (Company PRE-CAST STEP)
No ☐
4. Manholes: Over Inlet; diam. ___ in.
Over Outlet; diam. ___ in.
Below Grade ___ in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade ___ in.
8. Distances To:
Well or Suction Line 200 ft.;
Stream — ft.; Pressure Line — ft.;
Property Line — ft.

C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___ in.; Width ___ in.
Depth ___ in.
4. Distance from Septic Tank 6'3" ft.
5. Serial Distribution: Yes ☐, No ☒
(If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF ROUND
2. Lateral Lines: Depth below grade ___ in.
Number 2; Length of each line 100 ft
Total length of Laterals 200 ft.;
Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape O
Material: concrete ☒; fiber asbestos ☐; clay ☐; other ___
Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth 48 in.;
Width 60 in.
4. Filter Material: GRAVEL.
Depth of material from trench bottom ___ in.
5. Distances To:
Well or Suction Line 250 ft.;
Stream — ft.; Pressure Line — ft.
Property Line 201 ft.
6. Percolation Rate: ___ minutes/inch

TYPICAL SKETCHES

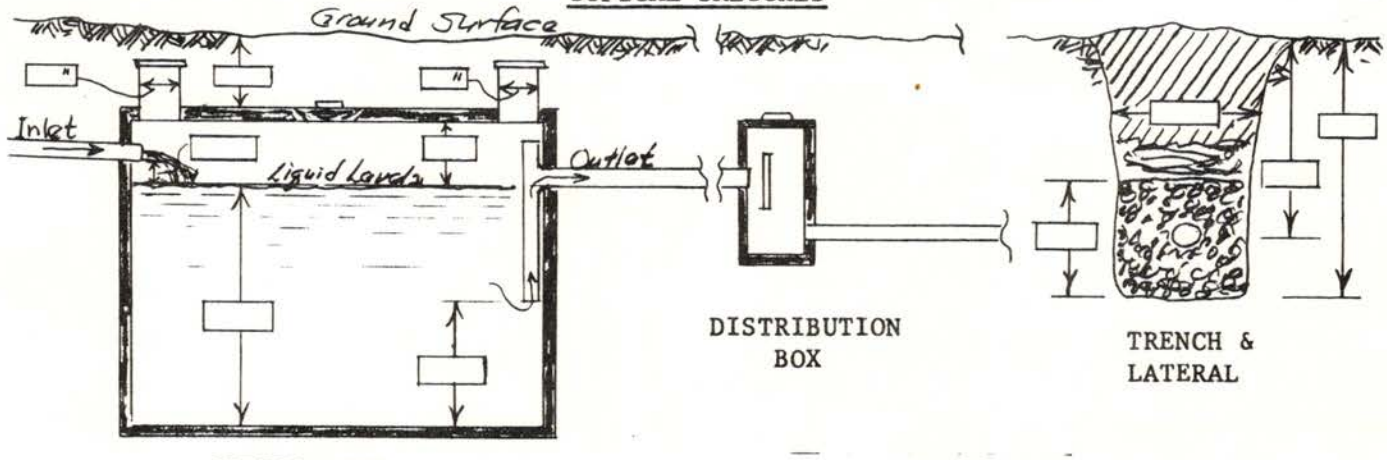

SEPTIC TANK

Signature of Applicant

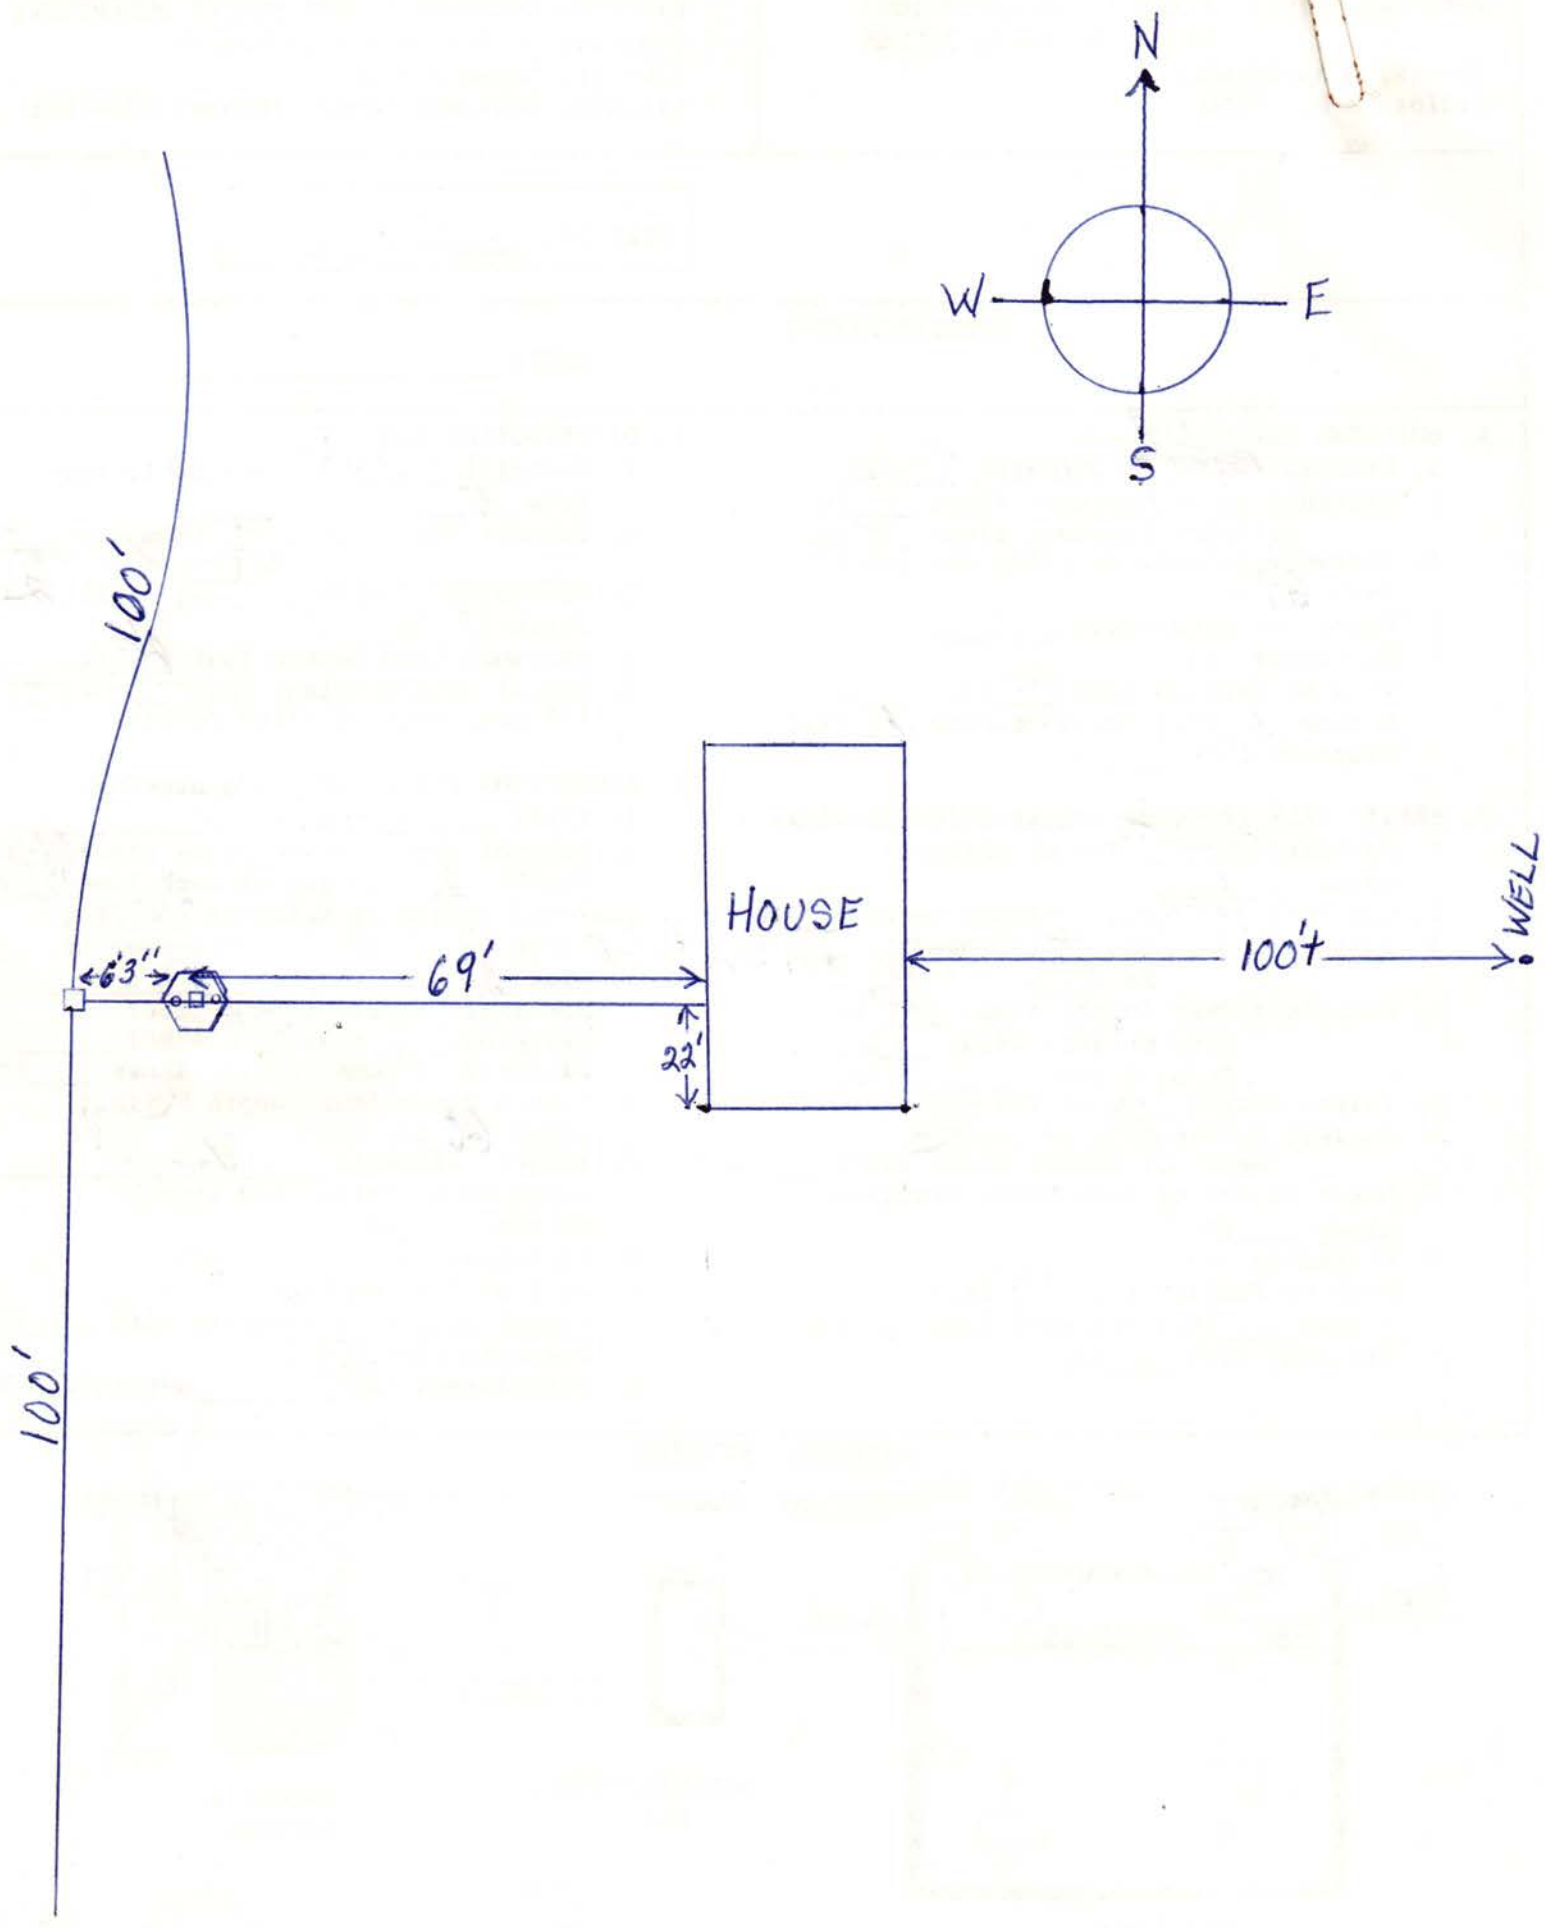
N
W
E
S
100'
HOUSE
WELL
6'3"
69'
100'
22'
100'