FILE #2466

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

SEPTEMBER 26, 1987 — THIS LICENSE OR PERMIT EXPIRES

STEVEN DAGLEY — LICENSEE OR PERMITTEE

ROUTE #13 LINCOLN, NE 68527 — ADDRESS

TION: R8E; Sec S½ 18; Blk 1; Lot 2; Gary Court — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. Date and Amount

APPLICATION

AHEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2466

DATE: March 25, 1987

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 8E ; Section 5½ 18;
   Block 1 : Lot 2 : Addition Dagley Replat
   Street Address Gary Ct

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☐

4. Distance to public sewer: _____ ft.

Steven Dagley
Signature of Applicant (Owner or Lessee)

Rt 1 3 Lincoln, NE
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 3/25/87. Date Frwd. 3/26/87. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nodd

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 3/26/87. Date Frwd. 3/26/87. ACTION: Approved ☒ Disapproved ☐ Signature: Gary N Stewart

3. City or County Engineer: Date Rec'd. 3/26/87. Date Frwd. 3/26/87. ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL EXISTING WELL

Site Visits:
Date: 9-11-87 by: RM
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 9-11-87 By: Ron Maynard

FORM 23-43

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

CITY OF LINCOLN
RECEIVED
JAN 14 1977
PLANNING DEPARTMENT

FILE NO. 2466

PROPERTY WHERE SOIL TESTED: Lot 2, Dagley Replat

Owner: DG Dagley

Location: Township 10N ; Range 8
Section & ¼ Sect. S½ 18

Address 120 Gaslight Circle

Property Dimensions: 520 ft. x 250 ft.
Area: 3+ acres. (Attach sketch of property showing hole location).

Soil Type: Silty Clay ☐; Silty Clay Loam ☒; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 8-6-76 to 8-7-76. Weather: Precip. 0 Temp. 80's

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	20	8/6	5:30	8/6	10:00	8/7	4:00	6	8:18	4 3/8	30	7/8	34.29
2	18	8/6	5:30	8/6	10:00	8/7	4:00	6	8:19	4 3/4	30	5/8	48.00
3	19	8/6	5:30	8/6	10:00	8/7	4:00	6	8:19	4 3/8	30	7/8	34.29
4	24	8/6	5:30	8/6	10:00	8/7	4:00	6	8:20	4 5/8	30	3/4	40.00
5	21	8/6	5:30	8/6	10:00	8/7	4:00	6	8:21	4	30	1	30.00
6	22	8/6	5:30	8/6	10:00	8/7	4:00	6	8:21	4 3/8	30	3/4	40.00

Sum of Percolation Rates 226.58
Average of Rates: 37.75
Mean of Rates:

Steven Dagley
Signature of Person Conducting Test

Address 120 Gaslight Circle
Phone: 477-3312

(Do not write below this line)

REVIEWING ACTION

REMARKS:

Approved Percolation Rate(s)
A. 37 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: August 11, 1976

Gerald C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. 2466

Indicate on sketch if residence and well are exisiting or proposed.

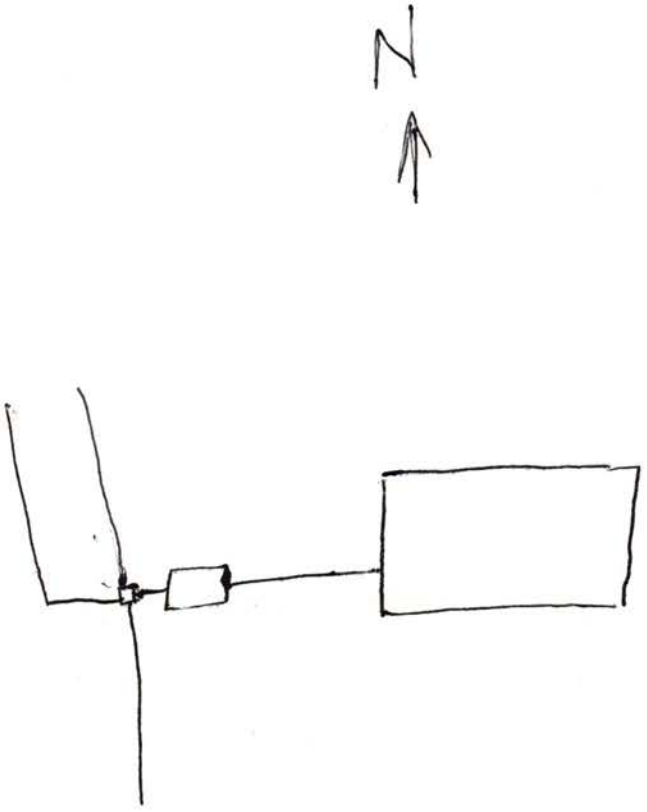

Well off drawing to west.

REVIEWING ACTION

Remarks: _____


Date: MARCH 25, 1987

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals 208 ft.
3. With a Trench Width of 48 in.
4. Total Area of Lateral needed 832 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

9-11-87

Larry Schwaneh

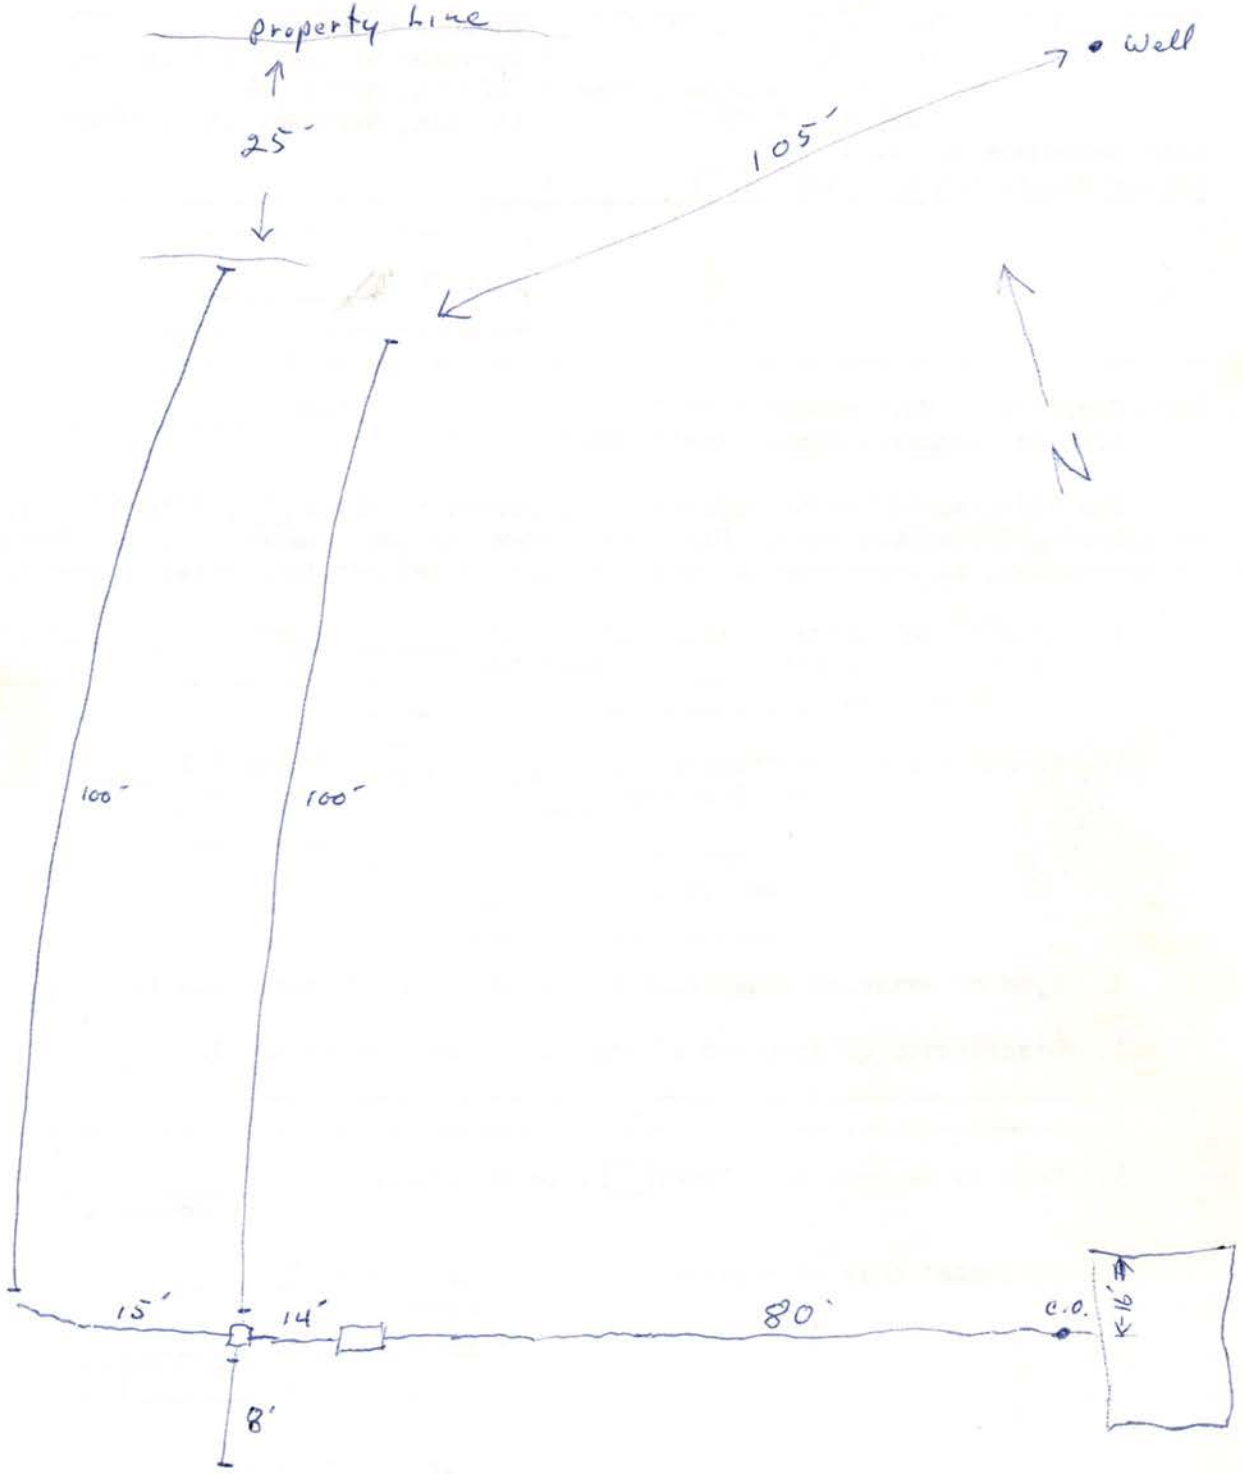

208' x 4' wide
Concrete ½ moon Lateral
1500 gal precast tank.

003

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☐ Evaluation of the Individual Water System Date: 12-24-92

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 10N; RANGE 7E; SECTION 18; BLOCK ____

LOT 2; ADDITION Dagley Replat; Street Address 11701 Gary Ct

Directions to Property 2¼ East of 84 on Holdrege, turn North on Dixie Trail, turn North on Gary Ct

Location of Well N/A Tap Location: Inside ☐ Outside ☐

Location of Sewage System Approx 100' West of N.W. corner of house Year Installed 1987

	NAME	ADDRESS	PHONE
Present Owner:	Steve Dagley	11701 Gary Ct	488-5791
Tenant/Buyer:	Charles Curtiss	600 N 86 68505 68506	483-1710
Return to:	Century Realty Attention Jeanne	2855 So 70 Lincoln, Ne	483 2951

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Charles Curtiss Address 600 N 86 Lincoln

==========

HEALTH DEPARTMENT USE ONLY

Date Received 12/29/92 Received $150.00 Check ☒ Cash ☐

#5771 D. Valley Bank

PRELIMINARY STATUS--DATE 1-4-93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☐ Not applicable	☐	Approved:	☐	Date 1-4-93 by [illegible]
Bacteria	☐	☐	Provisional:	☐	Date _____ by ____
Nitrate	☐	☐	Disapproved:	☐	Date _____ by ____

RWD

Comments: Recommend checking the septic tank to see if it needs pumping. Must properly abandoned old unused, plastic-cased well on west side of property as soon as weather permits or by April 1, 1993 See Attached Letter ☐

FINAL STATUS Public Water Supply

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☐	Approved: ☒	Provisional Approval: ☐

APPROVED BY Ron Mergaret RS DATE 1-5-93

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832