LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit

SEWAGE INSTALLATION

No. 95380128701

Issued 04/03/95
Expires 10/03/95
Revenue Code 18754

Establishment

LARRY SEMIN
T10N R8E SEC 22
LOT 32

FEES: $150.00

TOTAL $150.00

Permittee

LARRY SEMIN
5901 ROBIN CT
LINCOLN NE 68516

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $_____

FILE NO. _____

DATE: 1-25-95

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10 N ; Range 8 E ; Section 22 ; E ½, NW ¼
   Block _____ : Lot 32 I.T. : Addition _____
   Street Address 5101 PLUMBRIDGE ROAD
2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe SINGLE FAMILY RESIDENCE 1½ STORY 3 BRM
3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐
4. Distance to public sewer: _____ ft. experimental System

Larry E Semin
Signature of Applicant (Owner or Lessee)

5901 ROBIN COURT
LINCOLN, NE. 68516
Address

421-1769
432-1944 MOBILE

(Do not write below this double line)

1. Health Department: Date Rec'd. 3/31/95. Date Frwd. 4/3/95. ACTION: Approved ☒ Disapproved ☐ Signature: Gerald C. Hood
2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. _____. Date Frwd. 4/3/95. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]
3. City or County Engineer: Date Rec'd. 4-3-95. Date Frwd. 4-3-95. ACTION: Approved ☐ Disapproved ☐ Signature: Larry V. Worrell

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 3-31-95 by: [illegible]
Date: 8-25-95 by: [illegible]
Date: _____ by: _____

PROVISIONAL
INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 8-31-95 By: Ron Maynard

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D
AUG 29 1995

DATE: _____

FILE NO. _____

SPECIFICATIONS AS BUILT


A. BUILDING SEWER:
1. Material C class 160; Diameter 4" in.
2. Distance above basement floor _____ in., or below basement floor 14 in.
3. Distance between dwelling and septic tank 66 ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material Precast; No. of compartments _____.
2. Capacity 1250 gals.;
3. Factory Built: Yes ☒ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade ____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade 10 in.
8. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material Precast; Number - available outlets _____.
2. Factory Built: Yes ☐ No ☐
(Company _____)
3. Distance from Septic Tank 19 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or Perforated Pipe _____.
Material: fiberglass ☐ ; plastic ☐ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 2; Length of each line 125, 50, _____, _____, _____ ft.;
Total length of laterals 175 ft.;
Distance between lateral lines _____ ft.
3. Trench dimensions: Width 9½ ft.;
Slope — in/100 ft.; Average Depth 38 in.
4. Filter Material: Road Gravel
Depth of Material 24" in.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

Experimental
350' perf pipe

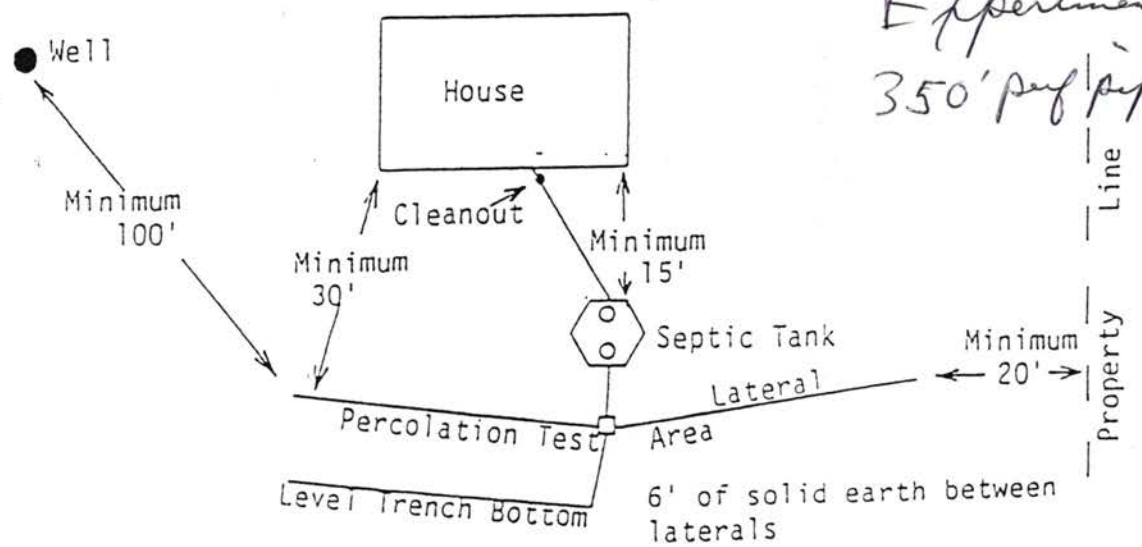


TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

Larry Schwenk

Aug 25-95

N

15101 Plum Ridge Rd

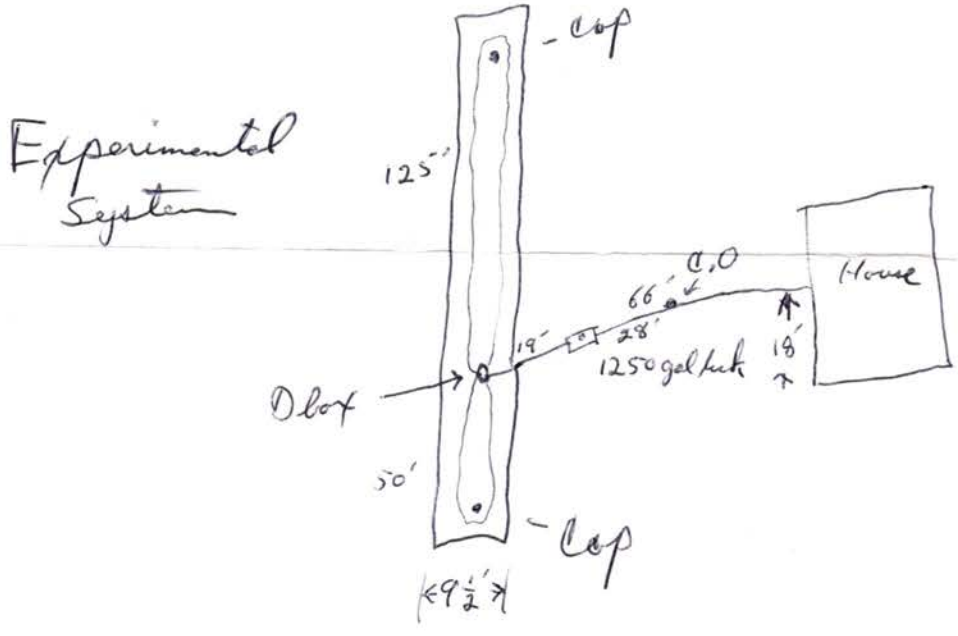

LANCASTER COUNTY, NEBRASKA — SHEET NUMBER 32

