LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

P E R M I T

Permit
SEWAGE INSTALLATION

No. 94380119501

Issued 07/13/94
Expires 01/13/95
Revenue Code 18754

Establishment
RHONDA SCHWARZENBACH
T10N R8E SEC 24
LOT 24
1001 N 190 STREET

FEES: $150.00

TOTAL $150.00

Permittee
RHONDA SCHWARZENBACH
1001 N 190 ST
LINCOLN NE 68527

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
~~2200 St. Marys Avenue~~ 3140 "N" St.
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: _____

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 8E ; Section 24 ;
   Block _____ : Lot 24 IT ; Addition _____
   Street Address 1001 N 190 th

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☐

4. Distance to public sewer: miles ft.

_____
Signature of Applicant (Owner or Lessee)

1001 N 190 th
Address (Steve Farm 486-5000 ask for Rhonda Schwarzenbach)

(Do not write below this double line)

1. Health Department: Date Rec'd. 7/13/94. Date Frwd. 7/13/94.
   ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 7/14/94. Date Frwd. 7/13/94.
   ACTION: Approved ☒ Disapproved ☐ Signature: Ray Spin

3. City or County Engineer: Date Rec'd. 07/13/94. Date Frwd. _____.
   ACTION: Approved ☒ Disapproved ☐ Signature: Ron Wagner

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 6-16-94 by: rm
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 7-13-94 By: Ron Wagner

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

RECEIVED JUN 27 1994 No 98-25 mitch Schwarzenbach

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township _____; Range _____; Section & ¼ Section _____.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 6-5 to 6-6-94. Weather: Precip. — Temp. 85.

OWNER: _____

Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	30	6-5	~~6~~	6-6	7:15	6-6	8:45	12	9:15	13 ¼	30	1 ¼	
2			4:00					9		10 ½		1 ½	
3								8 ⅞		9 ⅞		1	
4								10 ¼		12		1 ¾	
5								11 ½		13 ½		2	
6								10 ⅛		11 ¼		1 ⅛	

Larry Schwarck
Signature of Person Conducting Test

Address 8200 old Cheney Rd Phone 489-7294

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____


(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date: July 13, 1994

Approved Percolation Rate (a)
A. 21 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

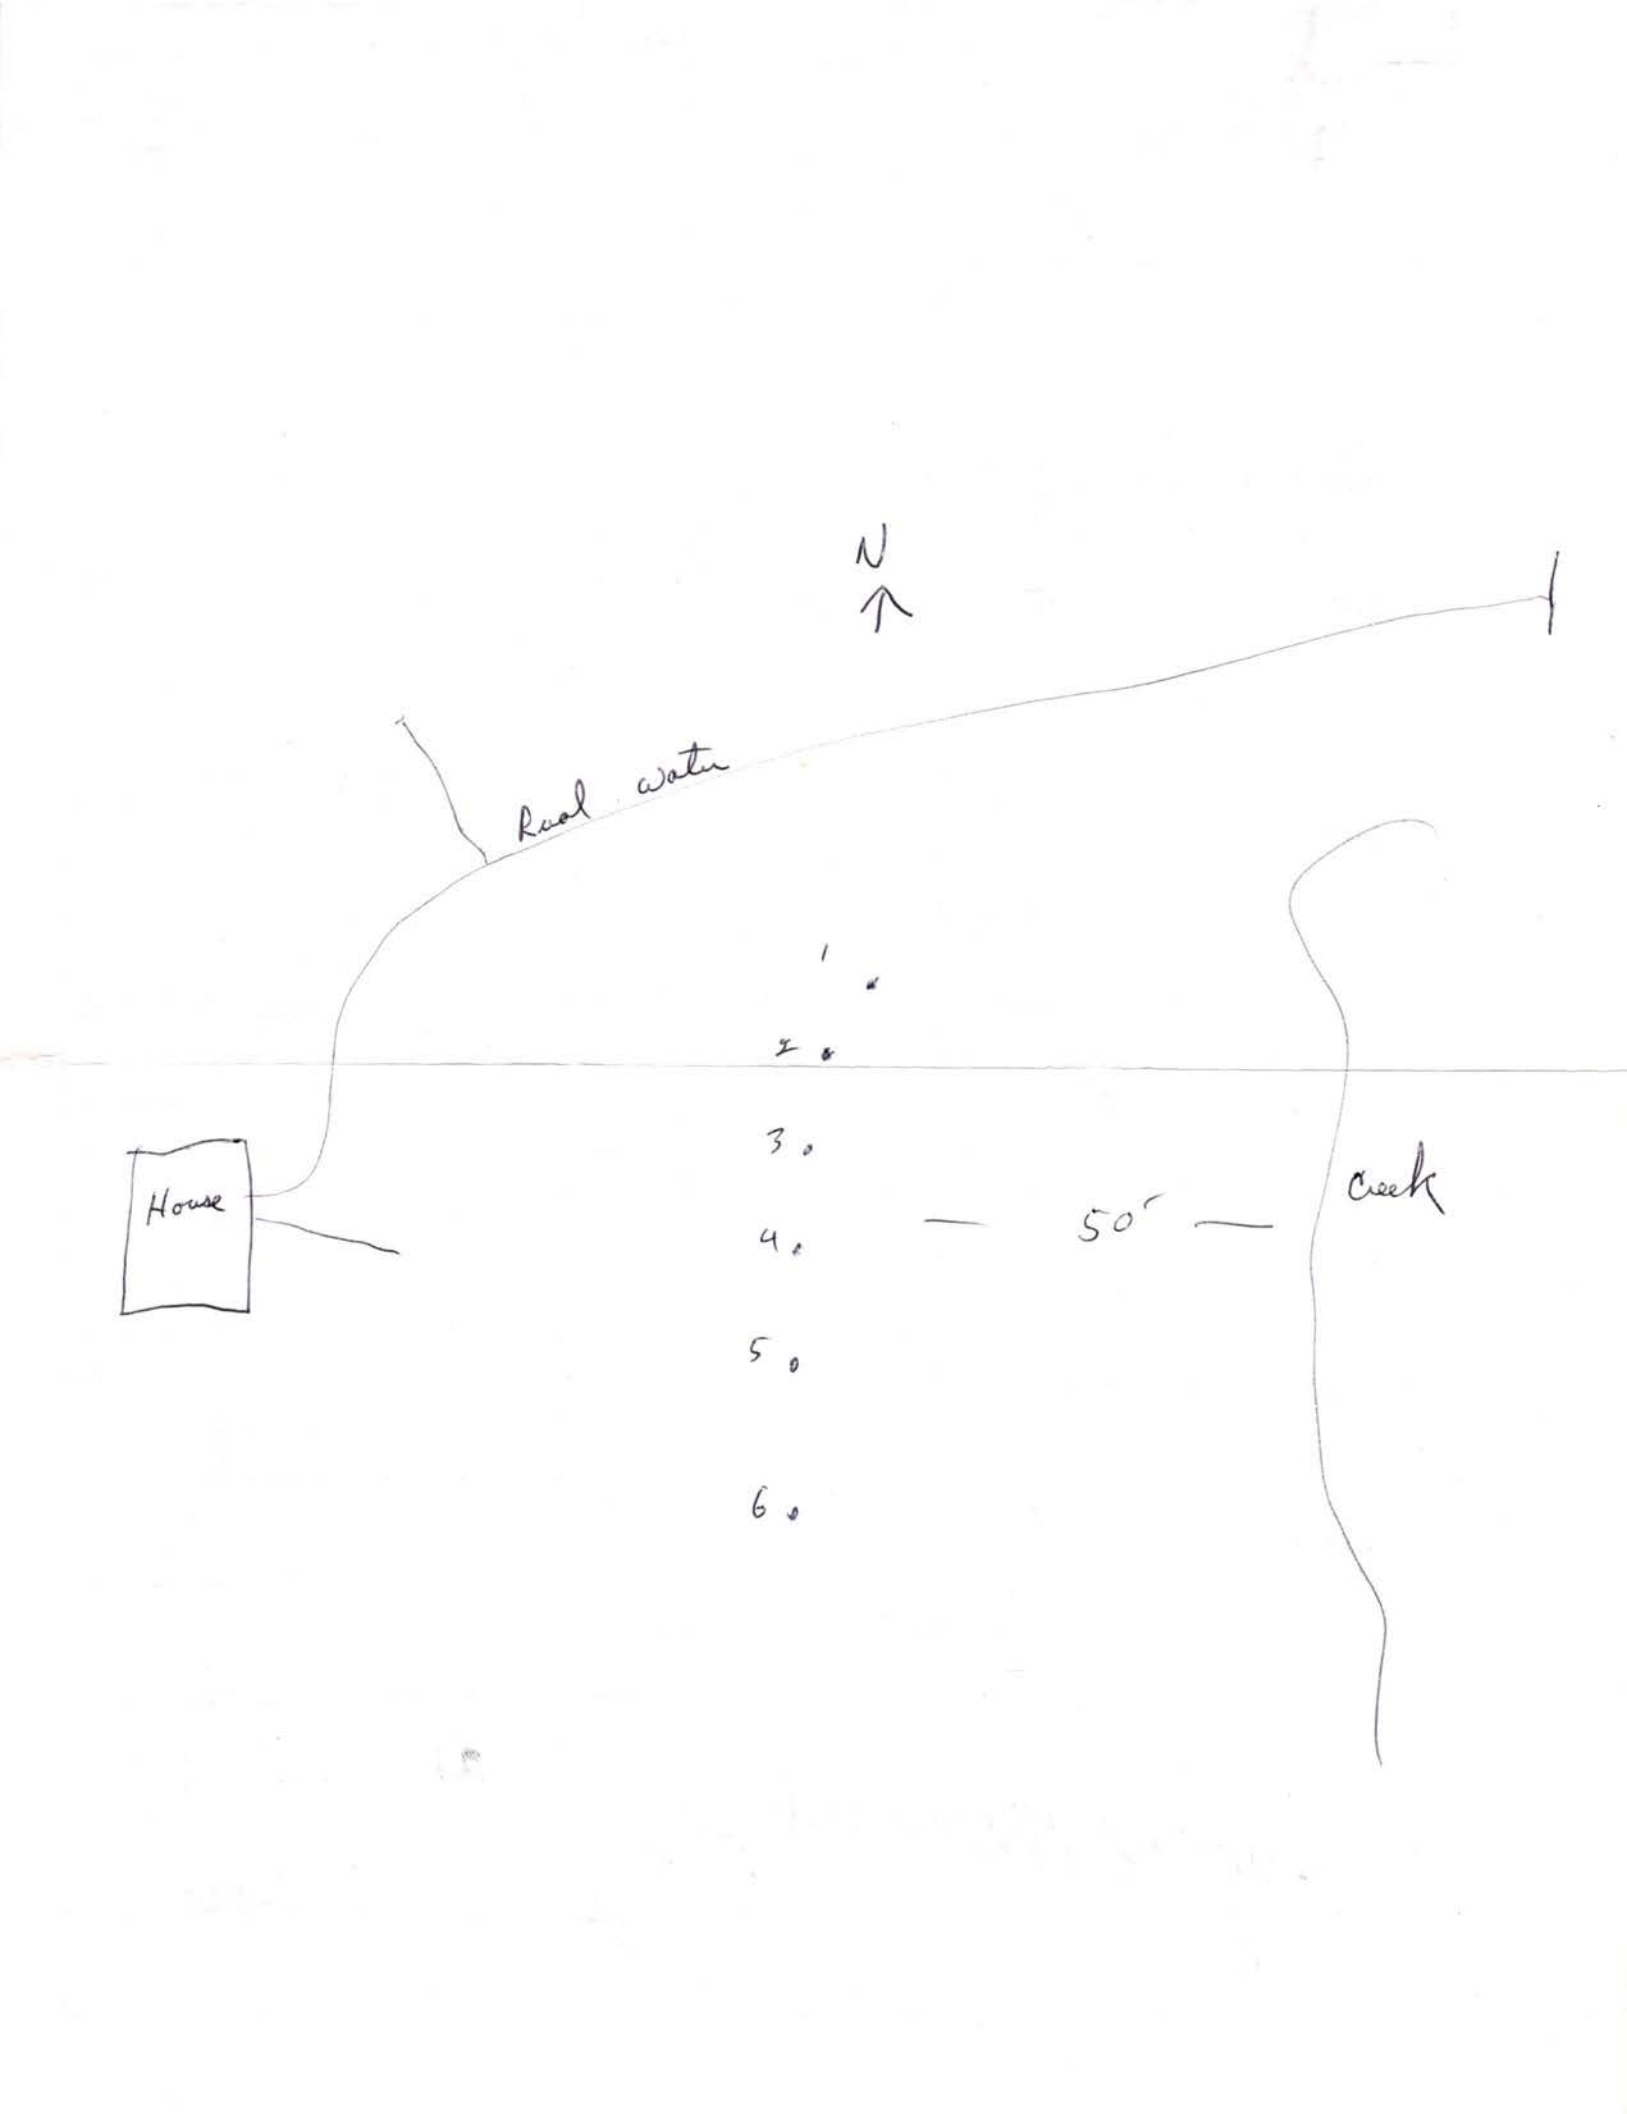
N
Road water
1
2
3
4
5
6
House
50'
Creek

RECEIVED JUN 22 1994

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: ~~471-7800~~ 441-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material 3034 ; Diameter 4 in.
2. Distance above basement floor _____ in., or below basement floor 14 in.
3. Distance between dwelling and septic tank 104 ft.
4. Number of clean-outs 1 .
5. Distances to:
Well or Suction Line _____ ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material Precast ; No. of compartments _____ .
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade ____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade 16 in.
8. Distances to:
Well or Suction Line _____ ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material Precast ; Number - available outlets _____ .
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank 8 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or Perforated Pipe 4 .
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other _____ .
2. Lateral Lines:
Number 4 ; Length of each line 50 , 50 , 50 , 90 , _____ ft.;
Total length of laterals 240 ft.;
Distance between lateral lines 6 ft.
3. Trench dimensions: Width 3 ft.;
Slope 6 in/100 ft.; Average Depth _____ in.
4. Filter Material: Road Gravel
Depth of Material 14 in.
5. Distances to:
Well or Suction Line _____ ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

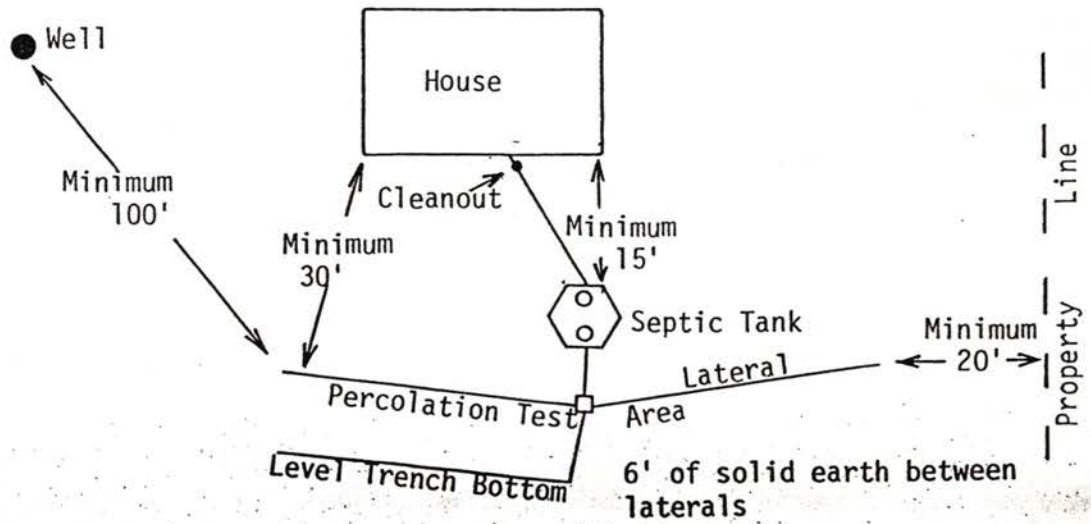

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

Larry Schwack

8200 Old Channel Rd (rc)

489-7294

6-16-94

Mitch Schwartzenbach

Rural Water

