LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 1580-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

February 8, 1980 — THIS PERMIT EXPIRES

Richard Rockenbach — ISSUED TO

Eagle, NE 68347 — ADDRESS

T10N, R8E, Section 24 S½ of NE¼ — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

FILING FEE: $30.00

FILE NO. 1580-C

DATE: _____

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10 n ; Range 8 E ; Section 1 ; 5½ of NE¼ 24
   Block _____ : Lot _____ : Addition _____
   Street Address 190 th Holdrege
2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____
3. Type of Individual Sewage Disposal System: Septic Tank ☑ ; Other ☐
4. Distance to public sewer: _____ ft.

Richard H Rockenbach
Signature of Applicant (Owner or Lessee)

Eagle Nebr
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/8/79. Date Frwd. 8/9/79. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 8-9-79. Date Frwd. _____. ACTION: Approved ☒ Disapproved ☐ Signature: Tom Beasley
3. City or County Engineer: Date Rec'd. 8-9-79. Date Frwd. 8-9-79. ACTION: Approved ☒ Disapproved ☐ Signature: Henry Graff

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 10/3/79 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 10/3/79 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

B

FILE NO. 1580-C

PROPERTY WHERE SOIL TESTED:

Location: Township 10N ; Range 8E ; Section & ¼ Section S½ of NE¼ 23.
Property Dimensions: _____ ft. x _____ ft. Area: 20 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☑ ; Sandy Loam ☐ ; Silt Loam ☑ ; Clay Loam ☐ .
Dates of Tests: 8/14/79 to 8/15/79 . Weather: Precip. none Temp. 81° .

OWNER: _____

Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
						8/15	10:20	5"	10:50				
						8/15	10:22	4 7/8"	10:51				
						8/15	10:25	3 3/4"	10:53				
						8/15	10:28	2 5/8	10:54				
						8/15	10:31	3 7/8	10:55				
						8/15	10:35	2"	10:57				

Richard H Rosbrugh
Signature of Person Conducting Test

Address Eagle Nebr. Phone 781-2974

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Pawnee clay loam
Date: August 6, 1979
On site visit august 6, 1979 doesn't look like Pawnee. 2 ite a bit of black topsoil.

Approved Percolation Rate (a)
A. 25 min./inch
B. _____ min./inch
C. _____ min./inch

Gerrold C. Hood
Signature of Reviewing Official

Strand

1. 11:27 - 8 1/8
2. 11.29 - 7 1/2
3. 11:30 - 5 3/8
4. 11:30 - 5 5/8
5. 11:31 - 6 7/8
6. - 4

third

1. 10 1/8, 12 00
2. 9 1/8 2 00
3. 7 12 00
4. 5 12 00
5. 8 1/4 12 00
6. 5 3/4 12 00

four

1. 12 1/8 12:30
2. 10 3/8 12:30
3. 8 1/4 12:30
4. 5 3/4 12:30
5. 9 1/4 12:30
6. 7 12:30

five

1. 13 1/4 1:00
2. 11 1/4 1:00
3. 9 1/4 1:00
4. 6 3/4 1:00
5. 10 1/2 1:00
6. 8 1/4 1:00

sixth

1. 14" 2:30
2. 11 3/4"
3. 10"
4. 7 1/4"
5. 11 1/4
6. 9"

seventh

1. 15 1/2 2:00
2. 13
3. 10 3/4
4. 8
5. 12 1/4
6. 10

eighth

1. 17 2:30
2. 14
3. 11 3/4
4. 9 3/4
5. 13 1/9
6. 11

1. 5"
3 1/8
2"
2"
1 1/8
3/4
1 1/2
1 1/2
17

2. 4 7/8
2 5/8
2 1/4
1 1/4
1 1/8
1/2
1 1/4
1
14 7/8

3. 3 1/4
2 1/8
1 5/8
1 1/4
1
3/4
3/4
1
11 3/4

4. 2 1/8
1 1/8
1 3/8
3/4
1
1/2
3/4
1 3/4
10 1/2

5. 3 7/8
2 9/16
2 3/4
1
1 1/4
3/4
1
1
14 5/8

6. 2
2
1 3/4
1 1/4
1 1/4
3/4
1
1
1
11

average drop

1

13

3.1

average per hour

Dick - 2 - 7 - 17 - 18 - 27 - 28 - 38 - 41 - 50 - 58

Sue - 8 - 3 - 13 - 14 - 15 - 24 - 34 - 37 - 38 - 40

Mom - 2 - [redacted] - 6 - 7 - 16 - 25 - 32 - 33 - 35

Dad - 8 - 13 - 22 - 23 - 24 - 31 - 40 - 48

Dave - 2 - 7 - 17 - 26 - 27 - 28 - 31 - 32 - 34

Dad - 1 - 2

Dave - 3 - 4 - 6 - 7 - 8

Dick - 3 - 5 - 3 - 4 - 7 - 9

Sue - 1 - [redacted] 3 - 4 - 6 - 7 - 9 - 12

Mom - 3 - 4

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. 1580-C

Indicate on sketch if residence and well are exisiting or proposed.

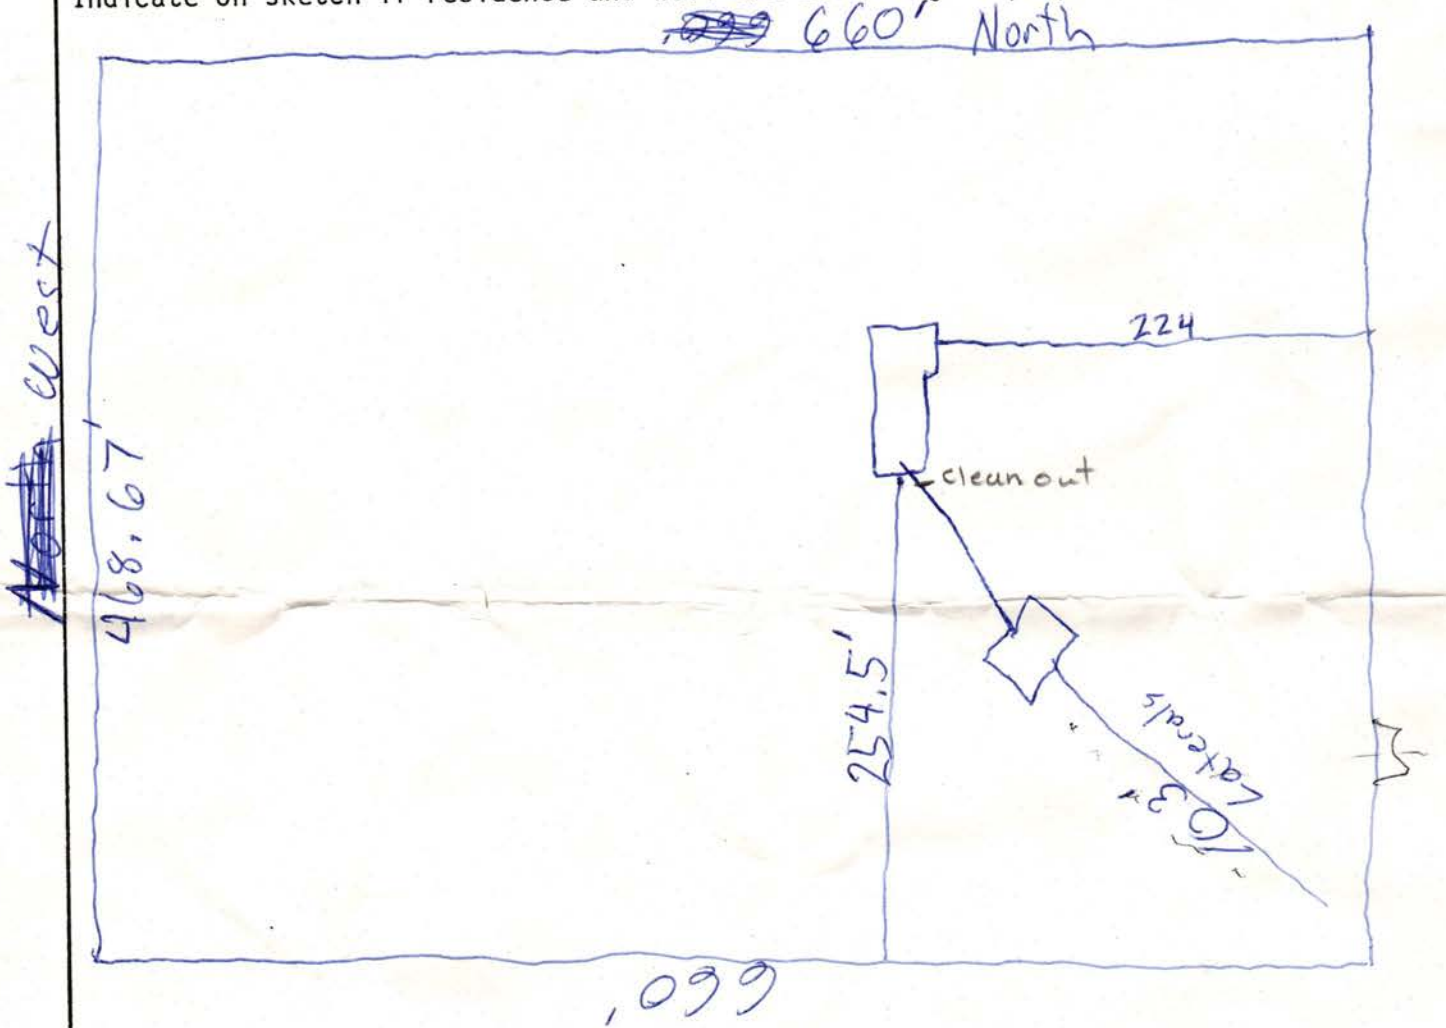

REVIEWING ACTION

Remarks: _____

Date: August 6, 1979

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 689 sq.ft.

Gerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material clay tile; Diameter 4 in.
2. Distance above basement floor _____ in., or below basement floor 6 in.
3. Distance between dwelling and septic tank 100 ft.
4. Number of clean-outs none.
5. Distances to:
Well or Suction Line 100 ft.; Stream 800 ft.; Pressure Line _____ ft.; Property Line 30 ft.

B. SEPTIC TANK:
1. Material Concrete; No. of compartments one.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Pre-Cast Co)
4. Manholes: Over Inlet; diam. none in.
Over Outlet; diam. none in.
Riser Above ☐ Below ☐ Grade ___ in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 24" in.
8. Distances to:
Well or Suction Line 150' ft.; Stream 600 ft.; Pressure Line 50 ft.; Property Line 130 ft.

C. DISTRIBUTION BOX:
1. Material Concrete; Number - available outlets 4.
2. Factory Built: Yes ☐ No ☐
(Company Pre Cast Co)
3. Distance from Septic Tank 4 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐
Diameter of Half Round 18" or Perforated Pipe _____.
Material: fiberglass ☐ ; plastic ☐ ; concrete ☒ ; other _____.
2. Lateral Lines:
Number 2 ; Length of each line 100', 72', _____, _____, _____ ft.;
Total length of laterals 172 ft.;
Distance between lateral lines 8 ft.
3. Trench dimensions: Width 4 ft.;
Slope 5 in/100 ft.; Average Depth 48" in.
4. Filter Material: none
Depth of Material 18 in.
5. Distances to:
Well or Suction Line 100 ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line 130 ft.

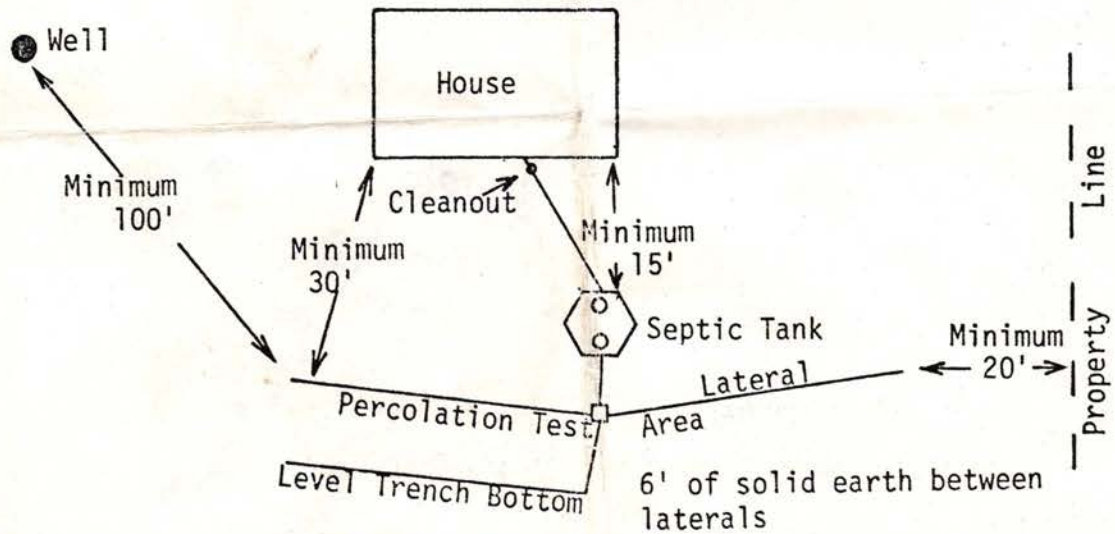


230' if trench 3' wide

172' if trench 4' wide

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

AS BUILT DRAWING OF SYSTEM

DATE 10-3-79 INSTALLER Ralph O. Nelson

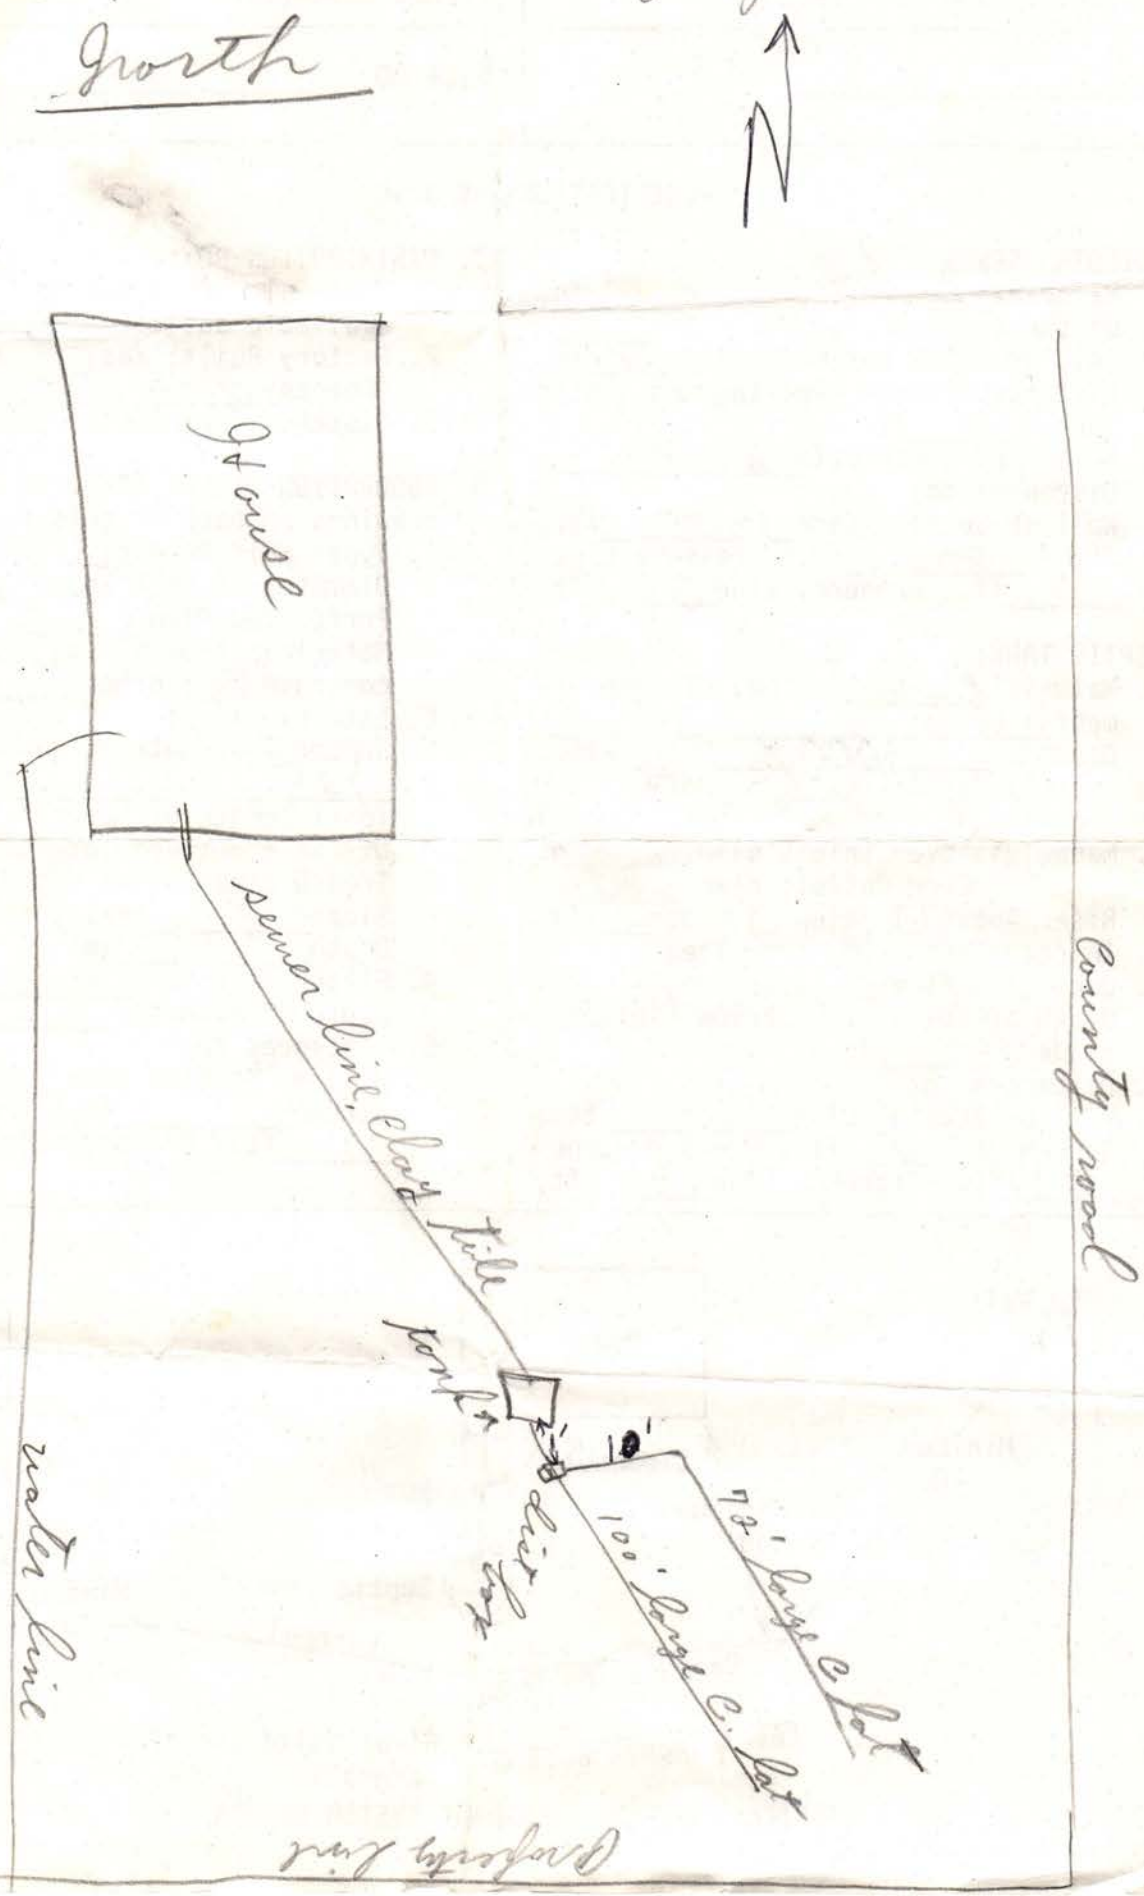

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

8AM Monday

2200 St. Marys Avenue | Phone (402) 471-~~7800~~ 8000 | Lincoln, Nebraska 68502

REAL ESTATE TRANS

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

This form must be completed and returned to reques:
MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County

☐ Evaluation of the Individual Water System
☒ Evaluation of the Sewage Disposal System

Date: Jan. 27, 1989
☒ Enclosed is ~~$45.00~~ $75.00

Legal description of property TWP. 10N ; RAN 8E ; SECTION 24
BLOCK Southpart ; LOT 3 ; ADDITION. Eagle, LCN
Street Address 1101 N 140th Eagle, NE
Directions to Property Go east on C St to 140th Turn north 3/4 mile

Location of Well None Tap Location: Inside ☐ Outside ☐
Location of Sewage System _____ Year Installed 1975

	NAME	ADDRESS	PHONE
Present Owner:	Monica & Clayton Seeland	HCR-1 Box 32 Bandera Texas	
Tenant/Buyer:	Clarence & Donna Poteet	6111 Aylesworth Ave Lincoln NE	466-2421
Return To:	Julie Bullis - Home Real Estate (Austin)	225 N Cotner Lincoln, NE	PH 467-4663 68505

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Donna & Clarence Poteet by Julie Bullis Address 6111 Aylesworth Ave

---

HEALTH DEPARTMENT USE ONLY #75.00

Date Received JANUARY 30, 1989 Received ~~$45.00~~ Check ☒ Cash ☐

CASS COUNTY RURAL WATER PRELIMINARY STATUS--DATE 1/31/89

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☐	☐	Approved:	☒	Date 1/31/89 by J.C.H.
Bacteria	☐	☐	Provisional:	☐	Date _____ by _____
Nitrate	☐	☐	Disapproved:	☐	Date _____ by _____

Comments: IF SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED. SYSTEM IS NOW NINE YEARS OLD. See Attached Letter ☐

CASS COUNTY RURAL WATER DISTRICT FINAL STATUS

WATER SYSTEM: Approved: ☐

SEWAGE DISPOSAL SYSTEM: Approved: ☒ Provisionsal Approval: ☐

APPROVED BY Jerrold C. Wood R.S. DATE JANUARY 31, 1989

FN 20215-1079R

This ~~form~~ is to be completed and returned to the Health Department to initiate a request for loan approval.
Make Checks Payable to: Lincoln-Lancaster County Health Department

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, NE 68502
Phone: 474-1541

Enclosed is $45.00 Fee ☒

DATE: January 25, 1979

The undersigned hereby requests evaluation of the following for loan approval on the below described property:

☒ Evaluation of the Individual Water Supply

☒ Evaluation of the Sewage Disposal System

Legal description of property: Twp. East 600' of N½ of NE¼ of 10 ; Range 8 ; Section 24 ;

Block ; Lot ; Addition .

Street Address Rt. #1 Eagle, Nebr. (190th & Holdrege) ;

Directions on how to get to property 1st house ~~XX~~ on the ~~XX~~ west side of the road .

Location of well south of house approximately 200 yards .

Where is tap: Inside ☐ Outside ☐ .

	NAME	ADDRESS	PHONE
Present Owner:	Richard Rockenbach	Rt. #1 Eagle, Nebr.	781-2974
Tenant:			
Lending Agency:	First Federal S&L Attn: Mr. Furnas	12 & N Lincoln	475-0521

(Do not write below double lines)

Health Department: Date Received

Received $45.00 Check ☒ Cash ☐

Site Visits: Date 2-7-79 by rm
Date 2-21-79 by rm
Date 2-22-79 by rm

Calvin E Freid
Signature of Applicant

14320 Castlewood
Address Waverly, Nebraska 68462

PRELIMINARY STATUS -- DATE 2-5-79

Water System:
~~Approved~~ ☒ Disapproved

Sewage Disposal System:
Approved ☐ Provisional Approval ☐
Disapproved ☒

Corrections Required or Reasons for Disapproval well water has high nitrate
Sewage disposal permit was not taken out at time of installation .

☒ See Attached Letter.

FINAL APPROVAL -- DATE 10-4-79

Water System . Sewage Disposal System ☒ . BY Ron Mangum .
pending attached letter requirements are met.

Form Number 20215-0878