LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 93380107501

Issued 10/08/93
Expires 04/08/94
Revenue Code 108754

Establishment
CAMERON HILL
T11N R5E SEC 14
8101 W WAVERLY ROAD

FEES: $150.00

TOTAL $150.00

Permittee
CAMERON HILL
8101 W WAVERLY RD
LINCOLN NE 68517

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $_____

FILE NO._____

DATE: Sept 17 / 1993

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 11 N ; Range 5E ; Section 14 NW/4 ;
   Block_____: Lot_____: Addition_____
   Street Address 8101 W Waverly Road 68517 Lincoln

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 1 . Describe_____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: N/A ft.

Cameron Hill
Signature of Applicant (Owner or Lessee)

8101 W Waverly Rd
Address Lincoln 68517

(Do not write below this double line)

1. Health Department: Date Rec'd. 10/8/93. Date Frwd. 10/8/93. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 10/8/93. Date Frwd. 10/8/93. ACTION: Approved ☒ Disapproved ☐ Signature: Amy Spurr

3. City or County Engineer: Date Rec'd. 10/8/93. Date Frwd. 10/8/93. ACTION: Approved ☒ Disapproved ☐ Signature: Dana Fillmore

REMARKS OR REASONS FOR DISAPPROVAL_____

Site Visits:
Date: 1-31-94 by: Final installation covered by this section
Date:_____ by: J.C.H.
Date:_____ by:_____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 2/3/94 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 11N ; Range 5E ; Section & ¼ Section 14.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: Sept 27 to Sept 28 . Weather: Precip. 0 Temp. 75 .

OWNER: CAMERON HILL

Address: 8101 W WAVERLY Rd.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	24"	~~SEPT~~ 27	4:30PM	SEPT 28	12:00	9/28	1:00	6 in	2:00	4 3/8	60'	1 5/8	
2	"	"	"	"	"	"	"	"	"	5	"	1	
3	"	"	"	"	"	"	"	"	"	4 3/4	"	1 1/4	
4	"	"	"	"	"	"	"	"	"	5 3/8	"	3/8	
5	"	"	"	"	"	"	"	"	"	5	"	1	
6	"	"	"	"	"	"	"	"	"	~~4~~ 3/4	"	1 1/4	

Melvin F Wagner
Signature of Person Conducting Test

Address RT LINCOLN NE. Phone 797-2365

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date: OCTOBER 8, 1993

Approved Percolation Rate (a)
A. ~~4~~ 5 3 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 6 Sept 93

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material Plastic; Diameter 4 in.
2. Distance above basement floor N/A in., or below basement floor N/A in.
3. Distance between dwelling and septic tank 137 ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line OVER 100 ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.


B. SEPTIC TANK:
1. Material Concret; No. of compartments 1.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Pre-Cast)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade 10 in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 10 in.
8. Distances to:
Well or Suction Line OVER 100 ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material Plastic; Number - available outlets 7.
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank 8 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or Perforated Pipe 4" .
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 2; Length of each line 100, 10, _____, _____, _____ ft.;
Total length of laterals 110 ft.;
Distance between lateral lines _____ ft.
3. Trench dimensions: Width 3 ft.;
Slope 3 in/100 ft.; Average Depth 18 in.
4. Filter Material: Gravel
Depth of Material 12 in.
5. Distances to:
Well or Suction Line OVER 100 ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

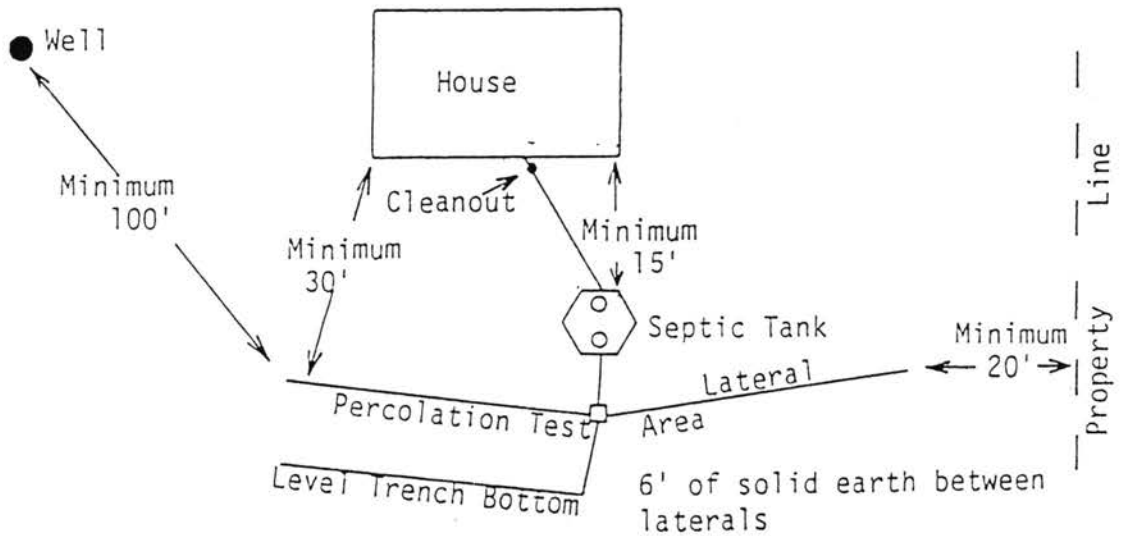

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

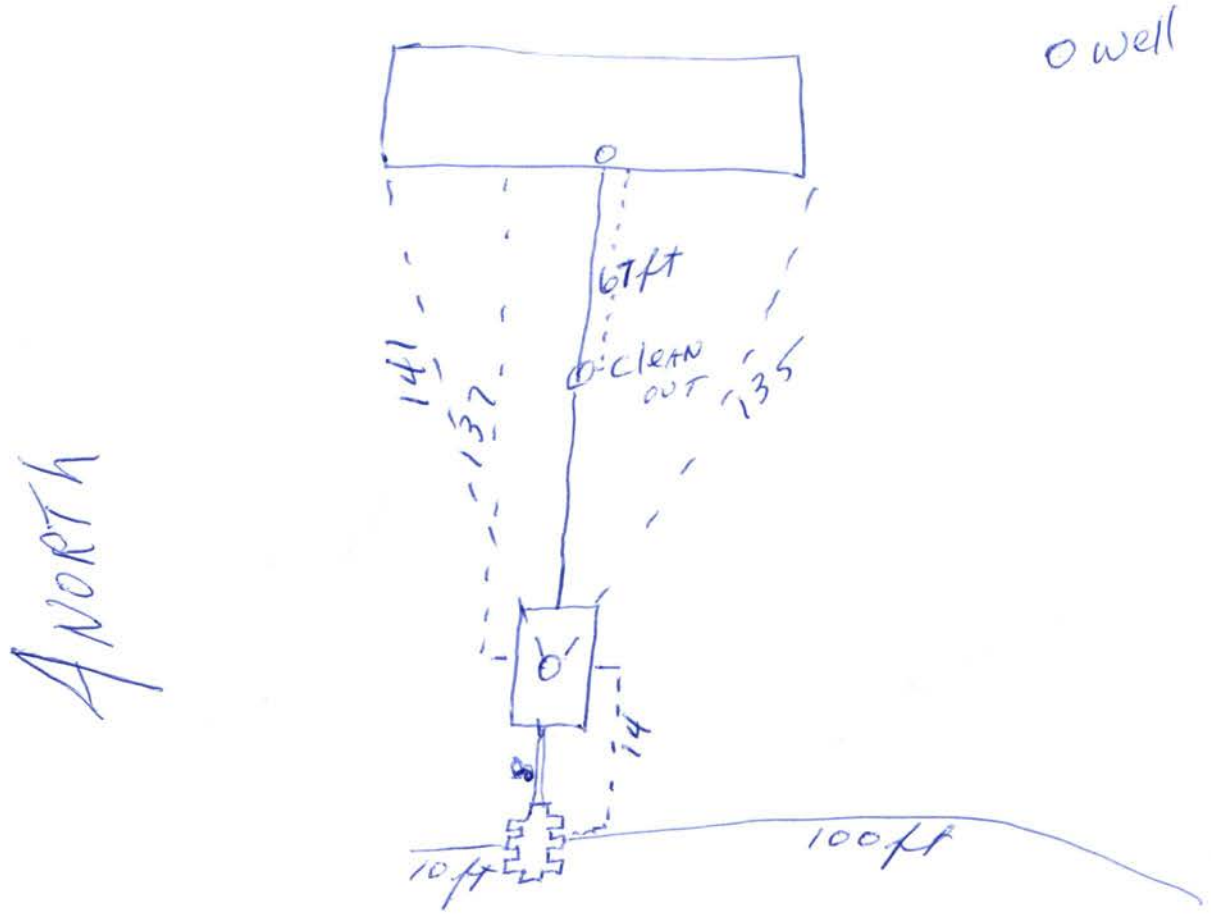
NORTH
well
67ft
CLEAN OUT
141
137
135
6'
4'
3'
10 ft
100 ft