

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave

Lincoln, NE 68502-3785

(402) 441-8000

NON TRANSFERABLE

P E R M I T

Permit

No. 94380116801

SEWAGE INSTALLATION

Issued 05/24/94

Expires 11/24/94

Revenue Code 18754

Establishment

KIRK KINBERG

FEES: \$150.00

T10N R8E SEC 31

WINDHOCK ESTATE BLK 1 LOT 3



Permittee

KIRK KINBERG

4100 S 78 ST

LINCOLN NE 68506

TOTAL \$150.00

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: \$ 150

FILE NO. _____

DATE: 5-23-94

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N; Range 8E; Section 31;
Block 1; Lot 3; Addition WindHock Estates 112 + Van Dorn
Street Address 2400 Secretariat CT 5 Acres.
2. Property Use: Residential ☒; Commercial ☐ Other Use ☐
No. of Bedrooms 4. Describe _____
3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐
4. Distance to public sewer: _____ ft.

Kirk Kimberg by Robert E. Schulz
Signature of Applicant (Owner or Lessee)

4100 South 78th 68506
Address

(Do not write below this double line)

- | | | |
|---|---|--|
| 1. Health Department: | Date Rec'd. <u>5/23/94</u>
Date Frwd. <u>5/24/94</u> | ACTION: Approved ☒ Disapproved ☐
Signature: <u>Terrell C. Hood</u> |
| 2. Supt. Bldg. Insp.:
or Village Clerk | Date Rec'd. <u>5/24/94</u>
Date Frwd. <u>5/24/94</u> | ACTION: Approved ☒ Disapproved ☐
Signature: <u>Ray</u> |
| 3. City or County
Engineer | Date Rec'd. <u>5-24-94</u>
Date Frwd. <u>5-24-94</u> | ACTION: Approved ☒ Disapproved ☐
Signature: <u>R.D. Muehman</u> |

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:

Date: 10-11-94 by: P.D. need drawing
Date: _____ by: _____
Date: _____ by: _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL

Date: 10-18-94 By: Paul

(Reference: City Ordinance No. 9150 and
County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

112th + Ast 1/2 mile So. East side

FILE NO. _____

Location: Township _____; Range _____; Section & ¼ Section _____.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach
Sheet C with sketch of property).

Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☒ .

Dates of Tests: 4-30-94 to 5-1-94. Weather: Precip. 0 Temp. 50°

OWNER: Kirk Kingberg

Address: 4100 So. 78th Lincoln, NE.
489-5592 . 68506

PERCOLATION TEST DATA TABLE

[illegible]

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Mike Hoagland
Signature of Person Conducting Test

Address 2700 Dan Ave Lincoln NE Phone 464-0638

Address 2100 N.W.
Precast Product Inc.

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): bedson silt loam
Date: MAY 24, 1994

Approved Percolation Rate (a)

A.	<u>30</u>	min./inch
B.	_____	min./inch
C.	<u>0</u>	min./inch

Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEW-
AGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test
hole locations, well, residence, direction
and property line.

FILE NO. _____

Indicate on sketch if residence and well are existing or proposed.

REVIEWING ACTION

Remarks: _____

Date: May 24, 1994

Minimum Design Requirement

1. Capacity of Septic Tank 1250 gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed 1000 sq.ft.

Jerrold C. Hood

Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL
SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

INCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 10-11-94

FILE NO. _____

2400 Secretariat

SPECIFICATIONS AS BUILT

A. BUILDING SEWER:

1. Material PVC; Diameter 4" in.
2. Distance above basement floor _____
in., or below basement floor 36 in.
3. Distance between dwelling and septic
tank 56 ft.
4. Number of clean-outs 1
5. Distances to:
Well or Suction Line 100+ ft.;
Stream 100+ ft.; Pressure Line
_____ ft.; Property Line 100+ ft.

B. SEPTIC TANK:


1. Material Concrete; No. of compart-
ments 1
2. Capacity 1250 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Precast)
4. Manholes: Over Inlet; diam. 6" in.
Over Outlet; diam. 6" in.
Riser Above ☐ Below ☒ Grade 8 in.
5. Inlet: Baffle ☒; or Tee ☐
6. Outlet: Baffle ☒; or Tee ☐
7. Depth of top of tank below finished
grade 32 in.
8. Distances to:
Well or Suction Line 100+ ft.;
Stream 100+ ft.; Pressure Line
100+ ft.; Property Line 100+ ft.

C. DISTRIBUTION BOX:

1. Material Concrete; Number -
available outlets 5
2. Factory Built: Yes ☒ No ☐
(Company Precast)
3. Distance from Septic Tank 8 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)

1. Type: Half Rounds ☒ Perforated Pipe ☐
Diameter of Half Round 20" or
Perforated Pipe _____
Material: fiberglass ☐; plastic ☐;
concrete ☒; other _____
2. Lateral Lines:
Number 3; Length of each line 88,
84, 80 ft.;
Total length of laterals 252 ft.;
Distance between lateral lines 14' ft.
3. Trench dimensions: Width 4 ft.;
Slope 4" in/100 ft.; Average
Depth 42" in.
4. Filter Material: gravel
Depth of Material 2" in.
5. Distances to:
Well or Suction Line 100+ ft.;
Stream 70+ ft.; Pressure Line
100+ ft.; Property Line 100+ ft.

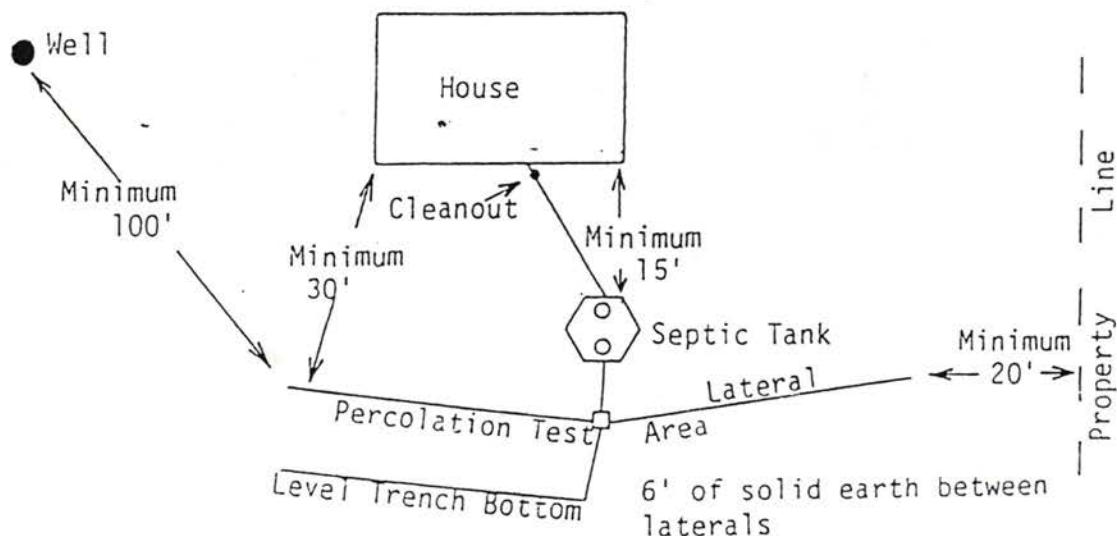

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

2400 Secretariat

House

N →

