

FILE NO. 317

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION

June 28, 1973

TYPE OF LICENSE OR PERMIT

THIS LICENSE OR PERMIT EXPIRES

N.D. Judds Co.Box 30230 Lincoln

LICENSEE OR PERMITTEE

ADDRESS

TION: RSE: Sec. 32

NAME OF ESTABLISHMENT, IF ANY

ADDRESS

LEGAL DESCRIPTION

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
\$ <u>30.00</u>	\$	\$	\$	\$ <u>30.00</u>
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
<u>6244035</u>	<u>110.16</u>	<u>148.14</u>	<u>6-2</u>	
SERIAL NO.	DATE	AMOUNT		

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

INTER-DEPARTMENT COMMUNICATION

TO: Charles Seale DATE: December 28, 1972

DEPARTMENT: Building Inspections FROM: Jerrold C. Hood

ATTENTION:

CARBONS TO: DEPARTMENT: Health

SUBJECT: Individual Sewage
System Construction
File No. 317
N.D. Judds Co.
Box 30230, Lincoln

The application and plans have been reviewed and approved for the construction of an individual sewage disposal system on property legally described as:

T10N; R8E; Sec. 32.

Jerrold C. Hood, R. S., Chief
Section of General Sanitation
Division of Environmental Health

JCH: ch

FORM HD-30(67) REQUEST FOR SITE
CLEARANCE FOR
INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 317

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 8E; Section 32;
WEST QUARTER, SECTION Block ; Lot ; Addition ;
33 TION RANGE 8E of Street Address .
6 P.M. LANCASTER COUNTY
2. Property Use: Residential ☒ Commercial ☐
No. of Bedrooms 3 Describe:
Other Use ☐
Describe:
3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐
4. Distance to public sewer: ft.

N.D. Judds Co. / Gary Menick
Signature of Applicant (owner or lessee)
Box 30230, Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 12/28/72. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 12/29/72. Signature: Verrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd. 12-29-72. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 12-29-72. Signature: LEE PITS
3. City City Engineer: Date Rec'd. 12-29-72. ACTION: Approved ☒ Disapproved ☐
Date Frwd. ". Signature: J. L. Blumharg

REMARKS OR REASONS FOR DISAPPROVAL

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: Signature

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 317

DATE: 12/22/72

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 8E; Section 32;
Block _____; Lot _____; Addition _____;
WEST QUARTER, SECTION 32,
T10 N RANGE 8E OF
6 P.M. LANCASTER COUNTY
Street Address _____

2. Property Use: Residential ☒; Commercial ☐
No. of Bed Rooms 3 Describe: _____

Other Use ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

N.D. Judds. Gary McIntosh
Signature of Applicant (owner or lessee)

Box 30230, Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: \$ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: 9/20/73 by: J.C.H.
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved ☒; Disapproved ☐: 12/28/72
by: Herold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: _____ by: _____

Closed off this date
2-28-77

FORM HD-33(67) SOIL ABSORPTION
TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 317

PROPERTY WHERE SOIL TESTED:

Location: Township _____

Section & $\frac{1}{4}$ Sect. WEST 32

Property Dimensions: 400 ft. x 577 ft.

Area: 5.3 acres. (Attach sketch of property showing hole location).

Soil Type: Silty Clay ☒; Silty Clay Loam ☐; Sandy Loam ☐

Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 12/27/72 to 12/28/72. Weather: Precip. 0 Temp. 36

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start		End		Water Level (in.)	Elaps- ed Time (Min.)	Water Level Drop (in.)	Perco- lation Rates (Min./inch)
		Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)				
1	30"	12/27	9:00	12/28	9:00	12/28	9:00	18 1/2	9:30	19 1/2	30	1"	30
2								19 1/2		20		1/2	60
3								19 1/2		20		1/2	60
4								20 1/2		21 1/4		3/4	38
5								19		19 1/2		1/2	60
6								19 3/4		20 1/4		1/2	60

Say Meints
Signature of Person Conducting Test

Sum of Percolation Rates 308
Average of Rates: 53
Mean of Rates: _____

Address Box 20230
Phone: 488-6672

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

DATE: December 28, 1972

Approved Percolation Rate(s)

A. 53 min./inch

B. _____ min./inch


C. _____ min./inch

Herold C. Hood
Signature of Reviewing Official



1" = 60'

ROAD
WALTON: 1/2 MILE

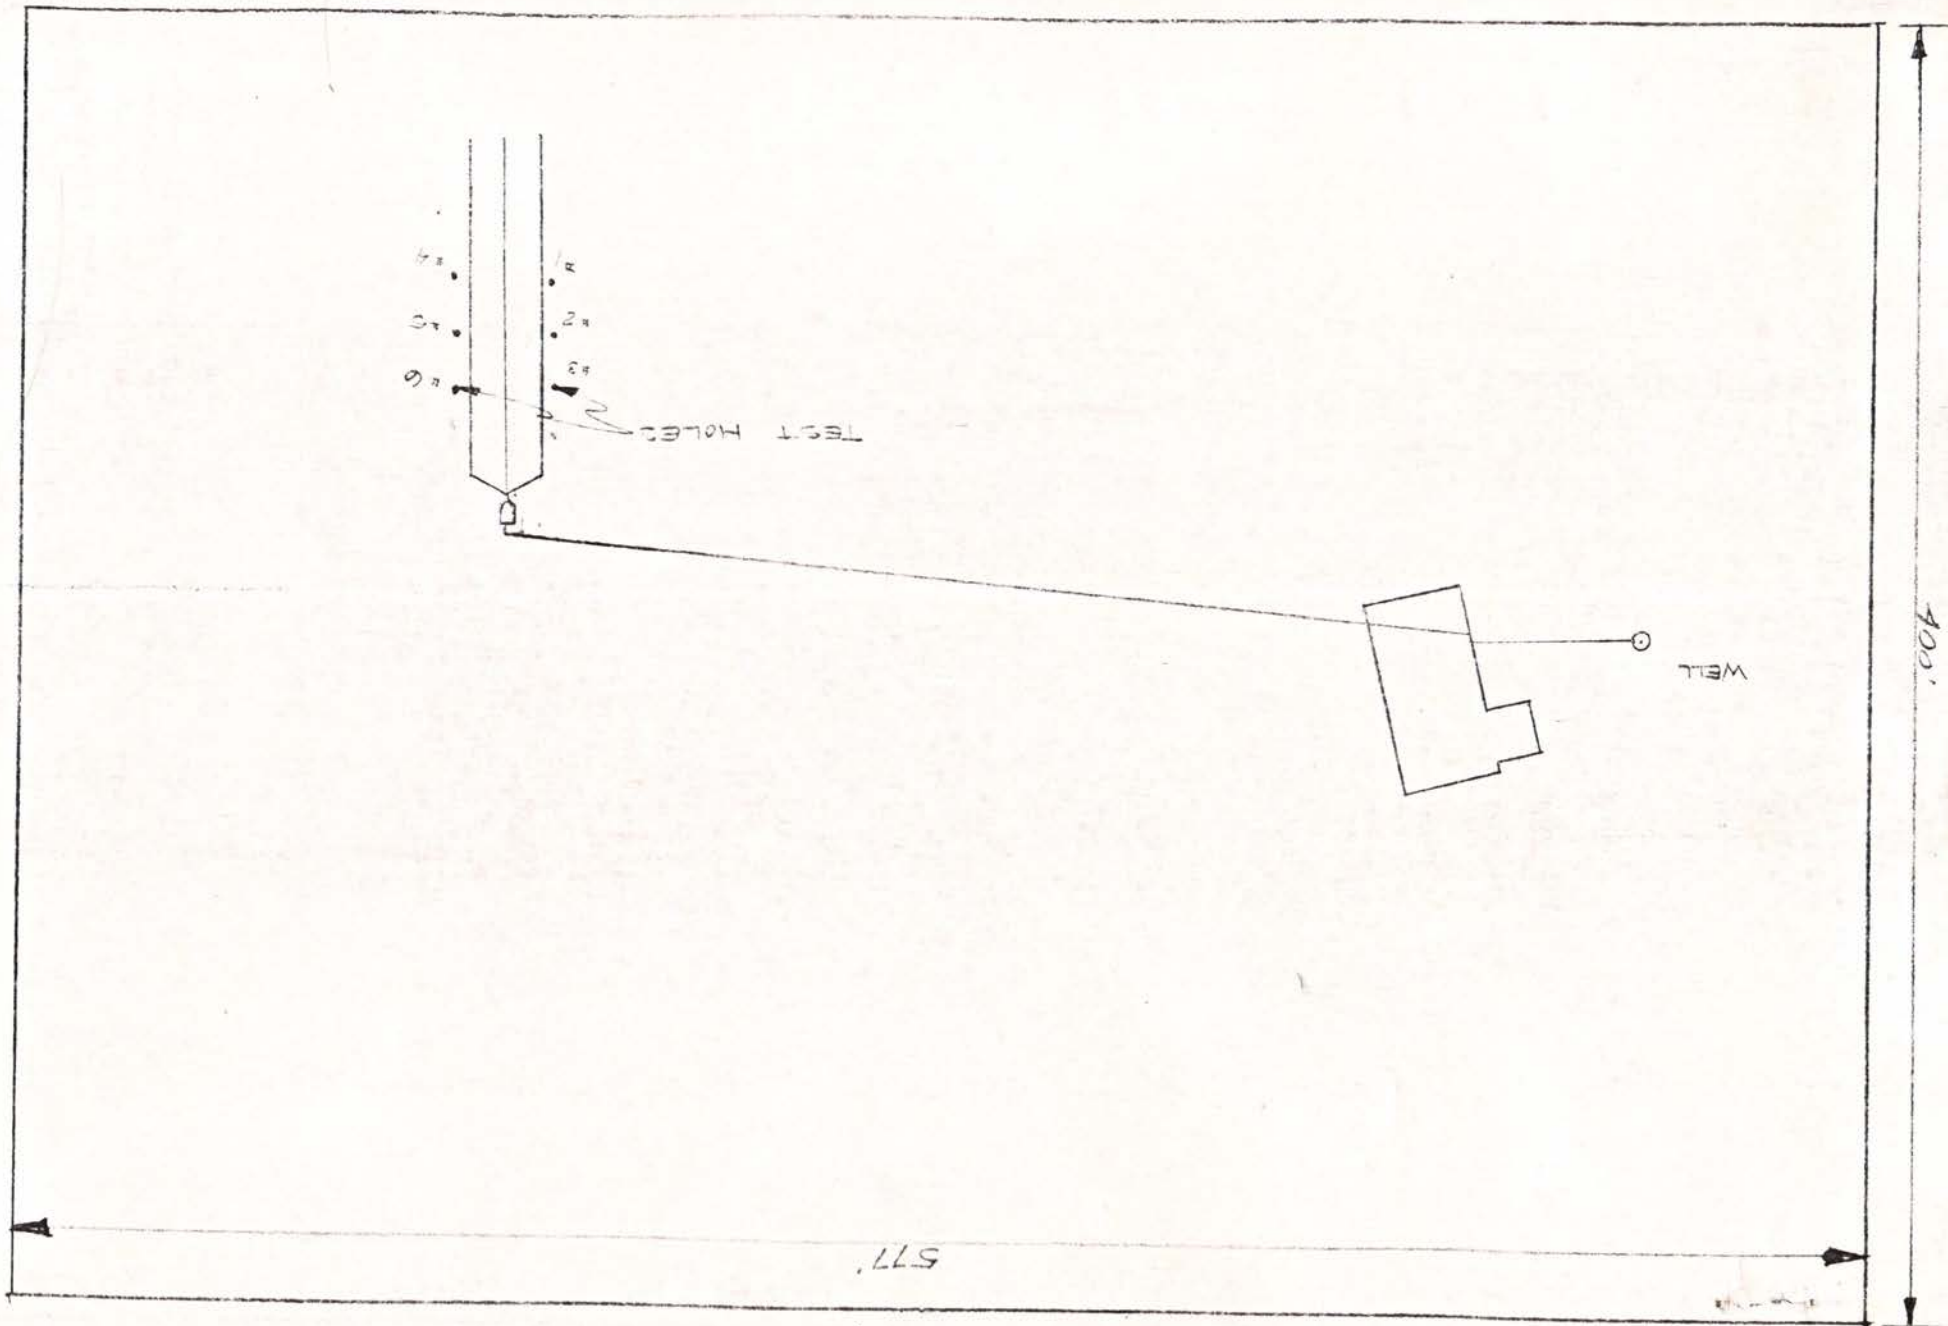

FILE NO. 317

SPECIFICATIONS

DATE: 12/22/72

A. BUILDING SEWER: PLASTIC

1. Material P.I.; Diameter 5" in.
2. Distance above basement floor — in.;
or below basement floor 13 in.
3. Distance between dwelling and septic
tank 270 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 50 ft.;
Stream — ft.; Pressure Line — ft.;
Property Line 125 ft.

B. SEPTIC TANK (Provide construction drawings.)

1. Material FIBERGLASS; No. of compart-
ments 1.
2. Capacity 1000 gals.; Liquid depth 47 in.
3. Factory Built: Yes ☒ (Company Pre-Cast)
No ☐ CORRUGATED FIBERGLASS
4. Manholes: Over Inlet; diam. — in.
Over Outlet; diam. — in.
Below Grade 12" in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished
grade 12 in.
8. Distances To:
Well or Suction Line 350 ft.;
Stream — ft.; Pressure Line — ft.;
Property Line 150 ft.


C. DISTRIBUTION BOX

1. Material CON; No. available out-
lets 5.
2. Factory Built: Yes ☒ (Company PRE-CAST STEP)
No ☐
3. Dimension: Length — in.; Width — in.
Depth — in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☐; No ☒
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)

1. Type: HALF MOON
2. Lateral Lines: Depth below grade 8 in.
Number 32; Length of each line — ft.
Total length of Laterals 313 ft.;
Slope 4 in/100 ft. Diameter of
pipe 16 in.; Shape D
Material: concrete ☒; fiber
asbestos ☐; clay ☐; other —
Distance between lateral lines 12 ft.
3. Trench Dimensions: Depth 36 in.;
Width 48 in.
4. Filter Material: Gravel
Depth of material from trench
bottom 36 in.
5. Distances To:
Well or Suction Line 350 ft.;
Stream — ft.; Pressure Line — ft.
Property Line 40 ft.
6. Percolation Rate: 53 minutes/inch

TYPICAL SKETCHES

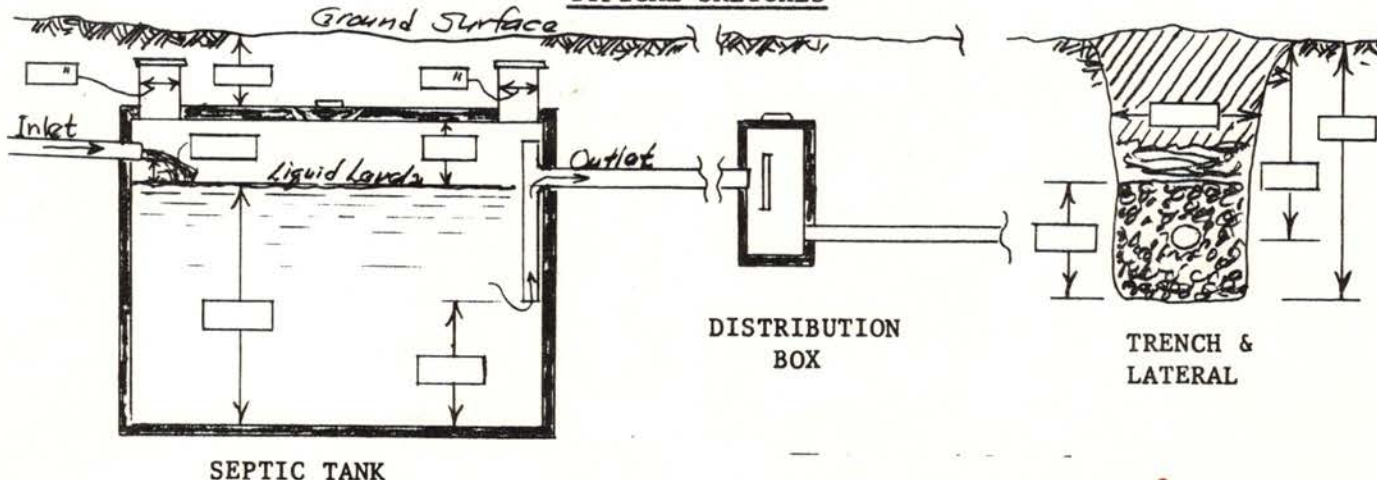

N.D. Judds Co. Gary Meints
Signature of Applicant


PROPERTY

LINE


47'

91'

98 1/2'

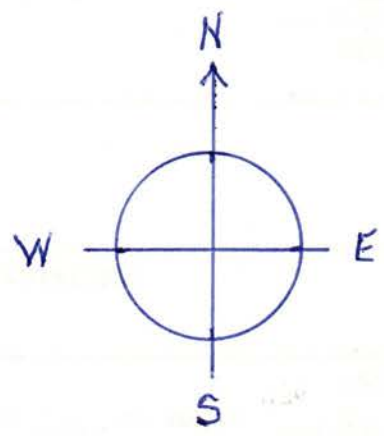

18' 8"

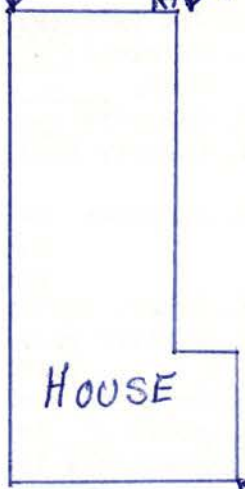

HOUSE

21' WELL

